



SMALL-SIGNAL SECURITY ASSESSMENT CONSIDERING MINIMUM REDISPATCH

Thiago José Masseran Antunes Parreiras

Tese de Doutorado apresentada ao Programa de Pós-graduação em Engenharia Elétrica, COPPE, da Universidade Federal do Rio de Janeiro, como parte dos requisitos necessários à obtenção do título de Doutor em Engenharia Elétrica.

Orientadores: Glauco Nery Taranto
Sergio Gomes Junior

Rio de Janeiro
Julho de 2017

SMALL-SIGNAL SECURITY ASSESSMENT CONSIDERING MINIMUM
REDISPATCH

Thiago José Masseran Antunes Parreiras

TESE SUBMETIDA AO CORPO DOCENTE DO INSTITUTO ALBERTO LUIZ
COIMBRA DE PÓS-GRADUAÇÃO E PESQUISA DE ENGENHARIA (COPPE)
DA UNIVERSIDADE FEDERAL DO RIO DE JANEIRO COMO PARTE DOS
REQUISITOS NECESSÁRIOS PARA A OBTENÇÃO DO GRAU DE DOUTOR
EM CIÊNCIAS EM ENGENHARIA ELÉTRICA.

Examinada por:

Prof. Glauco Nery Taranto, Ph.D.

Prof. Sergio Gomes Junior, D.Sc.

Prof. Tatiana Mariano Lessa de Assis, D.Sc.

Prof. João Alberto Passos Filho, D.Sc.

Prof. Kjetil Uhlen, Ph.D.

Dr. Nelson Martins, Ph.D.

RIO DE JANEIRO, RJ – BRASIL
JULHO DE 2017

Parreiras, Thiago José Masseran Antunes

Small-signal Security Assessment Considering Minimum
Redispatch / Thiago José Masseran Antunes Parreiras. –
Rio de Janeiro: UFRJ/COPPE, 2017.

XV, 143 p.: il.; 29,7cm.

Orientadores: Glauco Nery Taranto

Sergio Gomes Junior

Tese (doutorado) – UFRJ/COPPE / Programa de
Engenharia Elétrica, 2017.

Referências Bibliográficas: p. 113 – 118.

1. Power system stability. 2. Small-signal security
assessment. 3. Small-signal security boundary. 4.
Oscillation damping control. I. Taranto, Glauco Nery
et al. II. Universidade Federal do Rio de Janeiro, COPPE,
Programa de Engenharia Elétrica. III. Título.

This work is dedicated to all my relatives, for everything that they always provided to me, for all the support that they always gave to me, because they have been by my side, in all the moments of my life, especially, when I most needed.

Thank you very much!

"One does not make friends. One recognizes them."

Garth Henrichs

"If I have seen further, that is because I stood on the shoulders of giants."

Isaac Newton

Acknowledgment

I thank God for my existence and for all the blessings that He always provides to me, my mother, Maria Helena Masseran, my father, Nivaldo Parreiras, my sister, Viviane Masseran, and all my family, which always supported me in all the moments of my life, and all my friends that helped me during this journey in this graduation.

I would like to thank all the professors that participated of my academic formation during this doctoral course and, especially, I thank professor Glauco Nery Taranto, from Electrical Engineering Program (PEE) of Alberto Luiz Coimbra Institute of Graduation and Engineering Research (COPPE), which was my advisor in this work.

I also thank all my work friends and colleagues from Energetic Research Company (EPE) and from Electrical Energy Research Center (CEPEL), especially, my friends Nicolas Abreu and Tiago Amaral, for all the help that they gave to me during this graduation, and, more especially, I would like to thank researcher Sergio Gomes Junior, which was my coadvisor during this doctoral course, providing all the support to the development of the researches made and described in this doctoral thesis.

Finally, I thank the National Council for Scientific and Technological Development (CNPq) for the financial support, which allowed the realization of an interchange in Norway, through the Science Without Borders program, at the Norwegian University of Science and Technology (NTNU), which was important to the success of the researches made in this thesis, and, especially, I thank professor Kjetil Uhlen, which was my advisor during this interchange period, and my friend Knut Bjorsvik for all the help that he gave to me during the realization of the work in this interchange.

Resumo da Tese apresentada à COPPE/UFRJ como parte dos requisitos necessários para a obtenção do grau de Doutor em Ciências (D.Sc.)

AVALIAÇÃO DE SEGURANÇA A PEQUENOS SINAIS CONSIDERANDO REDESPACHO MÍNIMO

Thiago José Masseran Antunes Parreiras

Julho/2017

Orientadores: Glauco Nery Taranto
Sergio Gomes Junior

Programa: Engenharia Elétrica

Este trabalho apresenta uma revisão dos principais conceitos relacionados à estabilidade eletromecânica de sistemas de potência e das características associadas às avaliações de segurança de tensão, transitória e a pequenos sinais (VSA, TSA e SSA). A última é o foco desta pesquisa.

O desenvolvimento de novas ferramentas de avaliação de segurança a pequenos sinais e suas implementações computacionais no programa PacDyn, do Centro de Pesquisas de Energia Elétrica (CEPEL), são descritos.

Um método para determinação de redespacho mínimo em sistemas de potência usando sensibilidades de geração (CSBGRES) é proposto. Este é um método de otimização que considera um fator de amortecimento desejado para modos de oscilação como restrição.

O método CSBGRES pode ser utilizado para a determinação de margens de segurança a pequenos sinais ou de medidas corretivas, visando a melhoria do comportamento dinâmico de sistemas de potência.

Abstract of Thesis presented to COPPE/UFRJ as a partial fulfillment of the requirements for the degree of Doctor of Science (D.Sc.)

SMALL-SIGNAL SECURITY ASSESSMENT CONSIDERING MINIMUM
REDISPATCH

Thiago José Masseran Antunes Parreiras

July/2017

Advisors: Glauco Nery Taranto
Sergio Gomes Junior

Department: Electrical Engineering

This work presents a review of the main concepts related to electromechanical stability of power systems and of characteristics associated to the voltage, transient and small-signal security assessments (VSA, TSA and SSA). The last one is the focus of this research.

The development of new tools for small-signal security assessment and their computational implementations in software PacDyn, from Electrical Energy Research Center (CEPEL), are described.

A method for determining minimum redispatch for power systems using generation sensitivities (CSBGRES) is proposed. This is an optimization method that considers a desired damping factor for oscillation modes as constraint.

The CSBGRES method can be utilized for the determination of small-signal security margins or of corrective measures, aiming at the dynamic behavior improvement of power systems.

Summary

List of Figures	xii
------------------------	------------

List of Tables	xv
-----------------------	-----------

1 Introduction	1
1.1 Contextualization	1
1.2 Research Motivations	3
1.3 Thesis Contributions	3
1.4 Thesis Structure	4
1.5 Published Papers	5
1.6 Submitted Papers	6
1.7 Related Dissertations	6
1.8 Final Considerations	7
2 Power System Stability	8
2.1 Basic Concepts	8
2.2 Transient Stability	10
2.2.1 Non-linear System Modelling	11
2.3 Small-signal Stability	12
2.3.1 System Model Linearization	13
2.3.2 Eigenvalues and Eigenvectors	15
2.3.3 Participation Factors and Mode Shapes	17
2.3.4 Residue, Controlability and Observability	20
2.3.5 Control System Design	26
2.4 Final Considerations	30

3	State of Art and Concepts	31
3.1	DSA Tools and Techniques	31
3.2	On-line DSA Method	32
3.3	DSA Tool in an EMS	33
3.4	SSA Tools and Characteristics	34
3.5	SSA Numerical Index	35
3.6	DSA in Planning and Operation	36
3.7	Static and Dynamic Security	37
3.8	Oscillation Monitoring in SDSA	38
3.9	Final Considerations	39
4	Security Assessment Theory	40
4.1	Basic Concepts	40
4.2	Power System VSA and TSA	42
4.3	Power System SSA	47
4.3.1	Damping Nomogram Method	49
4.3.2	Root-locus Method	50
4.3.3	On-line Monitoring of Oscillations	52
4.4	Computational Implementations	56
4.4.1	Damping Nomogram Method	56
4.4.2	On-line Monitoring of Oscillations	58
4.5	Final Considerations	60
5	Hopf Bifurcation Application	61
5.1	Hopf Bifurcation Analysis	61
5.2	Closest Hopf Bifurcation Review	63
5.3	Generation Sensitivities	67
5.4	Hopf Bifurcation for Redispatch	69
5.5	Computational Implementations	77
5.5.1	Generation Sensitivities	77
5.5.2	Hopf Bifurcation for Redispatch	79
5.6	Final Considerations	81

6	Tests and Results	82
6.1	SAGE System Results	82
6.2	Two Areas System Results	90
6.3	Brazilian Power System Results	96
6.4	Nordic 44 System Results	100
6.5	Final Considerations	108
7	Conclusion	109
7.1	Considerations	109
7.2	Conclusions	111
7.3	Future Works	112
	References	113
A	SAGE System	119
A.1	Power Flow Data File	120
A.2	Dynamic Data File	123
B	Two Areas System	124
B.1	Power Flow Data File	125
B.2	Dynamic Data File	126
C	Brazilian Power System	128
C.1	Power Flow Data File	129
C.2	Dynamic Data File	131
D	Nordic 44 System	137
D.1	Power Flow Data File	138
D.2	Dynamic Data File	142

List of Figures

2.1	Power system stability division.	9
2.2	Rotor angle stability subdivision.	10
2.3	Schematic examples of mode shapes.	20
2.4	Transfer function $G(s)$ with feedback through $PSS(s)$	26
2.5	Schematic Nyquist diagram for the range $0 \leq \omega < \infty$	27
2.6	Nyquist diagram with module and phase compensation.	28
2.7	Nyquist diagram with phase compensation.	29
4.1	Schematic example of a SDSA nomogram.	41
4.2	Off-line voltage security assessment scheme.	43
4.3	On-line voltage security assessment scheme.	43
4.4	Off-line transient security assessment scheme.	44
4.5	On-line transient security assessment scheme.	45
4.6	Nomogram relating <i>Gen 1</i> and <i>Gen 2</i> generation groups.	45
4.7	Nomogram relating <i>Gen 1</i> and <i>Gen 3</i> generation groups.	46
4.8	Nomogram relating <i>Gen 2</i> and <i>Gen 3</i> generation groups.	46
4.9	Off-line small-signal security assessment scheme.	48
4.10	On-line small-signal security assessment scheme.	48
4.11	Schematic example of a SSA nomogram.	49
4.12	Schematic SSA root-locus example.	51
4.13	Mode damping factor mapping.	51
4.14	Schematic OLMO of a secure system.	53
4.15	Schematic OLMO of an insecure system.	53
4.16	Schematic OLMO of a secure system with forecasting.	54

4.17	Schematic OLMO of an insecure system with forecasting.	54
4.18	Schematic OLMO with forecasting and corrective measure.	55
4.19	SSA scenario creation algorithm.	57
4.20	Damping nomogram method algorithm.	58
4.21	OLMO algorithm.	59
5.1	Generation sensitivity calculation algorithm.	78
5.2	CSBGRES method algorithm.	80
6.1	SAGE system single-line diagram.	83
6.2	Gen 1 x Gen 2 nomogram for system normal operation using QR. . .	83
6.3	Gen 1 x Gen 3 nomogram for system normal operation using QR. . .	84
6.4	Gen 2 x Gen 3 nomogram for system normal operation using QR. . .	84
6.5	Gen 1 x Gen 2 nomogram for contingency situations using QR.	84
6.6	Gen 1 x Gen 3 nomogram for contingency situations using QR.	85
6.7	Gen 2 x Gen 3 nomogram for contingency situations using QR.	85
6.8	Gen 1 x Gen 2 nomogram for system normal operation using DPSE. . .	85
6.9	Gen 1 x Gen 3 nomogram for system normal operation using DPSE. . .	86
6.10	Gen 2 x Gen 3 nomogram for system normal operation using DPSE. . .	86
6.11	Gen 1 x Gen 2 nomogram for contingency situations using DPSE.	86
6.12	Gen 1 x Gen 3 nomogram for contingency situations using DPSE.	87
6.13	Gen 2 x Gen 3 nomogram for contingency situations using DPSE.	87
6.14	Comparison of nomograms obtained through QR and DPSE methods.	88
6.15	Corrective measure through power plant redispatch.	89
6.16	Corrective measure through PSS tuning.	89
6.17	Two areas system single-line diagram.	90
6.18	Mode damping factor timeline for Two areas system.	92
6.19	Mode frequency timeline for Two areas system.	92
6.20	Normalized generation sensitivity phasors for Two areas system.	93
6.21	CSBGRES histogram (MW) to reach 5% of damping factor in Two areas system.	94

6.22	CSBGRES histogram (MW) to reach 8% of damping factor in Two areas system.	95
6.23	Brazilian power system single-line diagram.	96
6.24	Normalized generation sensitivity phasors for Brazilian power system.	97
6.25	CSBGRES histogram (MW) to reach 5% of damping factor in Brazilian power system.	99
6.26	Nordic 44 system single-line diagram.	100
6.27	Normalized generation sensitivity phasors for Nordic 44 system.	101
6.28	CSBGRES histogram (MW) to reach 8% of damping factor in Nordic 44 system.	102
6.29	Mode damping factor timelines for Nordic 44 system.	104
6.30	Mode frequency timelines for Nordic 44 system.	104
6.31	Mode damping factor timelines for Nordic 44 system, using CSBGRES method.	105
6.32	Mode frequency timelines for Nordic 44 system, using CSBGRES method.	105
6.33	OLMO results with and without utilization of CSBGRES method.	106
6.34	CSBGRES histogram (MW) to reach 5% of damping factor in Nordic 44 system in worst scenario.	106

List of Tables

6.1	Normalized generation sensitivity list for Two areas system.	93
6.2	CSBGRES redispatches (MW) to reach 5% of damping factor in Two areas system.	94
6.3	CSBGRES redispatches (MW) to reach 8% of damping factor in Two areas system.	95
6.4	Normalized generation sensitivity list for Brazilian power system. . .	98
6.5	CSBGRES redispatches (MW) to reach 5% of damping factor in Brazilian power system.	99
6.6	Normalized generation sensitivity list for Nordic 44 system.	101
6.7	CSBGRES redispatches (MW) to reach 8% of damping factor in Nordic 44 system.	103
6.8	CSBGRES redispatches (MW) to reach 5% of damping factor in Nordic 44 system in worst scenario.	107

Chapter 1

Introduction

This chapter will describe the main topics covered by this work, containing the motivations, objectives and contributions of this research. This thesis is focusing on power system stability, small-signal security assessment and determination of corrective measures to improve the system dynamic behavior.

1.1 Contextualization

Different kind of studies must be done in the expansion and operation planning of power systems, in order to forecast possible problems in the energy supply to the consumers. These studies are related to power flow, fault and electromechanical stability analyses, among others.

Power flow analyses are concerned with the study of system steady-state conditions, aiming at the determination of bus voltage levels. Active and reactive power flow in branches of the electrical grid are also determined [1].

Fault analyses consist of studying short-circuit levels to which system equipment are submitted, in order to adequate their capability so they can resist to high electrical currents, without suffering any damage. Capability of circuit breakers are also identified in this evaluation [2].

Electromechanical stability analyses are concerned with the study of system dynamic behaviors when disturbances occur in the electrical grid, aiming at the identification of undesired transient or stability problems [3, 4].

Issues that can be detected through power system stability analyses are related to loss of synchronism between power plants or poorly damped oscillations in the electrical grid [4].

Disturbances considered in these analyses are events that may happen in the grid, such as: short-circuits, equipment trip-outs or shunt switching [3, 4].

Small variations are also evaluated, such as: load modifying during a day, control system set-point changing, power plant redispatches or automatic generation control (AGC) and coordinated voltage control (CVC) actions [3, 4].

Computational programs capable of performing these studies for large-scale power systems are extremely important. The Electrical Energy Research Center (CEPEL) develops these kinds of software. Some of them can be highlighted, such as: ANAREDE [5], ANAFAS [6], ANATEM [7] and PacDyn [8].

ANAREDE is a software able to perform power flow analyses, giving important information about steady-state conditions of electrical grids [5].

ANAFAS is a software capable of performing fault analyses, giving important information about short-circuit levels of electrical grids [6].

ANATEM is a software able to perform transient stability analyses, giving important information about system dynamic behavior, considering occurrences of large disturbances in its electrical grid [7].

PacDyn is a software capable of performing small-signal stability analyses, giving important information about system dynamic behavior, regarding natural oscillations and control systems [8].

The pursuit of an adequate, continuous and secure supply of electrical energy is increasing worldwide, each day more. Power system analyses are needed to improve system planning and operation, increasing its robustness and minimizing risks of failure in this process.

Power system security assessments arise in this context. Voltage security assessment (VSA) is concerned with bus voltage levels, transient security assessment (TSA) is concerned with transient dynamic behavior and small-signal security assessment (SSA) is concerned with dynamic behavior in face of small disturbances [9].

Some academic publications about VSA, TSA and SSA will be reviewed and several concepts and methodologies related to these analyses will be studied [10–17].

1.2 Research Motivations

First motivation of this research is the fact that concepts of power system security assessment are not well defined in the academy, needing a better organization.

Second motivation is the lack of methodologies and computational tools for small-signal security assessment. The development of new SSA features is important.

Third motivation of this work is the lack of discussion regarding solutions for security problems that may be detected in power system monitoring.

These are the main reasons for choosing small-signal security assessment as the theme of this doctoral thesis.

1.3 Thesis Contributions

This work presents a description of power system security assessment, reviewing and organizing its basic concepts. Besides, new tools for SSA were developed, considering its applications in real-time operation and planning studies.

This research studies methods and corrective measures that can be used to increase the damping factor of power system oscillations, considering control tuning and plant redispatches.

On-line control tuning is not a practice currently adopted by operators, but, in a future, this solution could be feasible.

On the other hand, power plant redispatches are more reasonable to be adopted as a solution of oscillation problems in a real-time operation.

The main contribution of this thesis is a mathematical development of algorithm capable of determining a minimum redispatch for power system, based on Hopf bifurcation analysis [18–33], which uses generation sensitivities and considers a damping factor criteria for oscillation modes.

This algorithm can be used to determine small-signal security margins and corrective measures to improve the dynamic behavior of power systems.

The redispatch algorithm and SSA tools proposed in this work represent an advance in the state of art of power system security assessment. The planning and operation of power systems can be improved using these developments.

1.4 Thesis Structure

This thesis is divided in chapters as follow:

- Chapter 1 – Introduction: In this chapter, the main topics of this research were described, including the motivations and contributions of this thesis;
- Chapter 2 – Power System Stability: In this chapter, the basic concepts of power system stability will be reviewed, focusing on the small-signal stability;
- Chapter 3 – State of Art and Concepts: In this chapter, the actual state of art related to the power system security assessment will be presented;

- Chapter 4 – Security Assessment Theory: In this chapter, the main concepts of power system security assessment will be reviewed, focusing on SSA;
- Chapter 5 – Hopf Bifurcation Study: In this chapter, the method for determination of minimum redispatch for power systems will be presented;
- Chapter 6 – Tests and Results: In this chapter, the methods and computational tools developed in this thesis will be tested in example systems;
- Chapter 7 – Conclusion: In this chapter, the conclusions of the thesis will be made, evidencing the benefits brought by the proposed methods.

1.5 Published Papers

Through the research and methods proposed in this thesis, the following papers were produced and published:

- PARREIRAS, T. J. M. A., GOMES JUNIOR, S., TARANTO, G. N., LEITE NETTO, N. A. R., AMARAL, T. S., UHLEN, K., “Avaliação de Segurança a Pequenos Sinais de Sistemas de Potência com o PacDyn”, *XXIII Seminário Nacional de Produção e Transmissão de Energia Elétrica - SNPTEE*, october, 2015;
- PARREIRAS, T. J. M. A., GOMES JUNIOR, S., TARANTO, G. N., “Damping Nomogram Method for Small-Signal Security Assessment of Power Systems”, *IEEE Latin America Transactions*, may, 2017.

1.6 Submitted Papers

Through the research and methods proposed in this thesis, the following paper was produced and submitted to publication:

- PARREIRAS, T. J. M. A., GOMES JUNIOR, S., TARANTO, G. N., UHLEN, K., “Closest Security Boundary for Improving Oscillation Damping through Generation Redispatch using Eigenvalue Sensitivities”, *IEEE Transactions on Power Systems*, june, 2017.

1.7 Related Dissertations

The following master dissertations are related to the work made in the development of this doctoral thesis:

- BJORSVIK, K., *A Scheme for Creating a Small-Signal On-line Dynamic Security Assessment Tool – Using PSS/E and PacDyn*, M. Sc. dissertation, NTNU, Trondheim, Sor-Trondelag, Norway, 2016;
- LEITE NETTO, N. A. R., *Novas Ferramentas para a Análise de Segurança Estática e Dinâmica de Sistemas de Potência*, M. Sc. dissertation, COPPE/UFRJ, Rio de Janeiro, Rio de Janeiro, Brazil, 2016.

1.8 Final Considerations

Power flow, fault and electromechanical stability analyses should be done for the planning and operation of electrical power systems. These studies were briefly described in this chapter.

Research motivations and thesis contributions were presented. This work is focusing on the small-signal security assessment and development of a method for determining of minimum redispatch for power systems.

The thesis structure with chapter descriptions and lists of produced papers were also presented, finishing this chapter.

Chapter 2

Power System Stability

This chapter will review the basic concepts related to power system stability analyses, focusing on the rotor angle stability. The transient and small-signal stability analyses will be described in this topic.

2.1 Basic Concepts

Electromechanical stability analyses are concerned with the dynamic behavior of power systems, before, during and after the occurrence of faults or disturbances in their electrical grid [4, 34].

Stability problems can be identified in these analyses. Redispatches and control tuning may be used to solve these problems [4, 34].

Operative constraints necessary to avoid stability problems can be obtained in the operation planning and reinforcements needed to improve the system dynamic behavior can be determined in the expansion planning.

Software capable of performing stability analyses of large-scale power systems are necessary to study real electrical systems. ANATEM [7] and PacDyn [8], developed by CEPTEL, are examples of these kinds of software.

Power system stability can be divided into voltage stability, frequency stability and rotor angle stability. Figure 2.1 illustrates this division [4, 35].

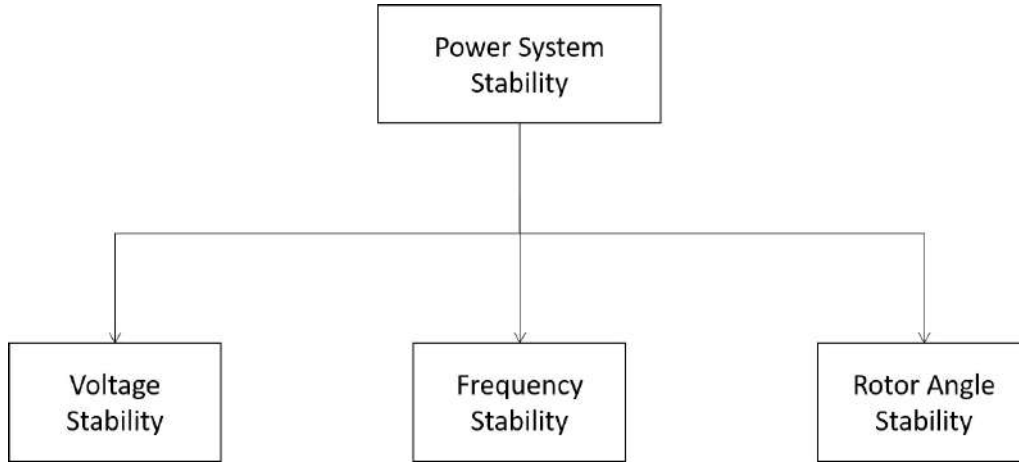


Figure 2.1: Power system stability division.

Voltage stability analyses are concerned with the bus voltage levels, considering contingencies and several disturbances, in order to determine the system capability of coming back to an acceptable operating point [34–36].

These studies are directly related to the transmission system capability and verifies abrupt voltage drops or voltage collapse [34, 35].

Frequency stability analyses are concerned with the system capability of keeping its frequency in acceptable value after the occurrence of large disturbances which may cause large unbalance between load and generation [34, 35].

Rotor angle stability analyses are concerned with the dynamic behavior of generators upon the occurrence of disturbances in the electrical grid [34, 35].

These studies are directly related to the mechanical and electromagnetic torques applied to power plant rotors [34, 35].

Rotor angle stability can be subdivided into transient stability and small-signal stability, as shown in figure 2.2 [4, 35].

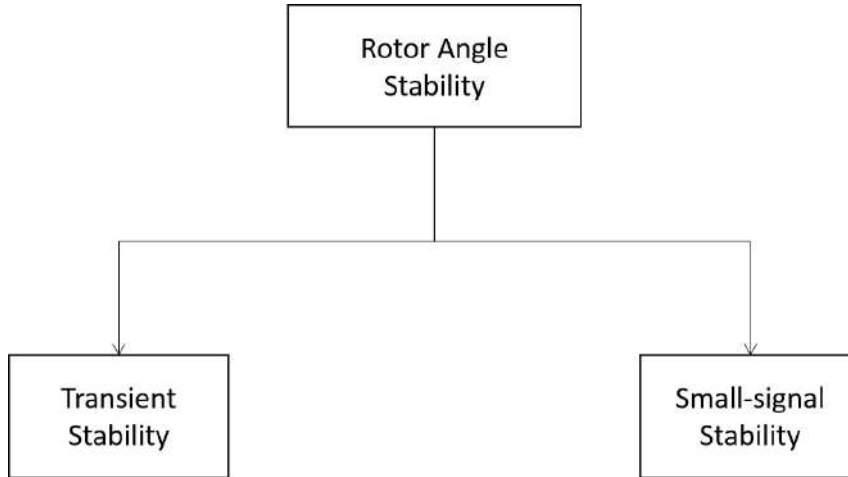


Figure 2.2: Rotor angle stability subdivision.

Power systems are considered stable when they have acceptable oscillatory and non-oscillatory stability. The oscillatory stability is related to damping factor of system natural oscillations and the non-oscillatory stability is related to maintenance of synchronism between the power plants [4, 34].

2.2 Transient Stability

Transient stability analyses are concerned with the determination of system dynamic behavior in face of large disturbances in the electrical grid, such as: short-circuits, equipment trip-outs, loss of generation, load rejection and others [4, 34].

The dynamic behavior of the load angle and rotor speed of power plants can be observed, in order to verify the maintenance of synchronism between the system machines and the oscillation damping factor [4, 34, 35].

Power systems of order n can be mathematically described through n differential equations of first order. These equations represent dynamic behavior and are necessary to model these systems. The state variable vector x is defined according to this equation set [4, 34].

These systems also have algebraic equations, which are related to electrical grid or control systems and are also needed in this modelling. The algebraic variable vector r can be defined according to this equation set [4, 34].

2.2.1 Non-linear System Modelling

The mathematical model of power systems can be described through equations (2.1), (2.2) and (2.3), including an input variable vector u and an output variable vector y , according to references [4, 34, 37].

$$\dot{x} = f(x, r, u) \quad (2.1)$$

$$0 = g(x, r, u) \quad (2.2)$$

$$y = h(x, r, u) \quad (2.3)$$

Where:

x = State variable vector;

r = Algebraic variable vector;

u = Input variable vector;

y = Output variable vector;

\dot{x} = State variable derivative vector;

f = Differential equation set;

g = Algebraic equation set;

h = Output equation set.

The analysis of power system transients is mainly focused on time response simulations of large disturbances in its electrical grid, obtained through using the mathematical model described before.

A software is needed for the analysis of large-scale power systems, as the Brazilian interconnected power system. ANATEM [7] can be used in this study.

Numerical integration methods are needed to determine time responses through the equations (2.1), (2.2) and (2.3). One of these methods is the numerical integration using trapezoidal approximation.

The dynamic behavior of power systems in face of disturbances can be verified through these time response simulations.

2.3 Small-signal Stability

Small-signal stability analyses are concerned with the system dynamic behavior in face of small disturbances in its electrical grid, such as: dispatch variations, load variations and controller set-point modification and others [4, 34].

The non-linear power systems are linearized in this study, which enables the use of linear control techniques and modal analysis. These tools help to determine characteristics of the system dynamic behavior [4, 34].

Modes of power systems can be determined through using modal analysis techniques. These modes represent the dynamic behavior of the system and have information about its small-signal stability. They may represent natural oscillations of power systems, being called oscillation modes [4, 34].

Control systems can be tuned using modal analysis techniques, in order to improve the system dynamic behavior. Power system stabilizers (PSS) and power oscillation damper (POD) are examples of controllers that may be used to increase the damping factor of oscillation modes [4, 34].

A software is needed for performing modal analysis of large-scale power systems, as the Brazilian power system. PacDyn [8] can be used in this study.

2.3.1 System Model Linearization

Non-linear power system model can be linearized around its initial operating point (x_0, r_0, u_0) to obtain linear approximate model, which is represented by equations (2.4) and (2.5), according to [4, 34, 37]. This is called descriptor system model.

$$\begin{bmatrix} \Delta \dot{x} \\ 0 \\ \Delta y \end{bmatrix} = J_{(x_0, r_0, u_0)} \cdot \begin{bmatrix} \Delta x \\ \Delta r \\ \Delta u \end{bmatrix} \quad (2.4)$$

$$\begin{bmatrix} \Delta \dot{x} \\ 0 \\ \Delta y \end{bmatrix} = \begin{bmatrix} \frac{\partial f}{\partial x} & \frac{\partial f}{\partial r} & \frac{\partial f}{\partial u} \\ \frac{\partial g}{\partial x} & \frac{\partial g}{\partial r} & \frac{\partial g}{\partial u} \\ \frac{\partial h}{\partial x} & \frac{\partial h}{\partial r} & \frac{\partial h}{\partial u} \end{bmatrix}_{(x_0, r_0, u_0)} \cdot \begin{bmatrix} \Delta x \\ \Delta r \\ \Delta u \end{bmatrix} \quad (2.5)$$

Where:

Δx = State variable deviation vector;

Δr = Algebraic variable deviation vector;

Δu = Input variable deviation vector;

Δy = Output variable deviation vector;

$\Delta \dot{x}$ = State variable derivative deviation vector;

$J_{(x_0, r_0, u_0)}$ = System jacobian matrix in (x_0, r_0, u_0) ;

$\frac{\partial f}{\partial x}$ = Function f derivatives with respect to vector x ;

$\frac{\partial f}{\partial r}$ = Function f derivatives with respect to vector r ;

$\frac{\partial f}{\partial u}$ = Function f derivatives with respect to vector u ;

$\frac{\partial g}{\partial x}$ = Function g derivatives with respect to vector x ;

$\frac{\partial g}{\partial r}$ = Function g derivatives with respect to vector r ;

$\frac{\partial g}{\partial u}$ = Function g derivatives with respect to vector u ;

$\frac{\partial h}{\partial x}$ = Function h derivatives with respect to vector x ;

$\frac{\partial h}{\partial r}$ = Function h derivatives with respect to vector r ;

$\frac{\partial h}{\partial u}$ = Function h derivatives with respect to vector u ;

$$\begin{bmatrix} \frac{\partial f}{\partial x} & \frac{\partial f}{\partial r} & \frac{\partial f}{\partial u} \\ \frac{\partial g}{\partial x} & \frac{\partial g}{\partial r} & \frac{\partial g}{\partial u} \\ \frac{\partial h}{\partial x} & \frac{\partial h}{\partial r} & \frac{\partial h}{\partial u} \end{bmatrix}_{(x_0, r_0, u_0)} = \text{Detailed system jacobian matrix.}$$

Algebraic variables can be eliminated from the model through mathematical manipulations. This new model is represented by equations (2.6) and (2.7), according to [4, 34, 37, 38], and is called state space model.

$$\Delta \dot{x} = A.\Delta x + B.\Delta u \tag{2.6}$$

$$\Delta y = C.\Delta x + D.\Delta u \tag{2.7}$$

Where:

Δx = State variable deviation vector;

Δu = Input variable deviation vector;

Δy = Output variable deviation vector;

$\Delta \dot{x}$ = State variable derivative deviation vector;

A = State transition matrix;

B = System input matrix;

C = System output matrix;

D = Direct transfer matrix.

System modes can be obtained through the eigenvalues of matrix A and represent the system dynamic behavior in face of small disturbances. These modes may represent characteristics of power system natural oscillations [4, 34].

The oscillation modes related to electromechanical dynamics can be divided into: intra-plant modes, local modes, inter-area modes and multi-machine modes.

Intra-plant modes represent oscillations between generating units of a single power plant. Local modes represent oscillations of a power plant against all other system machines. Inter-area modes represent oscillations between power plants of some areas against others. Multi-machine modes represent oscillations between several machines of several areas.

2.3.2 Eigenvalues and Eigenvectors

Eigenvalues and eigenvectors of the matrix A can be determined through equations (2.8) and (2.9), according to [4, 34, 37–39].

$$A.v = \lambda.v \quad (2.8)$$

$$w.A = w.\lambda \quad (2.9)$$

Where:

A = State matrix;

v = Right eigenvector;

w = Left eigenvector;

λ = Eigenvalue.

Equations (2.10), (2.11), (2.12) and (2.13) can be obtained through mathematical manipulations, according to [4, 34].

$$A.v - \lambda.v = 0 \quad (2.10)$$

$$(A - \lambda.I).v = 0 \quad (2.11)$$

$$w.A - w.\lambda = 0 \quad (2.12)$$

$$w.(A - \lambda.I) = 0 \quad (2.13)$$

Where:

A = State matrix;

v = Right eigenvector;

w = Left eigenvector;

λ = Eigenvalue;

I = Identity matrix.

The matrix $A - \lambda \cdot I$ must be singular, so eigenvalues can be obtained. The system characteristic equation is presented in equation (2.14), according to [4, 34].

$$\det(A - \lambda.I) = 0 \quad (2.14)$$

Where:

A = State matrix;

λ = Eigenvalue;

I = Identity matrix;

\det = Determinant of the matrix $A - \lambda.I$.

A n order system will have n eigenvalues. This system will also have n right and left eigenvectors related to each one of these eigenvalues. They can be obtained through equations (2.15) and (2.16), according to [4, 34].

$$(A - \lambda_i \cdot I) \cdot v_i = 0 \quad (2.15)$$

$$w_i \cdot (A - \lambda_i \cdot I) = 0 \quad (2.16)$$

Where:

A = State matrix;

v_i = Right eigenvector associated to mode i ;

w_i = Left eigenvector associated to mode i ;

λ_i = System mode i ;

I = Identity matrix.

These eigenvalues and eigenvectors have important information about the natural oscillations that may appear in power systems [4, 34].

2.3.3 Participation Factors and Mode Shapes

Participation factors represent the contribution of each system state variable for the appearance of modes in its model [4, 34].

These factors can be obtained through the multiplication of elements of the right eigenvector matrix Φ and left eigenvector matrix Ψ and their calculation is shown in equations (2.17) and (2.18), according to [4, 34].

$$P = \begin{bmatrix} P_1 & \dots & P_i & \dots & P_n \end{bmatrix} \quad (2.17)$$

$$P_i = \begin{bmatrix} P_{1i} \\ \vdots \\ P_{ii} \\ \vdots \\ P_{ni} \end{bmatrix} = \begin{bmatrix} \Phi_{1i} \cdot \Psi_{i1} \\ \vdots \\ \Phi_{ii} \cdot \Psi_{ii} \\ \vdots \\ \Phi_{ni} \cdot \Psi_{in} \end{bmatrix} \quad (2.18)$$

Where:

P = Participation factor matrix;

P_1 = Participation factor vector for mode 1;

P_i = Participation factors vector for mode i ;

P_n = Participation factors vector for mode n ;

P_{1i} = Participation factor of state variable 1 for mode i ;

P_{ii} = Participation factor of state variable i for mode i ;

P_{ni} = Participation factor of state variable n for mode i ;

Φ_{1i} = Element of right eigenvector matrix related to state variable 1 and mode i ;

Φ_{ii} = Element of right eigenvector matrix related to state variable i and mode i ;

Φ_{ni} = Element of right eigenvector matrix related to state variable n and mode i ;

Ψ_{i1} = Element of left eigenvector matrix related to state variable 1 and mode i ;

Ψ_{i1} = Element of left eigenvector matrix related to state variable i and mode i ;

Ψ_{in} = Element of left eigenvector matrix related to state variable n and mode i .

The participation factors can be used to determine the system mode origins, which can be related to power flow equations, control system equations or electromechanical interactions [4, 34].

Electromechanical oscillation modes present high participation factors for rotor angles and rotor speeds [4, 34].

Mode shapes are the graphics obtained through plotting elements of right eigenvector matrix Φ . They are related to a desired state variable and a mode and their calculation is shown in equations (2.19) and (2.20), according to [4, 34].

$$\Phi = [\Phi_1 \quad \dots \quad \Phi_i \quad \dots \quad \Phi_n] \quad (2.19)$$

$$\Phi_i = \begin{bmatrix} \Phi_{1i} \\ \vdots \\ \Phi_{ii} \\ \vdots \\ \Phi_{ni} \end{bmatrix} \quad (2.20)$$

Where:

Φ = Right eigenvector matrix;

Φ_1 = Right eigenvector related to mode 1;

Φ_i = Right eigenvector related to mode i ;

Φ_n = Right eigenvector related to mode n ;

Φ_{1i} = Element of right eigenvector matrix related to state variable 1 and mode i ;

Φ_{ii} = Element of right eigenvector matrix related to state variable i and mode i ;

Φ_{ni} = Element of right eigenvector matrix related to state variable n and mode i .

The mode shapes can be used to determine if system variables oscillate in a coherent or non-coherent way, when a small disturbance occurs in the electrical grid [4, 34].

Figure 2.3 illustrates examples of mode shapes.

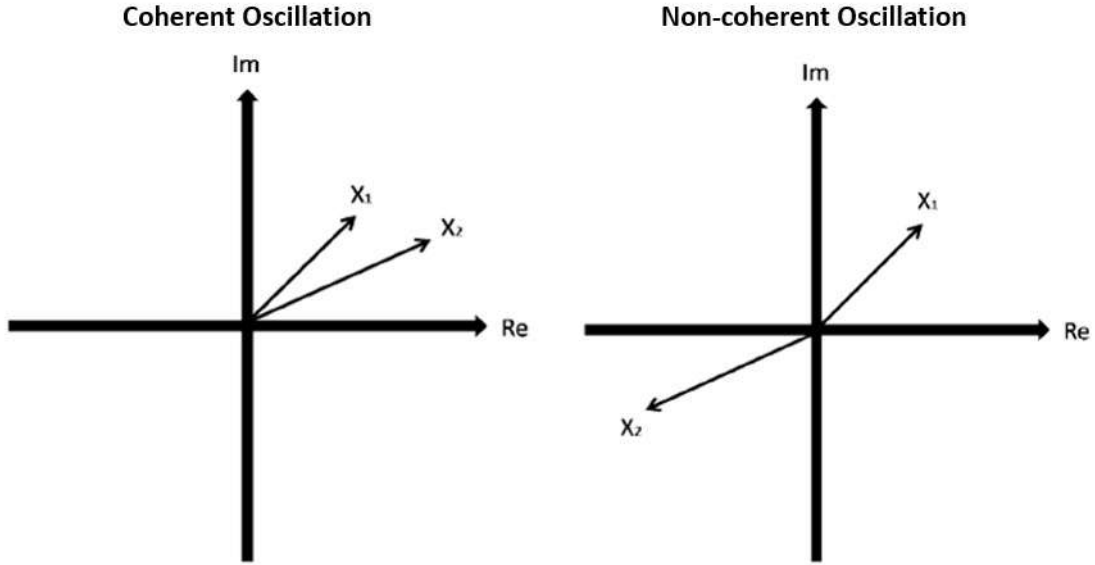


Figure 2.3: Schematic examples of mode shapes.

Coherent oscillations are those in which variables behave similarly and present oscillations almost in phase. Non-coherent oscillations are those in which variables have opposite behaviors and present oscillations almost in counter-phase [4, 34].

Rotor speed mode shapes are very important to electromechanical oscillation modes, enabling the determination of their types, such as: intra-plant modes, local modes, inter-area modes or multi-machine modes [4, 34].

2.3.4 Residue, Controlability and Observability

A variable linear transformation can be performed, in order to obtain a new state transition matrix Λ and modal state variables z for power systems [4, 34].

This similarity transformation is represented through equations (2.21) and (2.22). The new state transition matrix Λ will have a diagonal form, if the system presents n distinct eigenvalues [4, 34].

$$x = \Phi.z \quad (2.21)$$

$$\Lambda = \Phi^{-1}.A.\Phi = \begin{bmatrix} \lambda_1 & \cdots & 0 & \cdots & 0 \\ \vdots & \ddots & \vdots & \ddots & \vdots \\ 0 & \cdots & \lambda_i & \cdots & 0 \\ \vdots & \ddots & \vdots & \ddots & \vdots \\ 0 & \cdots & 0 & \cdots & \lambda_n \end{bmatrix} \quad (2.22)$$

Where:

x = Original state variable vector;

z = Modal state variable vector;

A = Original state transition matrix;

Φ = Right eigenvector matrix;

Λ = Modal state transition matrix;

λ_1 = System mode 1;

λ_i = System mode i ;

λ_n = System mode n .

Each modal state variable is directly related to a system mode, which defines its dynamic behavior. The original state variables can be obtained through linear combinations of the modal state variables [4, 34].

This similarity transformation can be expanded to the input matrix B , output matrix C and direct transfer matrix D , yielding a new state space model for the power system, which is represented in equations (2.23), (2.24), (2.25), (2.26), (2.27) and (2.28), according to [4, 34].

$$x = \Phi.z \quad (2.23)$$

$$\Lambda = \Phi^{-1}.A.\Phi \quad (2.24)$$

$$B' = \Phi^{-1}.B \quad (2.25)$$

$$C' = C.\Phi \quad (2.26)$$

$$\Delta\dot{z} = \Lambda.\Delta z + B'.\Delta u \quad (2.27)$$

$$\Delta y = C'.\Delta z + D.\Delta u \quad (2.28)$$

Where:

x = Original state variable vector;

z = Modal state variable vector;

A = Original state transition matrix;

Φ = Right eigenvector matrix;

Λ = Modal state transient matrix;

B = Original input matrix;

B' = Modal input matrix;

C = Original output matrix;

C' = Modal output matrix;

D = Direct transfer matrix;

Δu = Input variable deviation vector;

Δy = Output variable deviation vector;

Δz = Modal state variable deviation vector;

$\Delta\dot{z}$ = Modal state variable derivative deviation vector.

If there are no direct transfer terms in the system, the matrix D will be null and its model can be represented through equations (2.29) and (2.30). A transfer function [40] relating the input and output of the system can be obtained applying the Laplace transform in this new model, which is shown in equation (2.31).

$$\Delta \dot{z} = \Lambda . \Delta z + B' . \Delta u \quad (2.29)$$

$$\Delta y = C' . \Delta z \quad (2.30)$$

$$\frac{\Delta Y(s)}{\Delta U(s)} = C' . (s.I - A)^{-1} . B' \quad (2.31)$$

Where:

Λ = Modal state transition matrix;

B' = Modal input matrix;

C' = Modal output matrix;

Δu = Input variable deviation vector;

Δy = Output variable deviation vector;

Δz = Modal state variable deviation vector;

$\Delta \dot{z}$ = Modal state variable derivative deviation vector;

$\Delta Y(s)$ = Laplace transform of output variable deviation vector;

$\Delta U(s)$ = Laplace transform of input variable deviation vector;

$\frac{\Delta Y(s)}{\Delta U(s)}$ = Transfer function matrix relating input and output variables.

If the system has only one input and one output variables (SISO system), equation (2.31) can be rewritten through equations (2.32) and (2.33).

$$\frac{\Delta Y(s)}{\Delta U(s)} = c' . (s.I - A)^{-1} . b' \quad (2.32)$$

$$\frac{\Delta Y(s)}{\Delta U(s)} = \sum_{i=1}^n \frac{c'_i \cdot b'_i}{s - \lambda_i} = \sum_{i=1}^n \frac{R_i}{s - \lambda_i} \quad (2.33)$$

Where:

Λ = Modal state transition matrix;

b' = Modal input vector;

c' = Modal output vector;

b'_i = Element i of input variable deviation vector;

c'_i = Element i of output variable deviation vector;

R_i = Residue related to mode i in transfer function $\frac{\Delta Y(s)}{\Delta U(s)}$;

$\Delta Y(s)$ = Laplace transform of output variable deviation vector;

$\Delta U(s)$ = Laplace transform of input variable deviation vector;

$\frac{\Delta Y(s)}{\Delta U(s)}$ = Transfer function matrix relating input and output variables.

Controlability factor can be defined as an input variable capability of exciting a system mode and can be determined through equation (2.34), according to [4, 34].

$$Ctrl_i = b' = \Psi_i \cdot b \quad (2.34)$$

Where:

$Ctrl_i$ = Controlability factor of mode i ;

b'_i = Element i of modal input vector;

Ψ_i = Left eigenvector related to mode i ;

b = Original input vector.

Observability factor can be defined as an output variable capability of reflecting a mode dynamic and can be obtained through equation (2.35), according to [4, 34].

$$Obsv_i = c' = c.\Phi_i \quad (2.35)$$

Where:

$Obsv_i$ = Observability factor of mode i ;

c'_i = Element i of modal output vector;

Φ_i = Right eigenvector related to mode i ;

c = Original output vector.

Transfer function residue can be defined as a system mode influence in output variable dynamic behavior when this mode is excited by input variable and can be determined through equation (2.36), according to [4, 34].

$$R_i = Ctrl_i.Obsv_i = c'.b' = c.\Phi_i.\Psi_i.b \quad (2.36)$$

Where:

R_i = Residue related to mode i in transfer function $\frac{\Delta Y(s)}{\Delta U(s)}$;

$Ctrl_i$ = Controlability factor of mode i ;

$Obsv_i$ = Observability factor of mode i ;

c'_i = Element i of modal output vector;

b'_i = Element i of modal input vector;

c = Original output vector;

b = Original input vector;

Φ_i = Right eigenvector related to mode i ;

Ψ_i = Left eigenvector related to mode i .

The modal analysis is very important to small-signal stability of power systems. This analysis enables the identification of equipment most responsible for causing undesired oscillations and the improvement of their damping factors through control system tuning, such as: PSS or POD.

2.3.5 Control System Design

Power system stabilizers (PSS) can be used to increase the damping factor of electromechanical oscillation modes. Module and phase compensation are needed in PSS tuning, according to [34, 41, 42].

Nyquist diagrams can be used to design control systems, as PSS, and determine these compensations. These diagrams analyze the open loop system, in order to evaluate the closed loop dynamic behavior [34, 41, 42].

Figure 2.4 represents a power system model, where $G(s)$ considers a generator, its automatic voltage regulator (AVR), its speed governor (GOV) and other system equipment. $PSS(s)$ is the transfer function of a power system stabilizer, which is used in a negative feedback [34, 41, 42].

System input variable is the voltage reference signal V_{ref} , output variable is the rotor speed WW and V_{pss} is the stabilization signal [34, 41, 42].

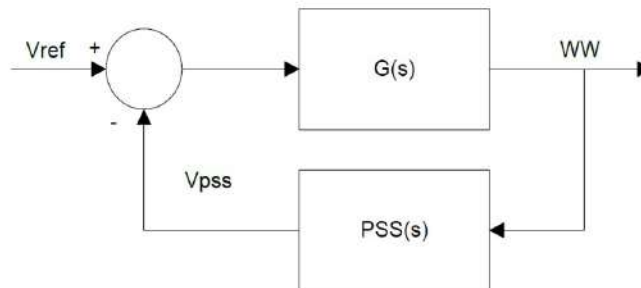


Figure 2.4: Transfer function $G(s)$ with feedback through $PSS(s)$.

$PSS(s)$ can be decomposed into a WASHOUT block and the function $Comp(s)$, which is responsible for module and phase compensation of the stabilizer, according to equations (2.37) and (2.38).

$$PSS(s) = Comp(s) \cdot \left(\frac{T_w \cdot s}{1 + T_w \cdot s} \right) \quad (2.37)$$

$$Comp(s) = K_{pss} \cdot \left(\frac{1 + T \cdot s}{1 + \alpha \cdot T \cdot s} \right)^{nb} \quad (2.38)$$

Where:

$PSS(s)$ = Transfer function of power system stabilizer;

$Comp(s)$ = Transfer function of module and phase compensation;

T_w = WASHOUT block time constant;

K_{pss} = Gain of $Comp(s)$;

α = Phase parameter of $Comp(s)$;

T = Frequency parameter of $Comp(s)$.

Function module M and phase ϕ for the mode frequency ω can be obtained through a traditional Nyquist diagram (with damping factor of 0%) of transfer function $G(s) \cdot \left(\frac{T_w \cdot s}{1 + T_w \cdot s} \right)$ [4, 34, 42], as can be seen in figure 2.5.

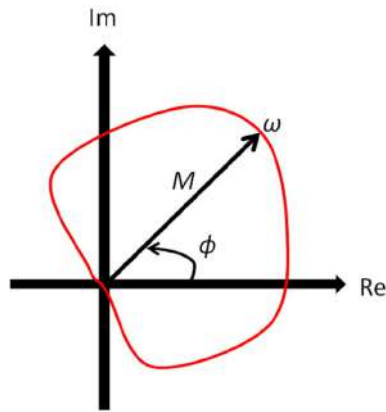


Figure 2.5: Schematic Nyquist diagram for the range $0 \leq \omega < \infty$.

$Comp(s)$ parameters can be obtained, so the compensated Nyquist diagram can involve the point -1 of the complex plane, counterclockwise. Then, system will become stable, according to Nyquist criteria [34, 40, 42]. This module and phase compensations can be observed in figure 2.6.

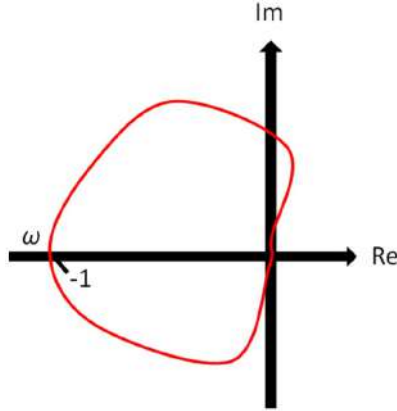


Figure 2.6: Nyquist diagram with module and phase compensation.

Gain and phase margins must be considered in compensation to ensure a satisfactory damping factor for the mode of interest [34, 40, 42].

The phase and frequency parameters of $Comp(s)$ can be determined through equations (2.39), (2.40) and (2.41), according to [34, 40, 42].

$$\phi_{adv} = 180^\circ - \phi \quad (2.39)$$

$$\sin\left(\frac{\phi_{adv}}{nb}\right) = \frac{1 - \alpha}{1 + \alpha} \quad (2.40)$$

$$\omega = \frac{1}{T \cdot \sqrt{\alpha}} \quad (2.41)$$

Where:

ϕ_{adv} = Desired phase advance;

ϕ = Phase of open loop system for frequency ω ;

nb = Number of lead-lag blocks used in compensation;

ω = Frequency of system mode;

α = Phase parameter of $Comp(s)$;

T = Frequency parameter of $Comp(s)$.

Module compensation can be determined through the Nyquist diagram with phase compensation. The new module M_{comp} for mode frequency ω can be obtained in this new diagram, as can be seen in figure 2.7.

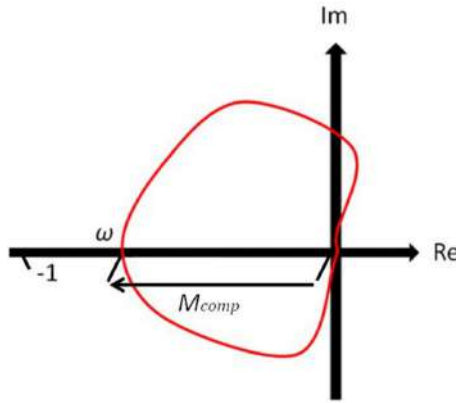


Figure 2.7: Nyquist diagram with phase compensation.

The gain K_{pss} can be obtained through the module M_{comp} , as can be seen in equation (2.42), according to [34, 40, 42].

$$K_{pss} = \frac{1}{M_{comp}} \quad (2.42)$$

Where:

K_{pss} = Gain of $PSS(s)$;

M_{comp} = Module of phase compensated transfer function for the mode frequency ω .

This equationing is related to control system design using traditional Nyquist diagram, which is not the only way to project controllers.

Other formulations for tuning control systems or loops can be performed through using Nyquist diagrams with damping factor [41, 42].

These other methods allow positioning complex pole pair in a desired location in complex plane, ensuring a desired damping factor and frequency for the oscillation mode of interest, according to [41, 42].

2.4 Final Considerations

Power system electromechanical stability was briefly described in this chapter, including a transient and small-signal stability analyses review.

Modal analysis principles were presented, including the concepts of eigenvalues, eigenvectors, participation factors, mode shapes, controllability, observability and transfer functions residues.

Control system design was discussed and a basic methodology for control tuning was also presented, finishing this chapter.

Chapter 3

State of Art and Concepts

This chapter will present the power system security assessment state of art, including a literature review about concepts of voltage, transient and small-signal security assessments (VSA, TSA and SSA).

3.1 DSA Tools and Techniques

DSA tools and techniques are described in [14]. Several stability analyses should be done in a DSA, such as: voltage, frequency and rotor angle stability [14].

Developments related to voltage and transient security assessment (VSA and TSA) are presented in [14]. The main applications in DSA field are: operation planning analysis, available transmission capability (ATC) determination and on-line security assessment of power systems [14].

The voltage stability is related to power system ability of keeping acceptable bus voltage levels under normal operation and contingency situations [14].

Voltage security assessment consists of evaluating system voltage stability and should have important characteristics, such as: critical contingency list to be consider, properly voltage security analysis and corrective measures to improve power system behaviors [14].

On-line transient security assessment is a computational challenge due to the high processing time in the determination of time response simulations of large-scale power systems, according to [14].

TSA tools should use adequate technique, as time responses and Prony analysis [43], for determining oscillation damping factors, through a fast computational processing with minimum human interference [14].

Transient security assessment tools should have important characteristics, such as: critical contingency list to be consider and properly transient security analysis to determine system security margins [14].

The criteria of DSA tools are related to oscillation damping factors and transient voltages, in order to determine these security margins, according to [14].

3.2 On-line DSA Method

Methods for performing on-line DSA are presented in [11], such as: second kick method, fast second kick method and free mode second kick method.

These methods are based on calculation of kinetic energy injected in the system, in order to determine stability or security margins of power systems [11].

Power systems are operating, each day more, under stressed scenarios and close to their limits. Power system security assessments are very important in this context, to ensure a safe system operation [11].

On-line transient security assessment can be divided into three steps, according to [11]: critical contingency selection, TSA considering these contingencies and determination of power system security limits.

Implementations of on-line DSA are based on time responses and should have important characteristics, such as: system dynamic behavior evaluation, stability margin determination, calculation of stability margin sensitivities with respect to power system key variables [11].

The second kick method for on-line DSA consists of applying two artificial short-circuits in the power system and verifying the kinetic energy variation of certain power plants, aiming at the transient energy margin determination [11].

The fast second kick method is defined through mathematical manipulations in the original second kick method, in order to enable a faster computational determination of the transient energy margin [11].

The free mode second kick method is presented in [11], which is a variation of the original second kick method and fast second kick method.

This new method aims at determining the kinetic energy margin, deleting the need of mode of disturbance (MOD) information, which is a machine set where the oscillation of interest is more observable [11].

A variable replacement is used to eliminate the MOD information from the second kick method and a Newton-Raphson algorithm is utilized to determine system kinetic energy and stability margins [11].

3.3 DSA Tool in an EMS

Off-line stability analyses are used for determining power system stability limits, but they are very conservative studies and, many times, consider scenarios in which the system may never operate [10].

On-line methods are better for the determination of these stability limits, because they are based on the analysis of the actual system operating point [10].

On-line dynamic security assessment is very important in this context, for determining these limits and improving power system reliability [10].

Some characteristics of on-line DSA are presented in [10], such as: critical contingency selection, time responses simulations, power transfer limit determination and parallel processing use to increase simulation speed.

This on-line security assessment aims at the periodic monitoring of power system state to ensure a secure operation [10].

Methods for calculating stability margins based on transient energy determination are also presented in [10], which enable faster simulations.

The basic requirements to on-line DSA implementations are described in [10], such as: critical contingencies selection, contingency analyses, power system modelling, algorithms for evaluating transient stability, and power system monitoring.

On-line DSA should supply important information about the system operation, as well as, power transfer limits and security margins [10].

3.4 SSA Tools and Characteristics

A small-signal security assessment tool is presented in [16]. The small-signal stability analyses determine important information about power system dynamic behavior and characteristics, according to [16].

This study is performed through the power system model linearization and its modal analysis, which enables the determination of bad damped oscillations [16].

SSA is directly related to small-signal stability analyses. This assessment includes contingency evaluation and bad damped oscillation mode determination [16].

The main motivations to a SSA tool development are presented in [16], such as: poorly damped oscillation mode determination, controller design for improving mode damping factors, small-signal security level determination and a possible on-line small-signal security assessment.

The basic requirements for a SSA tool implementation are defined in [16], such as: power system model linearization, eigensolvers to calculate modes, small-signal stability criteria, friendly interface development with result presentation.

This implementation of a SSA tool can be divided into two steps, according to [16]: eigenvalues or modes calculation and security assessment execution.

SSA tools have two important objectives, according to [16]: power system security margin determination and small-signal stability limit calculation.

These stability limits and security margins can be obtained through indexes, which are calculated considering damping factor criteria [16].

A relation between power transfer levels practiced in electrical systems and these security indexes can be defined and used to ensure a safe operation [16].

Small-signal security assessment tools should have some features, according to [16], such as: full eigensolvers, partial eigensolvers, time response simulations, frequency response simulations, small-signal security indexes, small-signal stability limits and system oscillation mode monitoring.

3.5 SSA Numerical Index

A SSA numerical index is proposed in [17], in order to represent qualitative small-signal security assessment results, identifying the system security.

The main objective of SSA consists of determining system critical modes, which could represent undesired oscillations in its electrical grid [17].

Oscillation problems can be identified through modal analysis tools, which are capable of calculating system modes, identifying the critical ones [17].

Small-signal security assessment is related to small-signal stability and should consider a critical contingency list to be evaluated [17].

The monitored power system will be defined as secure if mode damping factors are greater than the desired minimum damping factor, according to [17].

The power system will be considered insecure if, at least, one mode presents undesired damping factor [17].

A SSA index for power system is proposed in [17], which is called SSSI. This index can be determined through equations (3.1) and (3.2).

$$SSSI = \min \left(1, \max \left(\frac{\xi_i}{\xi_{min_d}} \right)^{-n} \right), \xi_i > \xi_{min_d} \quad (3.1)$$

$$SSSI = 1, \xi_i \leq \xi_{min_d} \quad (3.2)$$

Where:

n = SSSI security index norm;

ξ_i = Damping factor of mode λ_i ;

ξ_{min_d} = Desired minimum damping factor.

3.6 DSA in Planning and Operation

Results of initial experiences using a DSA computational tool are presented in [15]. The DSA is an important part of power system security assessment, which should be based on fast time response simulations and contingency analysis [15].

Dynamic security assessments should consider a criteria related to voltage, transient and small-signal stability analyses, according to [15].

The power system security assessment must be used in order to optimize system operation and should have some objectives, such as: load forecast, resource storage, power transfer planning, static and dynamic security assessment [15].

These security assessments should have a criteria related to: critical contingency analysis, equipment charging limits, desired minimum damping factor, transient stability margins, dynamic limits for frequency and voltage deviation [15].

A DSA tool prototype is proposed in [15], which has graphical interface, application platform and computational device.

This DSA prototype was used to monitor a power system in [15]. The tool was capable of determining the system security index and identifying the critical contingencies for its operation [15].

This computational tool was used in an EMS/SCADA and the results obtained through the detailed power system model and from monitoring data were coherent, once the same problems were detected in both situations [15].

The prototype security index consists of a scale from 0 to 1, where 0 represents a secure system operation and 1 represents a insecure operation. The intermediary values represent different system security levels [15].

3.7 Static and Dynamic Security

An integration between software ANAREDE [5] and ANATEM [7], both from CEPEL, is presented in [12], which can be used for performing static and dynamic security assessment of power system (SDSA).

The Brazilian interconnected power system may operate in several different power transfer scenarios between its electrical areas, which is a serious challenge for the system operators, according to [12].

The voltage, transient and small-signal security assessments should be performed to increase the robustness of the Brazilian system planning and operation, due to this important characteristic [12].

Power flow and transient stability data are needed for performing off-line SDSA, which should be used for the analysis of several feasible operation scenarios, so the system security can be evaluated [12].

On-line SDSA uses the actual operating point data, instead of analyzing several scenarios of the system. These data are obtained through the power system EMS/SCADA, according to [12].

Computational performance of on-line SDSA tools is very important for obtaining useful results for the system operator. The parallel processing is an interesting technique to be used in this context [12].

SDSA results can be observed through nomograms, which are orthogonal projections of the security regions. These regions are three-dimensional, relating the dispatches of three generating groups to the security criteria [12].

The dispatches of these generating groups are modified for the creation of different scenarios that must be evaluated in SDSA. The criteria of this security assessment are related to steady-state and dynamic limits recommended by the Electrical System National Operator (ONS) [12].

3.8 Oscillation Monitoring in SDSA

The importance of voltage and transient security assessments is discussed in [13], which can be used to improve the power system planning and operation.

VSA and DSA tools can be utilized to determine the relative position of power system operating points in relation to security region borders, which can be graphically observed through the nomograms [13].

Impact of detailed power plant representation in software ANAREDE [5] and ANATEM [7] is also discussed in [13], which can modify SDSA results.

Oscillation damping monitoring implementation is presented in [13], in order to adequate the dynamic security assessment results to the criteria recommended by the Brazilian power system operator.

This detailed representation of generating units can have a significant influence in VSA and DSA results, modifying the power system security regions determined through a SDSA execution, according to [13].

3.9 Final Considerations

The actual power system security assessment state of art were briefly described in this chapter, including a voltage, transient and small-signal security assessments literature review.

Critical contingencies and several scenarios should be evaluated in these security assessment, in order to determine power system security margins.

Security indexes and nomograms can be obtained as results of static and dynamic security assessment, according to the literature review made in this chapter.

Chapter 4

Security Assessment Theory

This chapter will present the main concepts related to the voltage, transient and small-signal security assessments. SSA methods will be proposed and their computational implementation will be described.

4.1 Basic Concepts

The concern and pursuit of an adequate, continuous and secure electrical energy supply are increasing worldwide.

Several power system analyses are needed to ensure a robust planning and operation, enabling the system to operate in different scenarios, many times very stressed, with minimized risks of failures.

An adequate security level is extremely important so the system can operate with continuity and robustness, ensuring the energy supply [9, 12–14, 44].

Power system security assessment appears in this context, where the bus voltage levels (VSA), transient dynamic behavior (TSA) and small-signal stability analysis (SSA) are evaluated, according to [9, 12–14, 44].

These security assessments consist of evaluating several scenarios and critical contingencies for the power system of interest, aiming at the determination of critical operating points [12–17].

The processing time of these evaluations is a challenge. TSA, for example, is very time consuming. Some methods are presented in the literature, trying to deal with this problem, as the extended equal area criterion (EEAC) [45].

Stability margins [11], security indexes [17] and security regions [12, 13] can be obtained through the power system security assessments.

Power system stability margins can be obtained through the determination of transient kinetic energy margin, according to [11].

A numerical small-signal security index is presented in [17], called SSSI.

The security regions determined through static and dynamic security assessment of power system can be viewed by using nomograms, according to [12, 13].

Figure 4.1 illustrates a nomogram that can be used in voltage and transient security assessments of power systems.

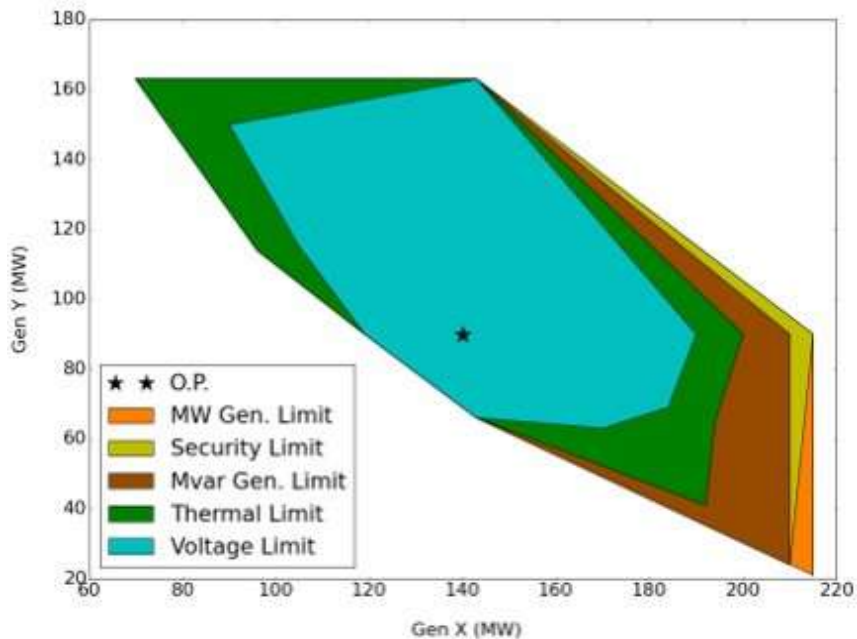


Figure 4.1: Schematic example of a SDSA nomogram.

Five security regions are defined in the schematic SDSA nomogram: blue, green, brown, yellow and orange.

Blue region represents the secure operating points. Outside, there were voltage violations in the system.

Green region represents the operating points with only voltage violations. Outside, there were voltage and charging limit violations.

Brown region represents the operating points with voltage and charging limit violations. Outside, there were also reactive compensation limit violations.

Yellow region represents the operating points with all already mentioned violations. Outside, there were also stability limit violations.

Lastly, orange region represents the operating points all the four mentioned violations. Outside, the power flow calculations were not convergent, considering a normal operation of the system.

4.2 Power System VSA and TSA

Voltage security assessment (VSA) is directly related to voltage stability concepts and consists of determining and evaluating bus voltage levels.

VSA should consider system normal operation and critical contingency situations, in order to determine the power system security.

Operating point will be considered secure if no critical contingencies are capable of leading the system to undesired bus voltage levels, which could cause interruptions in electrical energy supply.

A VSA criteria, in general, are related to limits of: under-voltage, over-voltage, generator active power, reactive power reserve, equipment charging and voltage stability margins [12–14].

The off-line VSA should use power flow data and a contingency list, in order to evaluate the system, determining its security regions [12, 13].

The on-line VSA uses EMS/SCADA data as power flow information and should be executed during system operation, aiming to obtain the security regions [12, 13].

Figure 4.2 presents a scheme for off-line VSA tools [12, 13].

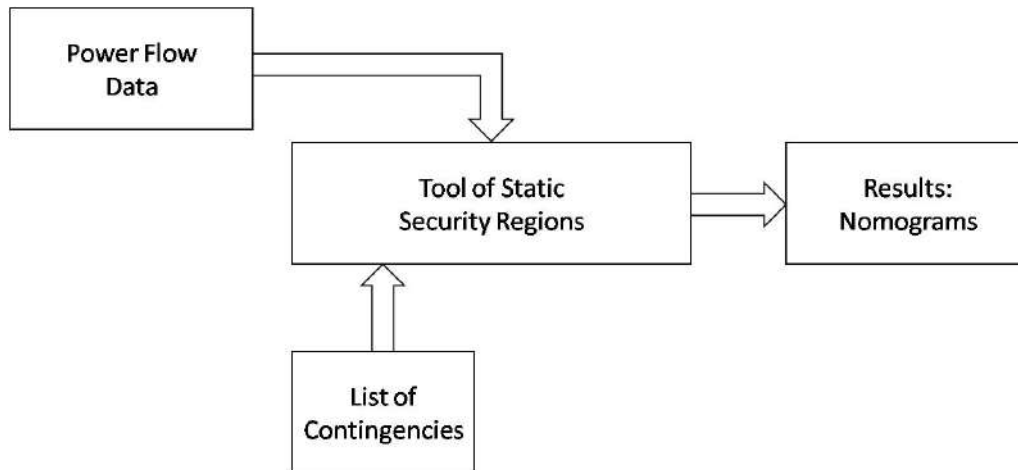


Figure 4.2: Off-line voltage security assessment scheme.

Figure 4.3 presents a scheme for on-line VSA tools [12, 13].

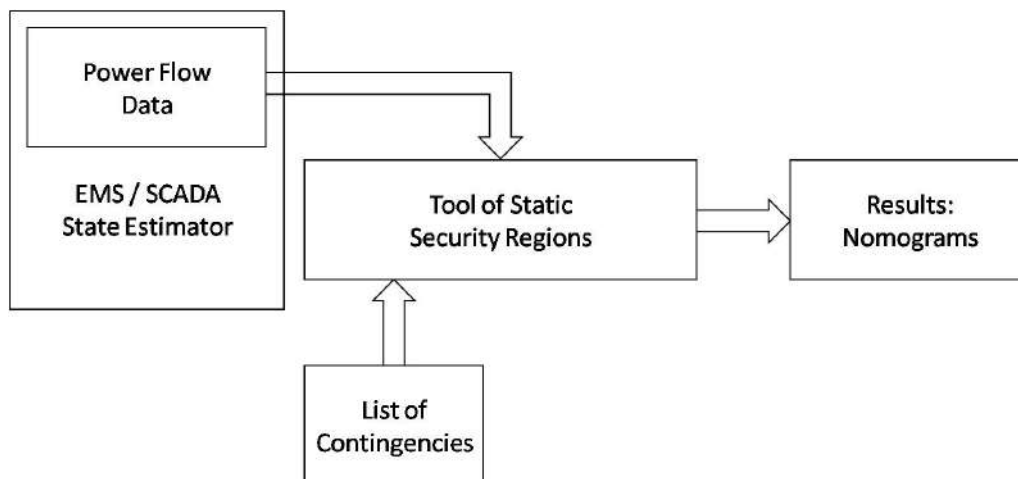


Figure 4.3: On-line voltage security assessment scheme.

Transient security assessment (TSA) is directly related to transient stability concepts and consists of determining and evaluating system dynamic behavior.

TSA should perform non-linear time responses for critical contingency situations, in order to determine the power system security.

Operating point will be considered secure if no critical contingencies are capable of leading the system to loss of synchronism between the power plants.

A TSA criteria, in general, are related to limits of: under-voltage, over-voltage, generator active power, reactive power reserve, equipment charging and transient stability margins [12–15].

The off-line TSA should use power flow data, dynamic data and a contingency list, in order to evaluate the system, determining its security regions [12, 13].

The on-line TSA uses EMS/SCADA data as power flow information and should also be executed during system operation, aiming to obtain the security regions [12, 13].

Figure 4.4 presents a scheme for off-line TSA tools [12, 13].

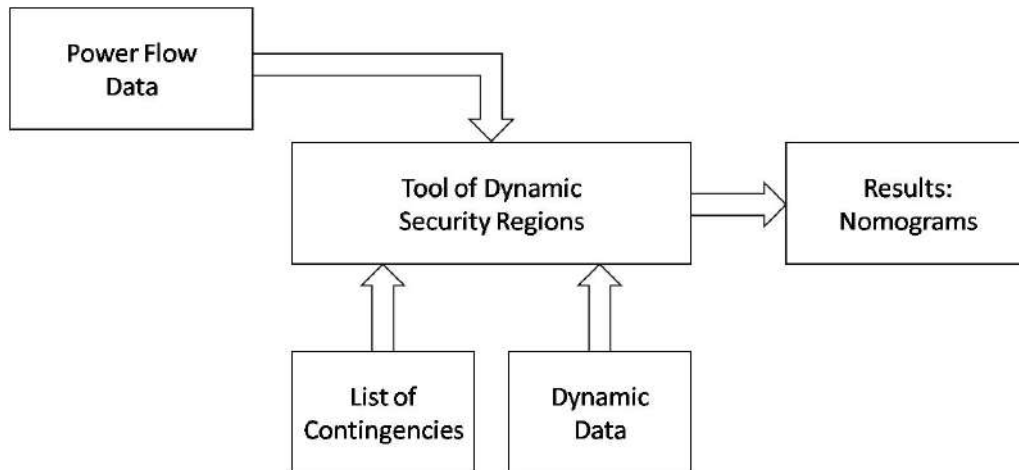


Figure 4.4: Off-line transient security assessment scheme.

Figure 4.5 presents a scheme for on-line TSA tools [12, 13].

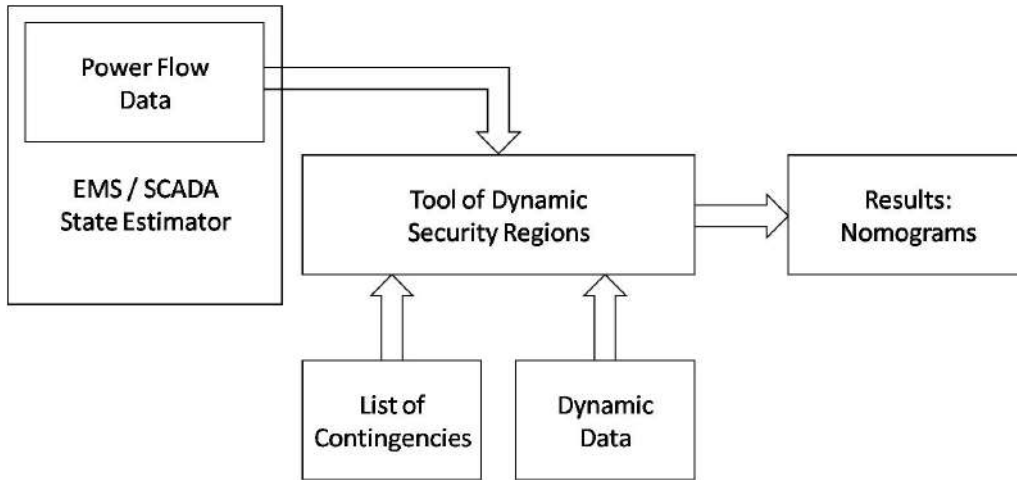



Figure 4.5: On-line transient security assessment scheme.

The power plants must be divided into three generator groups and their dispatches should be modified in order to obtain several system operation scenarios that will be evaluated in VSA or TSA [12, 13].

This generator group definition and processing time for large-scale power systems are challenges for VSA and TSA tool developers [12, 13].

All the scenarios are evaluated by the security assessment tool, aiming to determine the system security regions and their nomograms [12, 13].

Figures 4.6, 4.7 and 4.8 present illustrative nomograms example [12, 13].

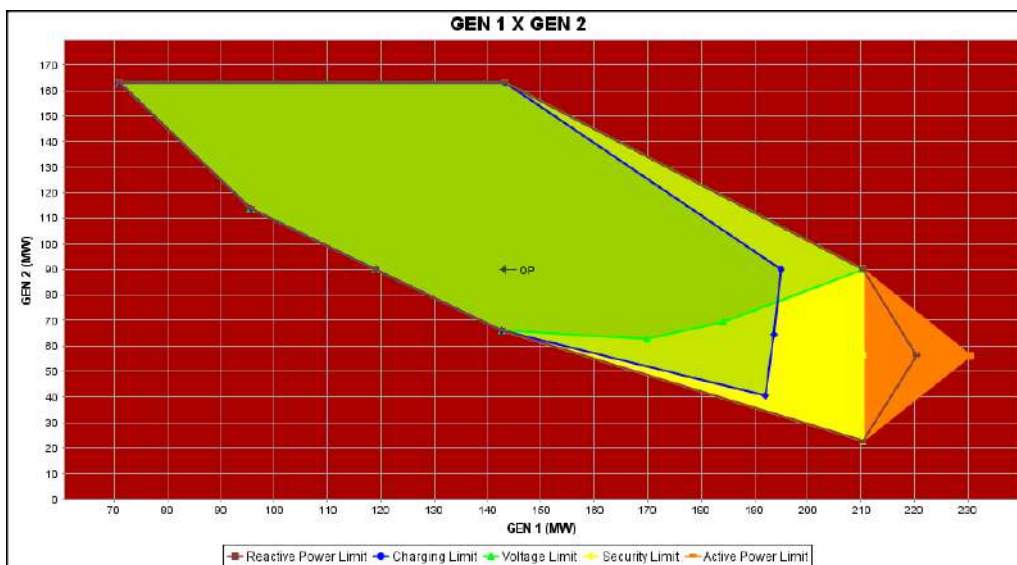Figure 4.6: Nomogram relating *Gen 1* and *Gen 2* generation groups.

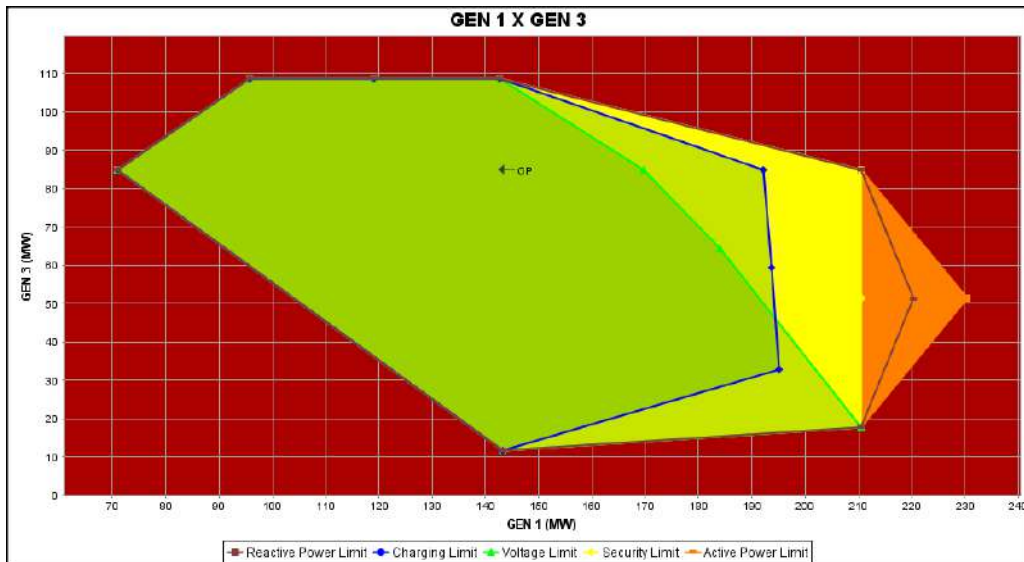


Figure 4.7: Nomogram relating *Gen 1* and *Gen 3* generation groups.

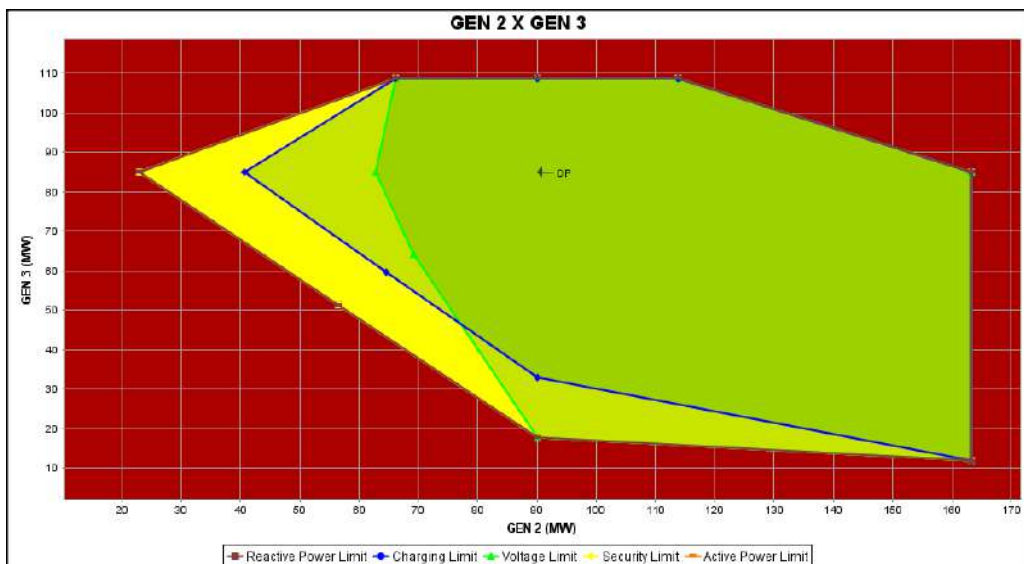


Figure 4.8: Nomogram relating *Gen 2* and *Gen 3* generation groups.

Green border represents voltage limits, blue border represents charging limits, brown border represents reactive power reserve limits, yellow border represents voltage (VSA) or transient (TSA) stability limits, and orange border represents power flow convergence limits for system normal operation.

Dark green region represents secure operating points, light green region represents operating points with one violation, yellow region represents operating points with more than one violation, orange region represents operating points with contingency issues, and red region represents operating points with normal operation issues.

The nomograms present power system security regions and can be used to identify the relative position of actual operating point in relation to the security limits, improving system planning and operation.

Power system planning studies can use the nomograms to recommend new equipment for the system, trying to improve its security.

Power system operation studies can use the nomograms to determine operative measures for the system, trying to keep its security.

4.3 Power System SSA

Small-signal security assessment (SSA) is directly related to small-signal stability concepts and consists of determining and evaluating system dynamic behavior, in face of small disturbances.

SSA should perform modal analysis and consider critical contingency situations, in order to calculate oscillation modes and determine system security.

Operating point will be considered secure if no oscillation mode presents undesired damping factor, which represents small-signal stability problems. This analysis should be done for system normal operation and contingency situations.

A SSA criteria are related with damping factors presented by system oscillation modes, which should be higher than a desired minimum value [12, 13, 16, 17].

The off-line SSA should use power flow data, dynamic data and a contingency list, in order to evaluate the system, calculating its oscillation modes and determining its security regions or root-locus contours [12, 13, 16, 17].

The on-line SSA uses EMS/SCADA data as power flow information and should also be executed during system operation, aiming to obtain the security regions, root-locus contours or on-line monitoring of oscillations [12, 13, 16, 17].

Figure 4.9 presents a scheme for off-line SSA tools [12, 13, 16, 17].

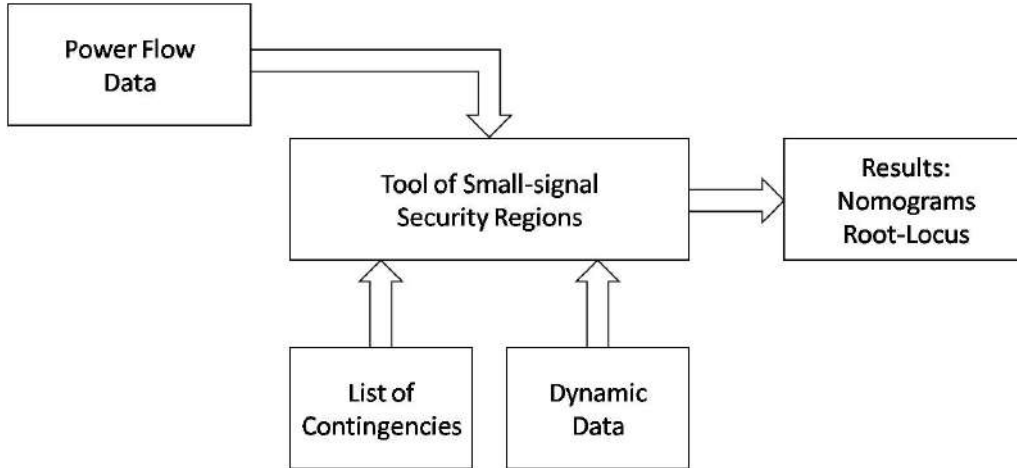


Figure 4.9: Off-line small-signal security assessment scheme.

Figure 4.10 presents a scheme for on-line SSA tools [12, 13, 16, 17].

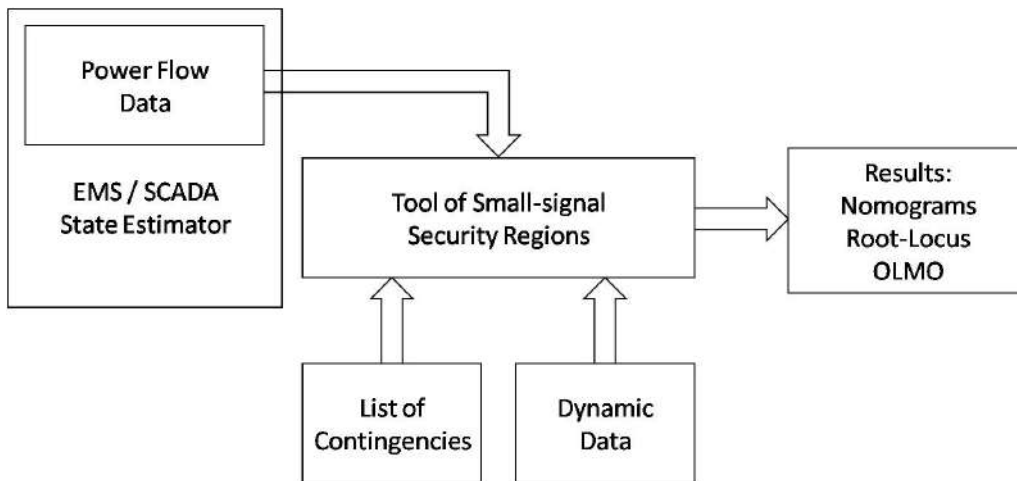


Figure 4.10: On-line small-signal security assessment scheme.

The thesis is proposing three SSA methods: damping nomogram method (DNM), root-locus method (RLM) and on-line monitoring of oscillations (OLMO).

4.3.1 Damping Nomogram Method

Damping nomogram method (DNM) consists of determining small-signal security regions for power systems, based on mode damping factors [9, 46–48].

The power plants must also be divided into three generator groups and their dispatches should be modified in order to obtain several system operation scenarios that will be evaluated in this SSA method.

All the scenarios are evaluated by the security assessment tool, aiming to determine the system small-signal security regions and their nomograms.

These SSA nomograms present the small-signal security regions, based on the minimum mode damping factor of each operating point, and can be used to identify the relative position of actual scenario in relation to the security limits, improving power system planning and operation.

Figure 4.11 illustrates a nomogram that can be used in small-signal security assessments of power systems.

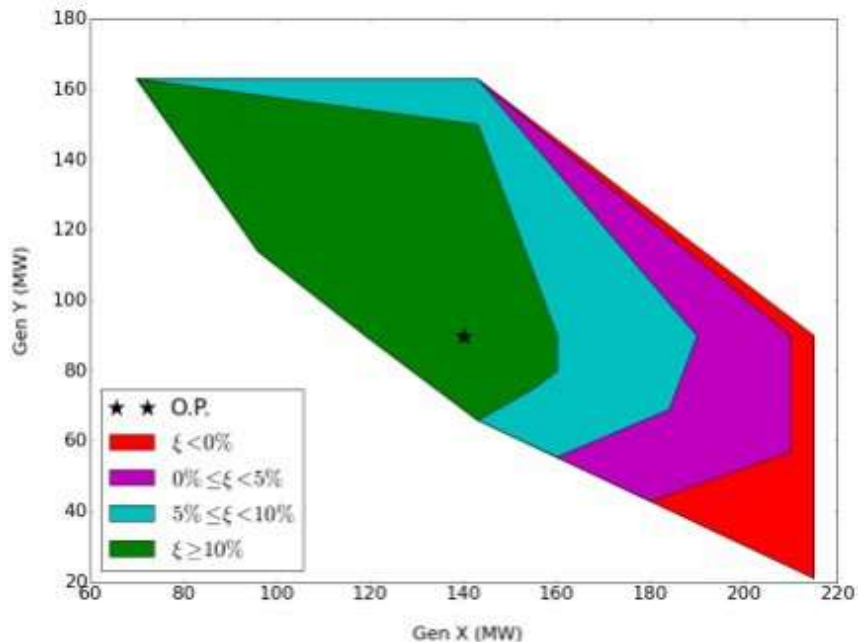


Figure 4.11: Schematic example of a SSA nomogram.

Five security regions are defined in the schematic SSA nomogram: green, blue, purple, red and white.

Green region represents the operating points defined as secure and stable, with minimum damping factor higher or equal to 10%.

Blue region represents the operating points defined as secure and stable, with minimum damping factor lower than 10% and higher or equal to 5%.

Purple region represents the operating points defined as insecure and stable, with minimum damping factor lower than 5% and higher or equal to 0%.

Red region represents the operating points defined as insecure and unstable, with minimum damping factor lower than 0% (negative damping factors), which represents instability in face of small disturbances.

Lastly, white region represents the operating points where power flow calculations were not convergent, considering a normal operation of the system.

Power system planning studies can use the SSA nomograms to recommend new equipment for the system or a new control tuning, trying to improve its security.

Power system operation studies can use the nomograms to determine operative measures for the system, as redispatches, trying to keep its security.

4.3.2 Root-locus Method

Root-locus method (RLM) consists of determining root-locus contours for power systems, considering load flow parameter variation [46, 47, 49].

These root-locus contours obtained through load flow parameter variation already exist, as can be seen in [49]. The proposed SSA method uses this kind of evaluation, in order to obtain small-signal security margins.

Important power flow variables can be used in this root-locus analysis, such as bus loads and plant dispatches.

The DNM analysis considers proportional redispatches for the power plants of the same generator group, during the scenario creation.

The RLM analysis can consider any proportion for plant redispatches and is applicable to a more detailed SSA evaluation.

Figure 4.12 presents an illustrative SSA root-locus, showing an oscillation mode displacement in complex plane caused by a load flow parameter variation.

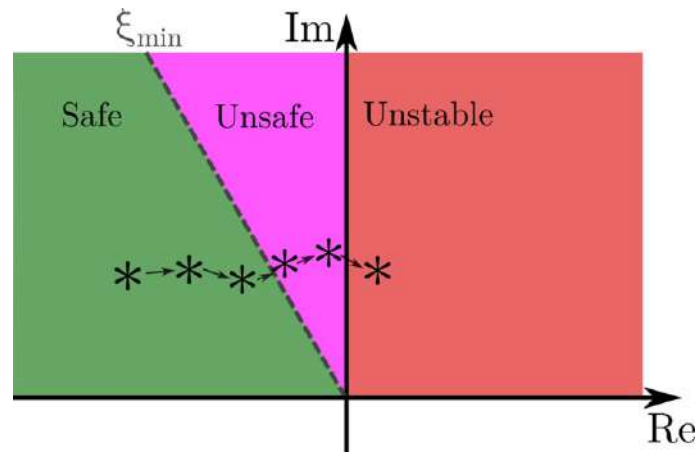


Figure 4.12: Schematic SSA root-locus example.

Figure 4.13 presents the same information as figure 4.12, showing a mapping of the mode damping factor in function of a parameter variation [16, 17].

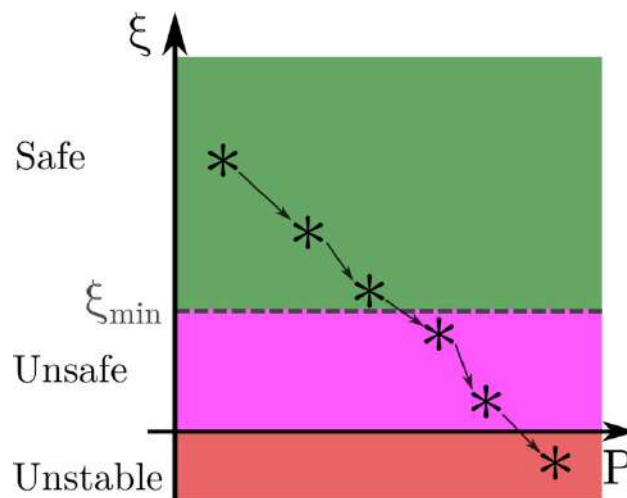


Figure 4.13: Mode damping factor mapping.

First RLM application consists of verifying system robustness and determining variation amount of parameter set that would produce poorly damped oscillations.

Load increasing with correspondent redispatch should be used in this case, in order to determine how much these loads can increase before a problem occurs.

Second RLM application consists of determining corrective measures to improve system dynamic behavior, increasing critical mode damping factors.

Power plant redispatches, terminal voltages and reactive power compensation should be used in this case, in order to obtain a better operating point.

Contingency analysis could also be considered in the RLM, yielding different root-locus contours for each one of these emergency situations.

4.3.3 On-line Monitoring of Oscillations

On-line monitoring of oscillations (OLMO) consists of monitoring small-signal stability of power systems, during their operations [47].

This monitoring is based on modal analysis, determining system oscillation modes and their damping factors, in order to detect possible oscillation problems.

Frequencies and damping factors of oscillation modes are monitored in the OLMO, which represent power system natural oscillations.

System will be considered secure if the monitored modes present damping factors higher than a desired minimum value. Otherwise, the system will be considered insecure, presenting poorly damped oscillations.

Security criteria used in OLMO are focusing on damping factors: 5% may be consider as a security limit and 0% is the stability limit.

Figure 4.14 illustrates OLMO of a secure power system, where monitored mode is always presenting a damping factor higher than the minimum desired.

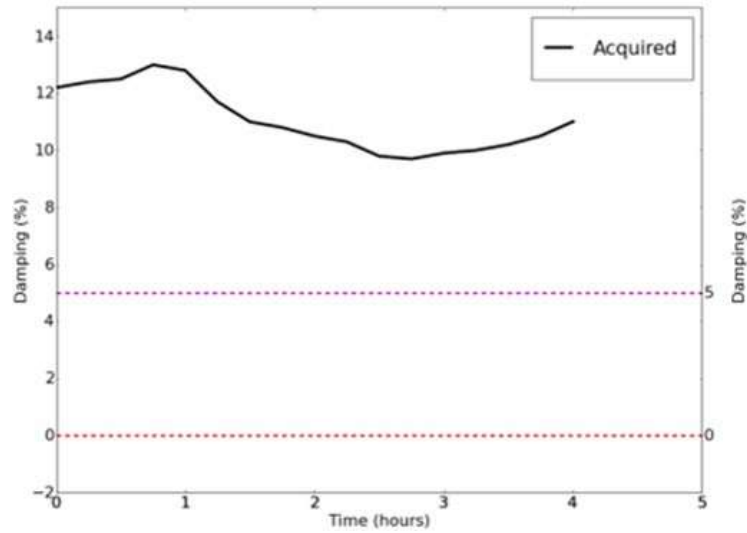


Figure 4.14: Schematic OLMO of a secure system.

Figure 4.15 illustrates OLMO of an insecure power system, where monitored mode is violating the security criteria in some operating points.

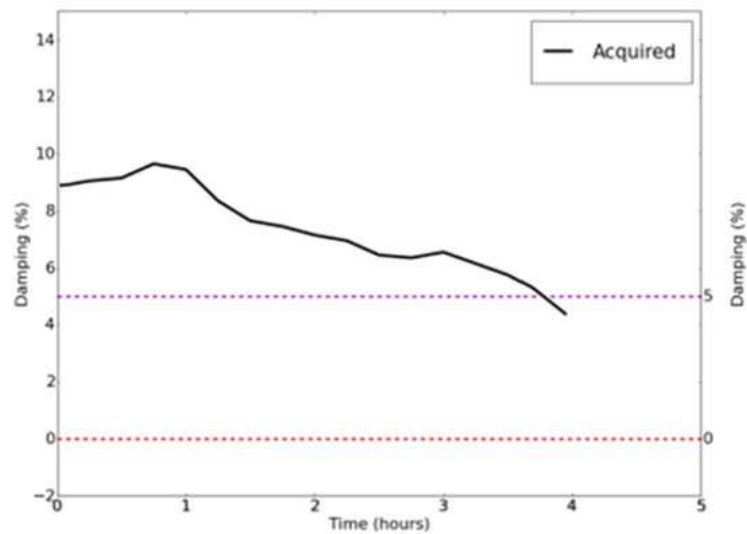


Figure 4.15: Schematic OLMO of an insecure system.

The OLMO may consider a method to forecast frequency and damping factor of important system modes, in order to preview future oscillation problems.

This forecasting may be related to simple extrapolation based on previous measurements or more complex methods based on load curve estimates.

Figure 4.16 illustrates OLMO of a secure power system, with forecasting, where monitored mode is always presenting a damping factor higher than the minimum desired, in measured and foreseen operating points.

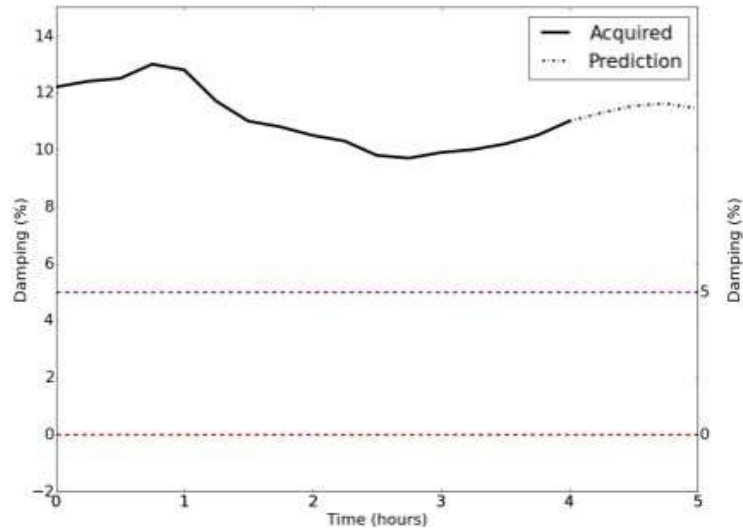


Figure 4.16: Schematic OLMO of a secure system with forecasting.

Figure 4.17 illustrates OLMO of an insecure power system, with forecasting, where monitored oscillation mode is violating the small-signal security criteria in some measured or foreseen operating point.

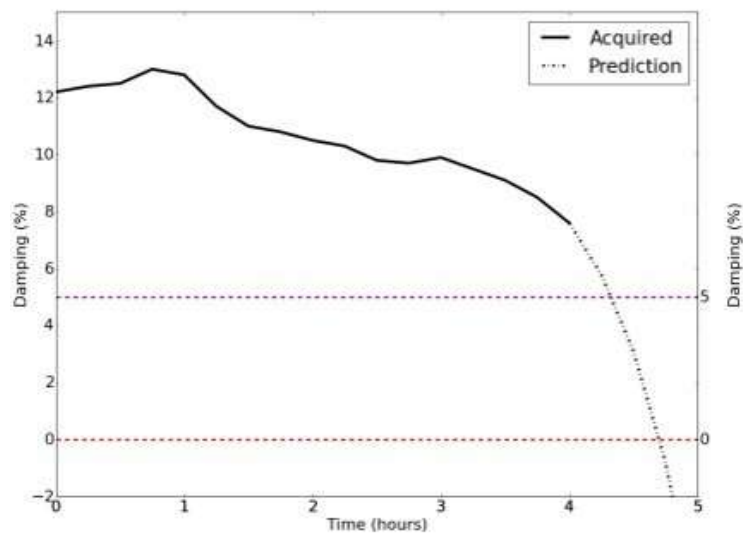


Figure 4.17: Schematic OLMO of an insecure system with forecasting.

The OLMO can also consider critical contingencies, in order to monitor the system modes of the normal operation scenarios and emergency situations.

Corrective measures can be used in power system, aiming to keep a secure operation, increasing damping factors of critical oscillation modes.

Figure 4.18 illustrates OLMO of a power system, where a security violation was foreseen and a corrective measure was used to keep a secure system operation, through increasing monitored mode damping factor.

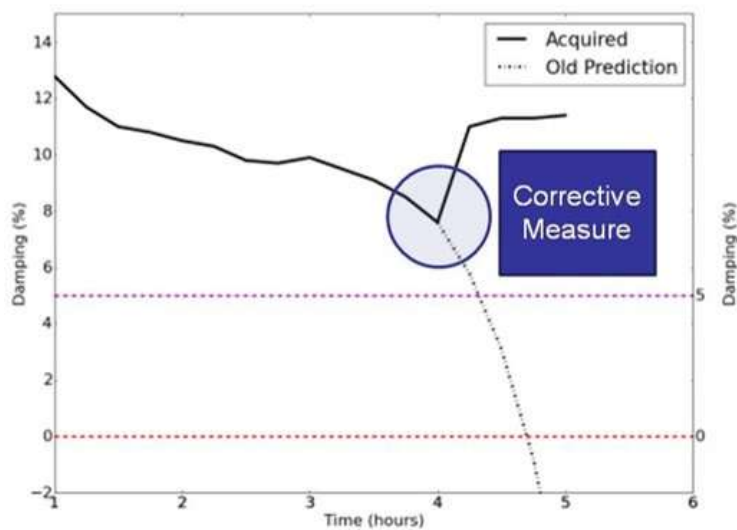


Figure 4.18: Schematic OLMO with forecasting and corrective measure.

Oscillation mode dynamic behaviors can be modified through using corrective measures in power systems, which are used to increase mode damping factors and can be related to automatic or operator actions.

Automatic actions can be related to supervisory control system utilization or power system stabilizer tuning. Adaptive control systems can also be used, in order to improve power system dynamic behavior.

Operator actions can be related to manual control system tuning or power plant redispatches, aiming to obtain better damping factor for monitored modes and keeping the system inside the security limits [44].

Nowadays, there are methods and strategies for power system monitoring based on phase measurement units (PMU) utilization [50].

The OLMO uses the steady-state and dynamic power system model, differently from these methods, which are based on real-time measurements [50].

PMU methods are more accurate and direct, since they do not depend on power system model. On the other hand, OLMO depends on the state estimator and system model data base. However, OLMO enables the forecasting, which can be used for corrective measure determination.

Then, OLMO could be used with PMU methods, in order to validate power system models and have forecasting tools, in order to improve system monitoring and determine corrective measures whenever needed.

Parallel processing may be utilized in OLMO tools, for improving computational performance to run eigensolver, specially for real-time applications [51].

4.4 Computational Implementations

The damping nomogram method and on-line monitoring of oscillations were implemented in software PacDyn [8], from CEPTEL. These developments will be described following. The root-locus method, already existent [49], was not focused in this work, therefore, its implementation will not be described.

4.4.1 Damping Nomogram Method

Damping nomogram method was implemented in software PacDyn [8] and can be used to determine small-signal security regions for power systems.

These regions are based on damping factors of system modes, which can be calculated through QR [52, 53] or DPSE [54] methods.

QR method [52, 53] is capable of determining all the modes of a power system, while, DPSE [54] only calculates a mode set of interest.

A communication between software ANAREDE [5] and PacDyn [8] was developed for the creation of scenarios to be evaluated in DNM.

Figure 4.19 presents the algorithm used by ANAREDE [5] to define the operating point list necessary in this SSA method.

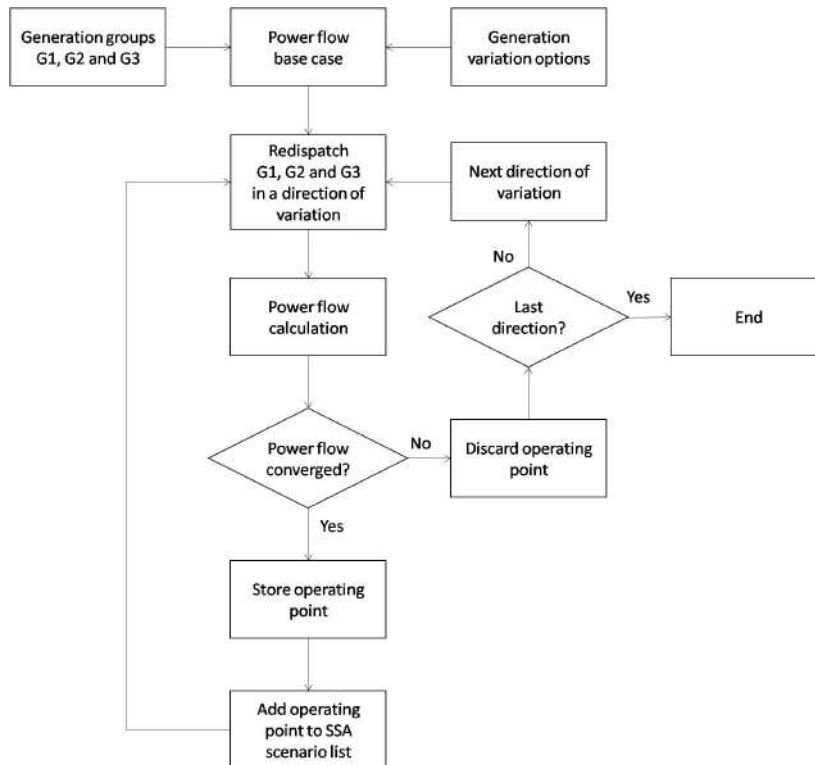


Figure 4.19: SSA scenario creation algorithm.

PacDyn [8] uses this communication with ANAREDE [5] for creating several scenarios to be evaluated in SSA.

Modes are obtained through QR [52, 53] or DPSE [54] methods, for all operating points, considering system normal operation and contingency situations.

Then, mode damping factors are verified, in order to determine the small-signal security regions, defining the SSA nomograms.

There are three nomograms for system normal operation and other three nomograms for the critical contingency situations.

Figure 4.20 presents the damping nomogram method algorithm, implemented in PacDyn [8] for SSA executions.

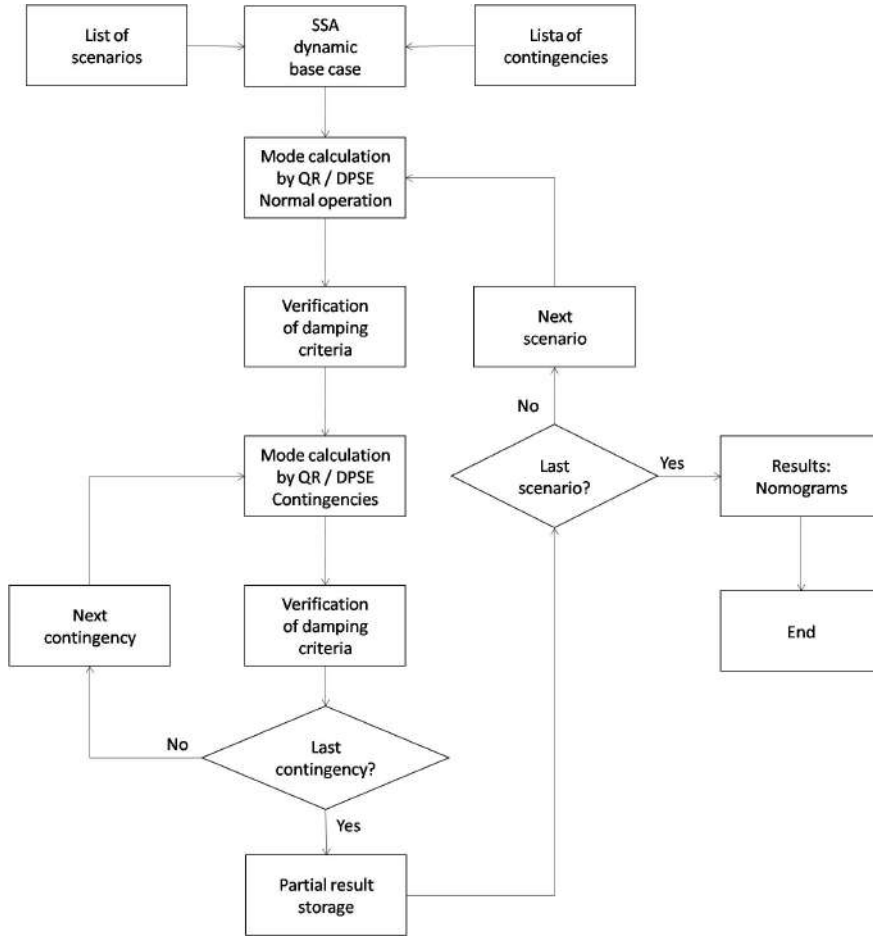


Figure 4.20: Damping nomogram method algorithm.

4.4.2 On-line Monitoring of Oscillations

On-line monitoring of oscillations was implemented in software PacDyn [8] and can be used to execute small-signal stability monitoring of power systems.

PacDyn monitors a mode set, which is calculated through using DPSE [54] method, considering system normal operation and contingency situations.

The software stays monitoring system steady-state data. When an EMS/SCADA updates these data, PacDyn [8] updates mode calculation, running DPSE [54] again, and obtains new frequencies and damping factors for monitored modes.

The OLMO results and their graphical views are also updated. These results are frequency and damping factor graphics over the time.

OLMO feature implemented in PacDyn [8] has several functions of this software available for using, such as: mode view in complex plane, linear time responses, frequency responses, root-locus calculations, sensitivities calculations, from among other modal analysis tools.

Figure 4.21 presents the OLMO algorithm, implemented in PacDyn [8] for small-signal stability monitoring.

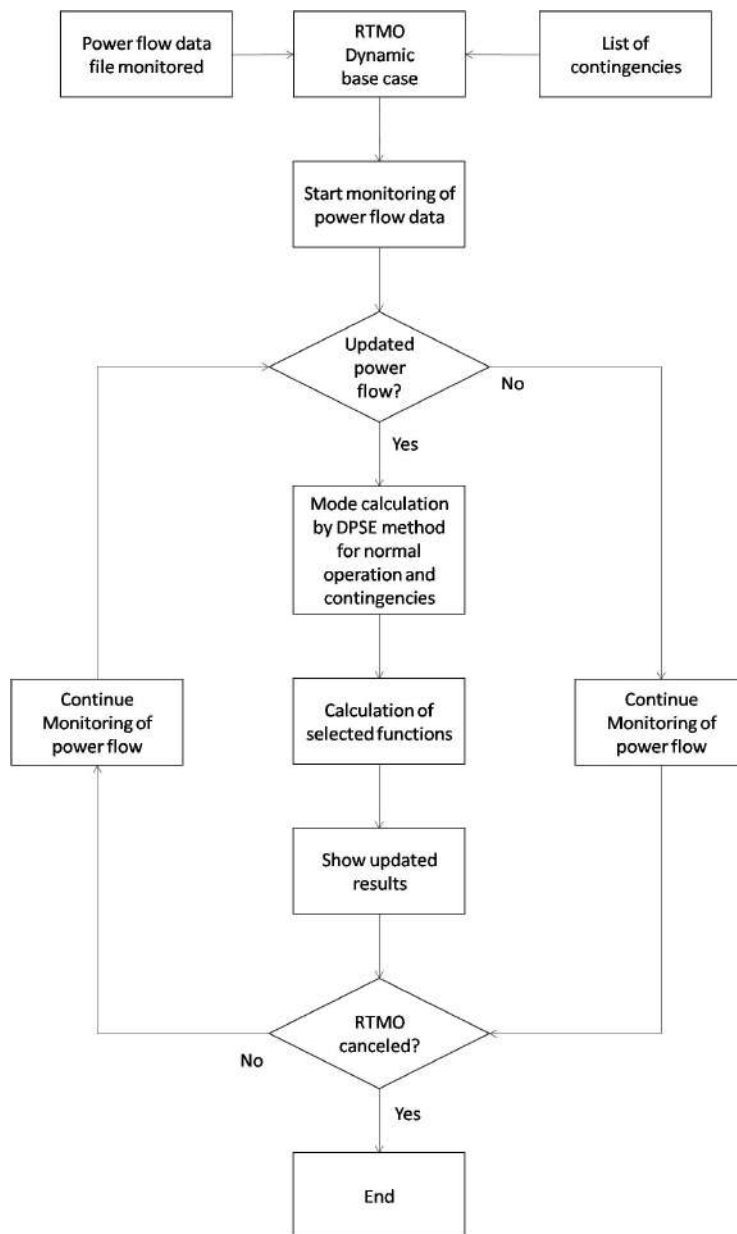


Figure 4.21: OLMO algorithm.

4.5 Final Considerations

Main concepts of voltage, transient and small-signal security assessment were briefly described in this chapter, focusing on SSA.

The damping nomogram method (DNM), root-locus method (RLM) and on-line monitoring of oscillations (OLMO) were proposed for SSA execution.

Computational implementations of the DNM and OLMO in software PacDyn [8] were presented, finishing this chapter.

Chapter 5

Hopf Bifurcation Application

This chapter will make a Hopf bifurcation literature review and will propose a method for power plant redispatches, considering a mode damping factor criteria. Generation sensitivity calculation will also be presented.

5.1 Hopf Bifurcation Analysis

Power system stability analysis aims at evaluating system dynamic behavior in face of disturbances, in order to detect possible focus of instability [4].

Hopf bifurcation analysis consists of determining specific situations of power systems, where their dynamic behaviors change [24].

System Hopf bifurcation points, considering small-signal stability analysis, are those where oscillation modes are positioned at the imaginary axis [24].

These situations represent the small-signal stability limits, which separates stable operating points from the unstable ones [24].

Several applications of Hopf bifurcation analysis for determining stability issues in power systems are presented in [18–33]. Parameter modifications that could lead them to a stability problem are calculated.

Some applications consider control system parameter variations, as presented in [18–20]. Other applications, however, are concerned with power flow parameter variations, as proposed in [29–33].

A method for determining minimum redispatch for power systems will be presented in this thesis, which considers a damping factor criteria for oscillation modes. This method is an extension of the algorithm proposed in [18–20].

An algorithm that uses optimization techniques and a predictor-corrector procedure is presented in [29], which can be utilized to detect power system bifurcations, including the Hopf bifurcations.

The method proposed in [29] is concerned with critical oscillation mode calculation and is applied to dynamic voltage security assessment, where modifications in the electrical grid and redispatches are considered for problem mitigation.

Power system bifurcation analysis is presented in [30], which considers several load situations. System demands are the parameters used in this study, for determining these bifurcations.

Methodology to control Hopf bifurcations through set-point modification of power systems is presented in [31], which uses reactive compensation, tap tuning, load shedding, plant terminal voltage changing, among others.

Method for determining the minimum distance to a Hopf bifurcation of power system is proposed in [32], which is based on genetic algorithm utilization. Active and reactive load variations were considered in the analysis.

An analysis of generation redispatch effects in system stability margins is presented in [33], where the Hopf bifurcation and load uncertainties are considered.

The methodologies presented in [29–33] are directly related to the research made in this work. However, they are quite different from the minimum redispatch method proposed by this thesis.

The proposed method is unique and uses optimization techniques and a mode damping factor criteria to determine, directly, a new dispatch for power systems.

5.2 Closest Hopf Bifurcation Review

Hopf bifurcation analysis applications are proposed in [18–20] for determining the lowest control parameter variation capable of making a specific system oscillation mode λ present a desired damping factor ξ_d .

The situation, determined by using this method for desired damping factor of 0%, can be defined as the closest Hopf bifurcation of power systems.

Optimization techniques are used in [18–20], in order to minimize an objective function, which ensures the minimum parameter variations.

This function is the normalized square difference sum of chosen parameters [18–20], known as euclidean norm, which is presented in equation (5.1).

$$f_{obj}(p) = \sum_{i=1}^n \left(\frac{p_i - p_{i0}}{p_{i0}} \right)^2 \quad (5.1)$$

Where:

f_{obj} = Objective function;

n = Number of chosen parameters;

p = Chosen parameter vector;

p_i = Parameter i value;

p_{i0} = Parameter i initial value.

This optimization method must consider some boundary conditions, according to [18–20], as can be seen in equations (5.2), (5.3), (5.4), (5.5) and (5.6).

$$\text{Min}f_{obj}(p) \tag{5.2}$$

S.t.:

$$f(x_0, p) = 0 \tag{5.3}$$

$$(\lambda.T - J(x_0, p)) \cdot v = 0 \tag{5.4}$$

$$c \cdot v - 1 = 0 \tag{5.5}$$

$$B(\sigma, \omega) = \sigma + \frac{\xi_d}{\sqrt{1 - \xi_d^2}} \cdot \omega \tag{5.6}$$

Where:

f_{obj} = Objective function;

p = Chosen parameter vector;

x_0 = System variable vector;

T = Expanded identity, containing 1 in diagonal elements related to state variables and 0 in those related to the algebraic variables;

J = System jacobian matrix;

v = Right eigenvector;

c = Sparse line vector used for normalization of p ;

σ = Mode real component;

ω = Mode imaginary component;

ξ_d = Desired damping factor;

f = Vector including power flow equations and equipment initialization equations;

B = Function representing the desired relation between σ and ω .

The Lagrange method can be used to solve this optimization problem. A lagrangian function LF is defined in equation (5.7) and must be minimized for obtaining the optimal solution [18–20].

$$MinLF = f_{obj}(p) + l^t \cdot h(x, p) \quad (5.7)$$

Where:

LF = Lagrangian function;

f_{obj} = Objective function;

l = Lagrangian multiplier vector;

h = Function representing equality constrains;

p = Chosen parameter vector;

x = Vector containing independent variables, except vectors p and l .

The solution is obtained when the lagrangian function gradient is null ($\nabla LF = 0$), which is represented by equations (5.8), (5.9) and (5.10), according to [18–20].

$$\frac{\partial LF}{\partial x} = l^t \cdot \frac{\partial h}{\partial x} = 0 \quad (5.8)$$

$$\frac{\partial LF}{\partial p} = \frac{\partial f_{obj}}{\partial p} + l^t \cdot \frac{\partial h}{\partial p} = 0 \quad (5.9)$$

$$\frac{\partial LF}{\partial l} = h = 0 \quad (5.10)$$

Where:

l = Lagrangian multiplier vector;

p = Chosen parameter vector;

x = Vector containing independent variables, except vectors p and l ;

h = Function representing equality constrains;

$\frac{\partial LF}{\partial x}$ = Lagrangian function derivative with respect to vector x ;

$\frac{\partial LF}{\partial p}$ = Lagrangian function derivative with respect to vector p ;

$\frac{\partial LF}{\partial l}$ = Lagrangian function derivative with respect to vector l ;

$\frac{\partial h}{\partial x}$ = Function h derivative with respect to vector x ;

$\frac{\partial f_{obj}}{\partial p}$ = Objective function derivative with respect to vector p ;

$\frac{\partial h}{\partial p}$ = Function h derivative with respect to vector p .

The non-linear system defined in equations (5.8), (5.9) and (5.10) can be solved through using Newton-Raphson method. Then, the equations (5.11), (5.12) and (5.13) can be defined [18–20].

$$l^t \cdot \frac{\partial^2 h}{\partial x^2} \cdot \Delta x + l^t \cdot \frac{\partial^2 h}{\partial p \partial x} \cdot \Delta p + \left(\frac{\partial h}{\partial x} \right)^t \cdot \Delta l = \Delta \frac{\partial LF}{\partial x} \quad (5.11)$$

$$l^t \cdot \frac{\partial^2 h}{\partial x \partial p} \cdot \Delta x + \left(\frac{\partial^2 f_{obj}}{\partial p^2} + l^t \cdot \frac{\partial^2 h}{\partial p^2} \right) \cdot \Delta p + \left(\frac{\partial h}{\partial p} \right)^t \cdot \Delta l = \Delta \frac{\partial LF}{\partial p} \quad (5.12)$$

$$\frac{\partial h}{\partial x} \cdot \Delta x + \frac{\partial h}{\partial p} \cdot \Delta p = \Delta \frac{\partial LF}{\partial l} \quad (5.13)$$

Where:

Δl = Lagrangian multiplier variation vector;

Δp = Chosen parameter variation vector;

Δx = Variation vector containing independent variables, except vectors p and l ;

$\Delta \frac{\partial LF}{\partial x}$ = Variation of lagrangian function derivative with respect to vector x ;

$\Delta \frac{\partial LF}{\partial p}$ = Variation of lagrangian function derivative with respect to vector p ;

$\Delta \frac{\partial LF}{\partial l}$ = Variation of lagrangian function derivative with respect to vector l ;

$\frac{\partial^2 h}{\partial x^2}$ = Second order derivative of function h with respect to vector x ;

$\frac{\partial^2 h}{\partial p \partial x}$ = Second order derivative of function h with respect to vectors x and p ;

$\frac{\partial h}{\partial x}$ = Function h derivative with respect to vector x ;

$\frac{\partial^2 h}{\partial x \partial p}$ = Second order derivative of function h with respect to vectors p and x ;

$\frac{\partial^2 f_{obj}}{\partial p^2}$ = Second order derivative of objective function with respect to vector p ;

$\frac{\partial^2 h}{\partial p^2}$ = Second order derivative of function h with respect to vector p ;

$\frac{\partial f_{obj}}{\partial p}$ = Objective function derivative with respect to vector p ;

$\frac{\partial h}{\partial p}$ = Function h derivative with respect to vector p .

Using this equationing in an iterative algorithm, the closest security boundary in control parameter space can be defined, according to [18–20].

This method can be used to determine the minimum parameter variation capable of making a system mode present a desired damping factor [18–20].

Mathematical difficulties arise when considering power flow parameter variation in the method proposed in [18–20], such as plant dispatches.

This thesis solved these mathematical issues in a different way, defining a minimum redispatch method, which will be described in this chapter.

5.3 Generation Sensitivities

A method for calculating oscillation mode sensitivities with respect to power plant dispatches was developed, which was called generation sensitivities.

These sensitivities can be mathematically defined as the derivative of oscillation mode λ with respect to active power dispatched by specific power plant P .

The analytical determination of these derivatives is very complex, once many jacobian elements depend on power plant dispatches.

Then, a numerical method was used for determining the generation sensitivities. Small positive and negative variations ($P + \Delta P$ and $P - \Delta P$) are applied in a specific power plant dispatch and oscillation modes are obtained for both situations ($\lambda_{+\Delta P}$ and $\lambda_{-\Delta P}$), using DPSE method [54].

Other system plants take on opposite dispatch variation, proportionally to their nominal capability (MVA base), ensuring the load-generation balance.

The generation sensitivity can be obtained through a first order approximation, which is represented by equations (5.14), (5.15) and (5.16)

$$\frac{\partial \lambda}{\partial P} \approx \frac{\Delta \lambda}{\Delta P'}, \Delta P' \rightarrow 0 \quad (5.14)$$

$$\Delta P' = 2.\Delta P \quad (5.15)$$

$$\frac{\partial \lambda}{\partial P} \approx \frac{\lambda_{+\Delta P} - \lambda_{-\Delta P}}{2.\Delta P} \quad (5.16)$$

Where:

$\frac{\partial \lambda}{\partial P}$ = Generation sensitivity of mode with respect to dispatch;

$\Delta \lambda$ = Oscillation mode variation;

$\Delta P'$ = Total dispatch variation;

ΔP = Absolute dispatch value used in positive and negative variations;

$\lambda_{+\Delta P}$ = Oscillation mode for dispatch $P + \Delta P$;

$\lambda_{-\Delta P}$ = Oscillation mode for dispatch $P - \Delta P$.

If ΔP is very small, numerical problems may happen in power flow solution. Otherwise, if ΔP is very high, the sensitivity calculation loses accuracy. In this thesis, ΔP was considered equal to 0.1 per unit in system power base.

Generation sensitivities can be used for selecting power plants to be used in the redispatch method that will be proposed in this thesis.

5.4 Hopf Bifurcation for Redispatch

Hopf bifurcation analysis can also be applied for determining a minimum power plant redispatch capable of making a specific system oscillation mode λ present a desired damping factor ξ_d .

This new application was called the closest security boundary for generation redispatch using eigenvalue sensitivities (CSBGRES method).

Similarly to the method presented in [18–20], optimization techniques can be used to minimize an objective function, which ensures the minimum dispatch variation for system power plants.

Several system jacobian elements, power flow and equipment initialization equations change in function of plant dispatches, which is a challenge.

Other mathematical issues are related to the discontinuous control of power flow model, which should be considered in the method.

A new optimization problem can be proposed, which avoids these difficulties using a different approach. This formulation is presented through equations (5.17), (5.18) and (5.19), where a mode damping factor criteria and a load-generation balance equation (without including loss variations) are considered as constraints.

$$Min f_{obj}(P) = \sum_{i=1}^n (P_i - P_{i_0})^2 \quad (5.17)$$

S.t.:

$$\sigma(P) + \frac{\xi_d}{\sqrt{1 - \xi_d^2}} \omega(P) = 0 \quad (5.18)$$

$$\sum_{i=1}^m P_i - \sum_{i=1}^m P_{i_0} = 0 \quad (5.19)$$

Where:

f_{obj} = Objective function;

P = Active power vector;

P_i = Power plant i dispatch;

P_{i_0} = Power plant i initial dispatch;

n = Number of chosen power plants;

m = Total number of system power plants;

$\sigma(P)$ = Mode real component;

$\omega(P)$ = Mode imaginary component;

ξ_d = Desired damping factor.

The variables σ and ω were considered independent variables in the optimization method presented in [18–20]. In the equationing of this thesis, these variables depend on the power plant dispatches, being dependent variables.

These σ and ω characteristics enable the CSBGRES method development, which is the main contribution of this thesis.

The Lagrange method can be used again to solve this new optimization problem. A lagrangian function LF is defined in equation (5.20) and must be minimized for obtaining the optimal solution.

$$MinLF = \sum_{i=1}^n (P_i - P_{i_0})^2 + l_1 \cdot \left(\sigma(P) + \frac{\xi_d}{\sqrt{1 - \xi_d^2}} \cdot \omega(P) \right) + l_2 \cdot \left(\sum_{i=1}^m P_i - \sum_{i=1}^m P_{i_0} \right) \quad (5.20)$$

Where:

LF = Lagrangian function;

P = Active power vector;

P_i = Power plant i dispatch;

P_{i_0} = Power plant i initial dispatch;

n = Number of chosen power plants;

m = Total number of system power plants;

$\sigma(P)$ = Mode real component;

$\omega(P)$ = Mode imaginary component;

ξ_d = Desired damping factor;

l_1 = First lagrangian multiplier;

l_2 = Second lagrangian multiplier.

Similarly to [18–20], the solution is obtained when the lagrangian function gradient is null ($\nabla LF = 0$), which is represented by equations (5.21), (5.22) and (5.23).

$$\frac{\partial LF}{\partial P} = 2(P - P_0) + l_1 \cdot \left(\frac{\partial \sigma}{\partial P} + \frac{\xi_d}{\sqrt{1 - \xi_d^2}} \cdot \frac{\partial \omega}{\partial P} \right) + l_2 = 0 \quad (5.21)$$

$$\frac{\partial LF}{\partial l_1} = \sigma + \frac{\xi_d}{\sqrt{1 - \xi_d^2}} \cdot \omega = 0 \quad (5.22)$$

$$\frac{\partial LF}{\partial l_2} = \sum_{i=1}^m P_i - \sum_{i=1}^m P_{i_0} = 0 \quad (5.23)$$

Where:

P = Active power vector;

P_i = Power plant i dispatch;

P_{i_0} = Power plant i initial dispatch;

n = Number of chosen power plants;

m = Total number of system power plants;

$\sigma(P)$ = Mode real component;

$\omega(P)$ = Mode imaginary component;

ξ_d = Desired damping factor;

l_1 = First lagrangian multiplier;

l_2 = Second lagrangian multiplier;

$\frac{\partial LF}{\partial P}$ = Lagrangian function derivative with respect to vector P ;

$\frac{\partial LF}{\partial l_1}$ = Lagrangian function derivative with respect to multiplier l_1 ;

$\frac{\partial LF}{\partial l_2}$ = Lagrangian function derivative with respect to multiplier l_2 ;

$\frac{\partial \sigma}{\partial P}$ = Derivative of mode real component with respect to vector P ;

$\frac{\partial \omega}{\partial P}$ = Derivative of mode imaginary component with respect to vector P .

The derivatives $\frac{\partial \sigma}{\partial P}$ and $\frac{\partial \omega}{\partial P}$ can be obtained through the generation sensitivities of mode λ with respect to vector P , according to equations (5.24) and (5.25).

$$\frac{\partial \sigma}{\partial P} = Re \left\{ \frac{\partial \lambda}{\partial P} \right\} \quad (5.24)$$

$$\frac{\partial \omega}{\partial P} = Im \left\{ \frac{\partial \lambda}{\partial P} \right\} \quad (5.25)$$

Where:

$\frac{\partial \lambda}{\partial P}$ = Generation sensitivity of mode λ with respect to vector P ;

$\frac{\partial \sigma}{\partial P}$ = Derivative of mode real component with respect to vector P ;

$\frac{\partial \omega}{\partial P}$ = Derivative of mode imaginary component with respect to vector P .

Similarly to [18–20], the non-linear system defined in equations (5.21), (5.22) and (5.23) can be solved through using Newton-Raphson method. Then, the equations(5.26), (5.27) and (5.28) can be defined.

$$2.\Delta P + \left(\frac{\partial \sigma}{\partial P} + \frac{\xi_d}{\sqrt{1 - \xi_d^2}} \cdot \frac{\partial \omega}{\partial P} \right) \cdot \Delta l_1 + \Delta l_2 = \Delta \frac{\partial LF}{\partial P} \quad (5.26)$$

$$\left(\frac{\partial \sigma}{\partial P} + \frac{\xi_d}{\sqrt{1 - \xi_d^2}} \cdot \frac{\partial \omega}{\partial P} \right) \cdot \Delta P = \Delta \frac{\partial LF}{\partial l_1} \quad (5.27)$$

$$\Delta P = \Delta \frac{\partial LF}{\partial l_2} \quad (5.28)$$

Where:

ΔP = Active power variation vector;

Δl_1 = First lagrangian multiplier variation;

Δl_2 = Second lagrangian multiplier variation;

ξ_d = Desired damping factor;

$\Delta \frac{\partial LF}{\partial P}$ = Variation of lagrangian function derivative with respect to vector P ;

$\Delta \frac{\partial LF}{\partial l_1}$ = Variation of lagrangian function derivative with respect to first lagrangian multiplier;

$\Delta \frac{\partial LF}{\partial l_2}$ = Variation of lagrangian function derivative with respect to second lagrangian multiplier;

$\frac{\partial \sigma}{\partial P}$ = Derivative of mode real component with respect to vector P ;

$\frac{\partial \omega}{\partial P}$ = Derivative of mode imaginary component with respect to vector P .

The second derivative of mode λ with respect to vector P was not considered for the simplification of this optimization problem. Then, a dishonest Newton-Raphson method is used here, instead of the traditional one.

Maximum and minimum limits must be consider for the active power vector P . Variable replacement can be done, aiming at their implementations.

Similarly to [18–20], the vector P can be replaced by an auxiliary vector a through using equations (5.29) and (5.30).

$$P = \frac{P_{max} + P_{min}}{2} + \frac{P_{max} - P_{min}}{2} \cdot \sin(a) \quad (5.29)$$

$$a = \arcsin\left(\frac{P - \frac{P_{max} + P_{min}}{2}}{\frac{P_{max} - P_{min}}{2}}\right) \quad (5.30)$$

Where:

P = Active power vector;

P_{max} = Maximum active power vector;

P_{min} = Minimum active power vector;

a = Auxiliary vector.

All the derivatives with respect to vector P must be replaced by the ones with respect to auxiliary vector a through using correction factors f_1 and f_2 , which are defined in equations (5.31) and (5.32).

$$f_1 = \frac{\partial P}{\partial a} = \frac{P_{max} - P_{min}}{2} \cdot \cos(a) \quad (5.31)$$

$$f_2 = \frac{\partial^2 P}{\partial a^2} = -\frac{P_{max} - P_{min}}{2} \cdot \sin(a) \quad (5.32)$$

Where:

P = Active power vector;

P_{max} = Maximum active power vector;

P_{min} = Minimum active power vector;

a = Auxiliary vector;

f_1 = Correction factor representing vector P derivative with respect to vector a ;

f_2 = Correction factor representing vector P second order derivative with respect to vector a ;

$\frac{\partial P}{\partial a}$ = Vector P derivative with respect to vector a ;

$\frac{\partial^2 P}{\partial a^2}$ = Vector P second order derivative with respect to vector a .

Correction factors f_1 and f_2 should be used in linearized system shown in equations (5.26), (5.27) and (5.28), so the optimization problem can be modelled in function of vector a , instead of vector P .

This new system can be defined through equations (5.33), (5.34) and (5.35).

$$\begin{aligned} & \left(2.f_1^2 + \left(2.(P - P_0) + l_1 \cdot \left(\frac{\partial \sigma}{\partial P} + \frac{\xi_d}{\sqrt{1 - \xi_d^2}} \cdot \frac{\partial \omega}{\partial P} \right) + l_2 \right) f_2 \right) \cdot \Delta a \\ & + f_1 \cdot \left(\frac{\partial \sigma}{\partial P} + \frac{\xi_d}{\sqrt{1 - \xi_d^2}} \cdot \frac{\partial \omega}{\partial P} \right) \cdot \Delta l_1 + f_1 \cdot \Delta l_2 = f_1 \cdot \Delta \frac{\partial LF}{\partial P} \end{aligned} \quad (5.33)$$

$$f_1 \cdot \left(\frac{\partial \sigma}{\partial P} + \frac{\xi_d}{\sqrt{1 - \xi_d^2}} \cdot \frac{\partial \omega}{\partial P} \right) \cdot \Delta a = \Delta \frac{\partial LF}{\partial l_1} \quad (5.34)$$

$$f_1 \cdot \Delta a = \Delta \frac{\partial LF}{\partial l_2} \quad (5.35)$$

Where:

Δa = Auxiliary vector variation;

Δl_1 = First lagrangian multiplier variation;

Δl_2 = Second lagrangian multiplier variation;

ξ_d = Desired damping factor;

$\Delta \frac{\partial L F}{\partial P}$ = Variation of lagrangian function derivative with respect to vector P ;

$\Delta \frac{\partial L F}{\partial l_1}$ = Variation of lagrangian function derivative with respect to first lagrangian multiplier;

$\Delta \frac{\partial L F}{\partial l_2}$ = Variation of lagrangian function derivative with respect to second lagrangian multiplier;

$\frac{\partial \sigma}{\partial P}$ = Derivative of mode real component with respect to vector P ;

$\frac{\partial \omega}{\partial P}$ = Derivative of mode imaginary component with respect to vector P ;

P = Active power vector;

P_0 = Initial active power vector;

l_1 = First lagrangian multiplier used in the method;

l_2 = Second lagrangian multiplier used in the method;

f_1 = Correction factor representing vector P derivative with respect to vector a ;

f_2 = Correction factor representing vector P second order derivative with respect to vector a .

Using this equationing in an iterative algorithm, the closest security boundary for generation redispatch using eigenvalue sensitivities can be defined.

The CSBGRES method can be used to determine minimum redispatches capable of making a system mode present a desired damping factor.

Computational implementation of the method should use step-length controls in desired damping factor and active power variations, in order to keep mode track and improve algorithm convergence.

The proposed method can be applied to determine power system security margins or possible corrective measures to improve its dynamic behavior.

5.5 Computational Implementations

The generation sensitivity calculation and CSBGRES method were implemented in software PacDyn [8]. These developments will be described following.

5.5.1 Generation Sensitivities

Generation sensitivity calculation was implemented in software PacDyn [8], using equations (5.14) and (5.16), and can be used to determine system mode displacement trend in complex plane in function of power plant dispatches.

These sensitivities can also be used to select the power plants to be utilized in CSBGRES method for minimum redispatches.

This development was made through programming an iterative algorithm that runs the calculation defined in equations (5.14) and (5.16) for each power plant.

Software ANAREDE [5] is used for the several power flow executions needed to obtain the generation sensitivities.

The results are phasors that show this displacement trend in complex plane of the mode of interest, when modifying power plant dispatches.

This numerical method used in this computational implementation is generic and can be utilized to determine the sensitivities of oscillation modes with respect to any parameter of electrical power systems.

Figure 5.1 presents the generation sensitivity calculation algorithm, implemented in PacDyn [8] for obtaining a first order relation between system oscillation mode and power plant dispatches.

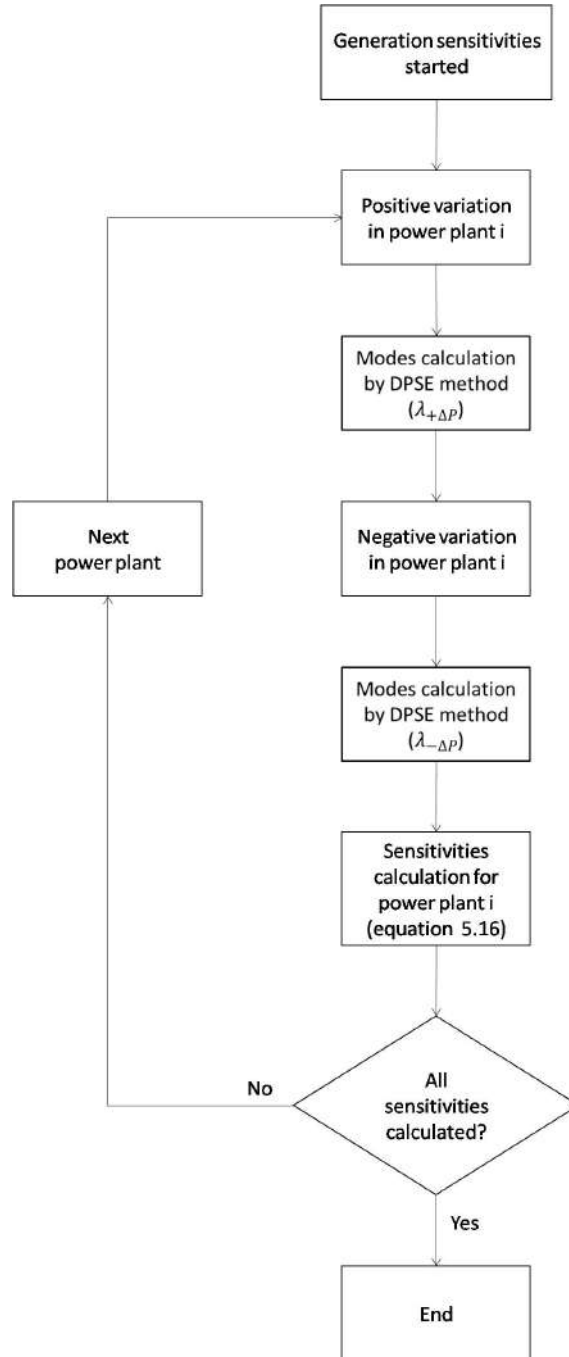


Figure 5.1: Generation sensitivity calculation algorithm.

5.5.2 Hopf Bifurcation for Redispatch

The CSBGRES method was implemented in software PacDyn [8], using equations (5.26), (5.27) and (5.28), and can be used to determine minimum redispatch to achieve a desired damping factor for a system mode.

This development was made through programming an iterative algorithm that runs the calculation defined in equations (5.26), (5.27) and (5.28), which is based on dishonest Newton-Raphson method.

The algorithm is an alternating method, similar to a predictor-corrector process.

Power flow calculation and mode determination are made considering the dispatches of actual iteration, using ANAREDE [5] and PacDyn [8].

If the desired damping factor was not reached, a new Newton-Raphson iteration is executed to determine power plant dispatch variations.

This alternating procedure is repeated until desired damping factor is reached for the mode of interest and the minimum redispatch is obtained.

Convergence verification is made through a comparison between the mode damping factor and the desired value. If this difference is lower than a tolerance, which is 0.1% in this work, the process is convergent.

Losses variations are taken on by the power plants selected to be used in the method.

This numerical procedure used in this computational implementation is generic and can be utilized to consider the variation of any power system parameter, in order to obtain its security margins.

Figure 5.2 presents the CSBGRES method algorithm, implemented in PacDyn [8] for determining minimum dispatches for power systems, considering a damping factor criteria for oscillation modes.

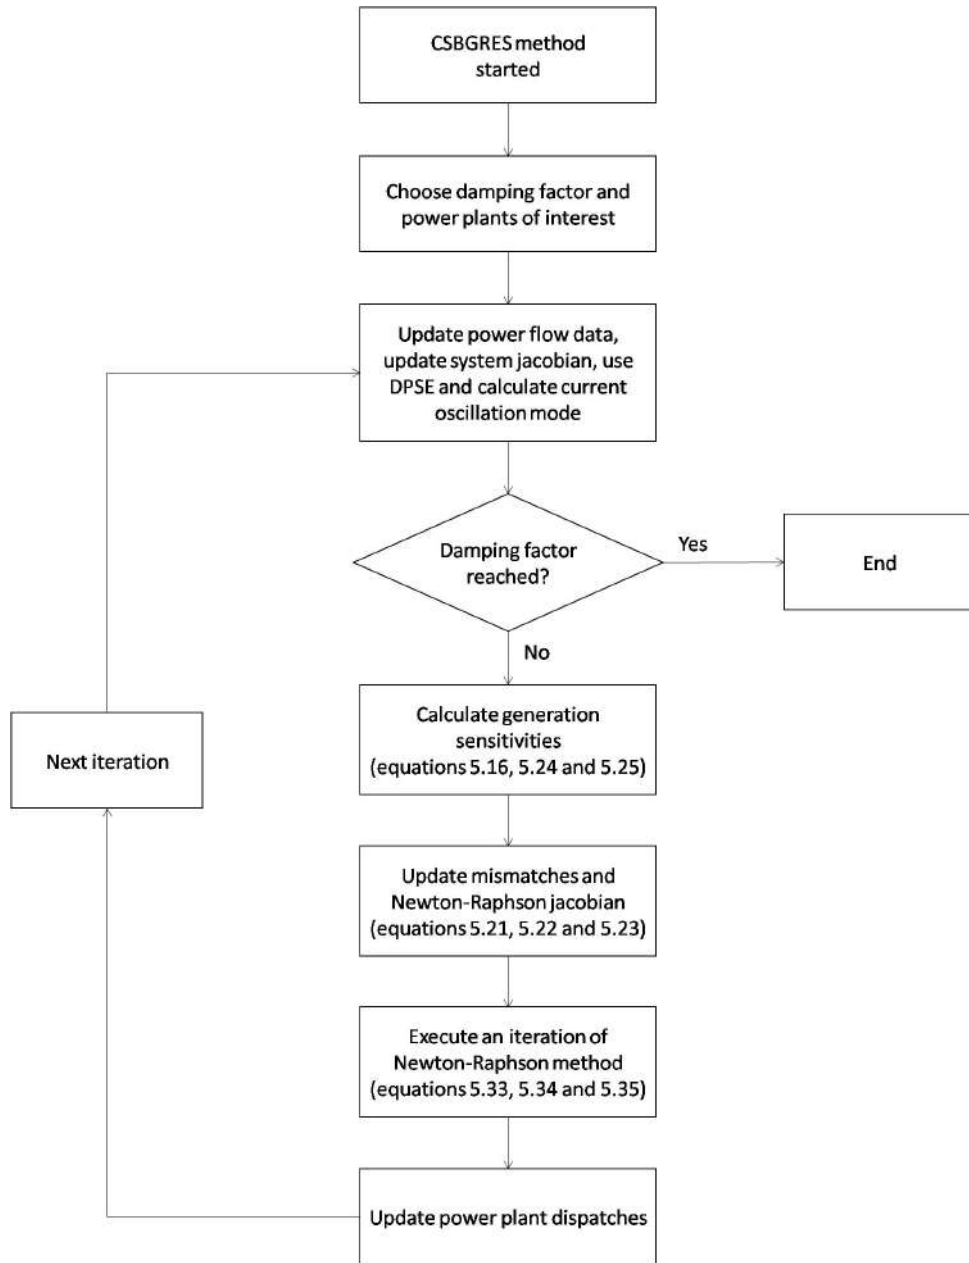


Figure 5.2: CSBGRES method algorithm.

5.6 Final Considerations

Hopf bifurcation analysis and the closest security boundary in control parameter space algorithm were reviewed in this chapter.

A generation sensitivity calculation was developed and can be used to determine mode displacement trend in complex plane in function of power plant dispatches and select machines to be used in system redispatch.

The CSBGRES method was also developed and can be used to obtain minimum redispatches for power plants needed to achieve a desired damping factor for a specific system mode.

Chapter 6

Tests and Results

This chapter will perform tests and simulations using the methods developed in this thesis. Results will be evaluated, in order to highlight the benefits obtained through applying these methods in power system analyses.

6.1 SAGE System Results

Damping nomogram method (DNM) was tested in a Brazilian equivalent system (appendix A), containing about 65 buses and 29 machines (related to Itaipu, South and Southeast power plants).

Power flow base case from the energy management open system (SAGE) [55], developed by CEPTEL, was used in this analysis.

Figure 6.1 [56] presents the single-line diagram of SAGE system, showing interconnections between three electrical areas.

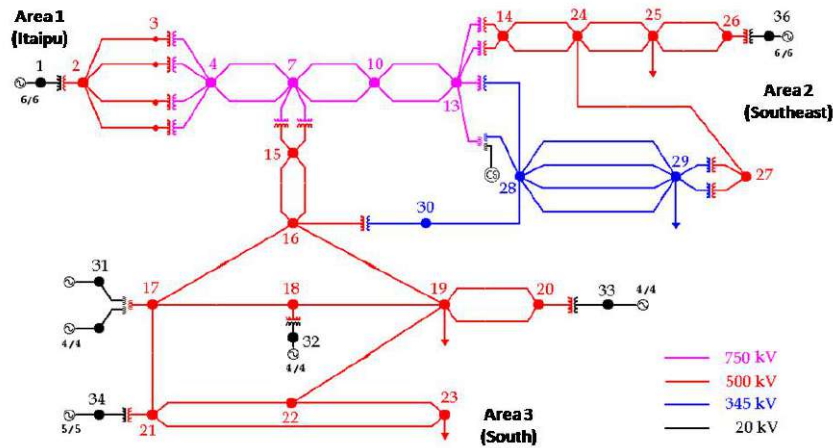


Figure 6.1: SAGE system single-line diagram.

Power plants of area 1 were chosen to form the generation group 1, power plants of area 2 were chosen to form the generation group 2 and the other power plants were chosen to form the generation group 3.

Ten redispatch directions were used for creating scenarios to be evaluated. Two outages were considered as contingencies: of transmission line inside area 3, and interchanging line between areas 1 and 2.

Figure 6.2 to 6.13 present DNM results with oscillation modes obtained through QR [52, 53] and DPSE [54] methods, considering system normal operation and contingency situations.

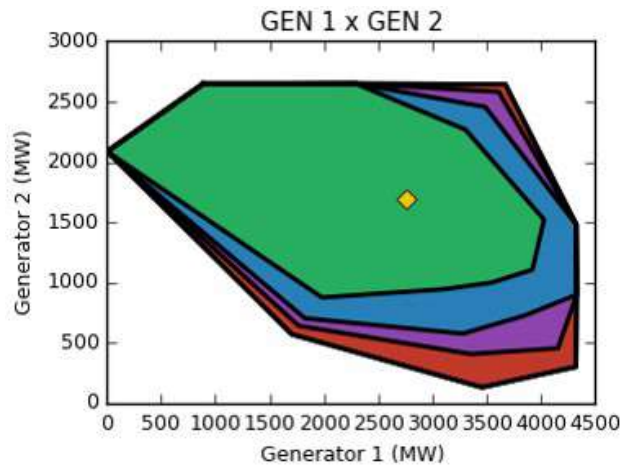


Figure 6.2: Gen 1 x Gen 2 nomogram for system normal operation using QR.

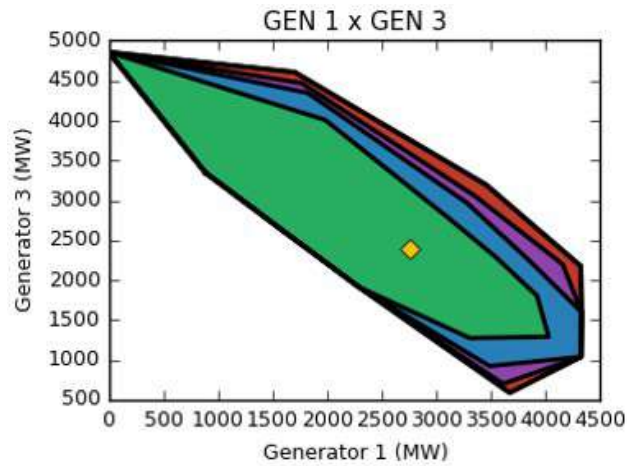


Figure 6.3: Gen 1 x Gen 3 nomogram for system normal operation using QR.

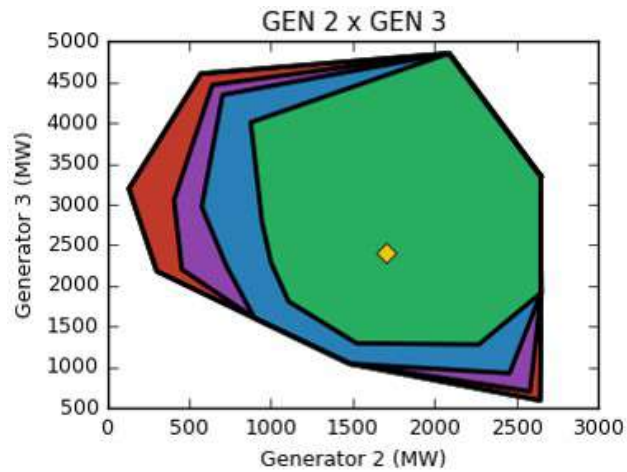


Figure 6.4: Gen 2 x Gen 3 nomogram for system normal operation using QR.

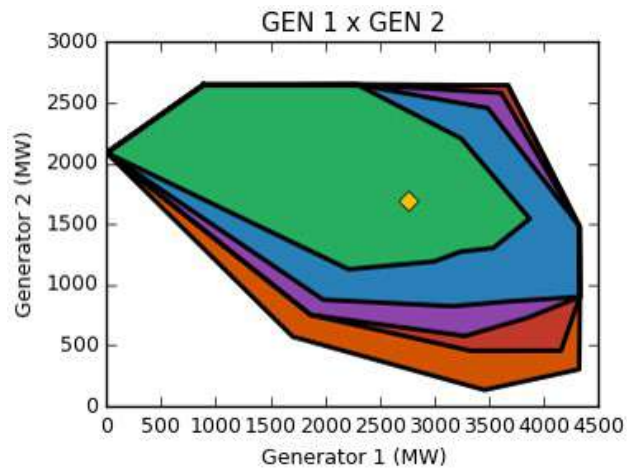


Figure 6.5: Gen 1 x Gen 2 nomogram for contingency situations using QR.

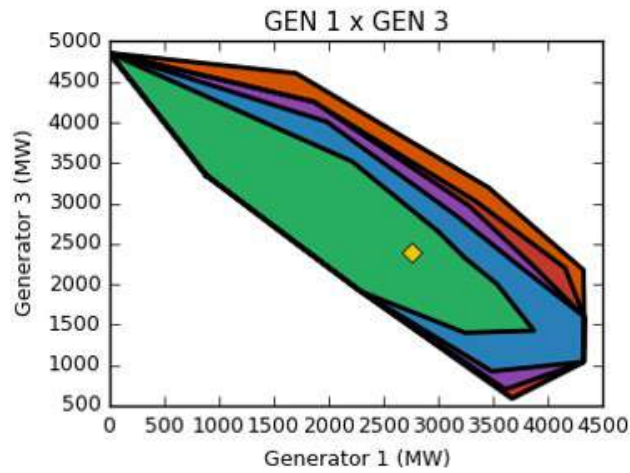


Figure 6.6: Gen 1 x Gen 3 nomogram for contingency situations using QR.

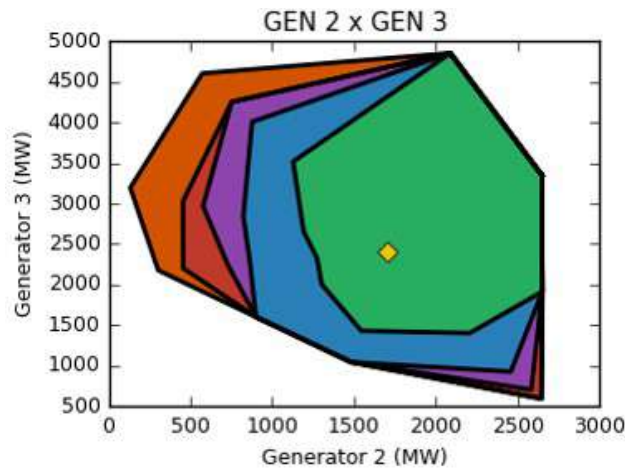


Figure 6.7: Gen 2 x Gen 3 nomogram for contingency situations using QR.

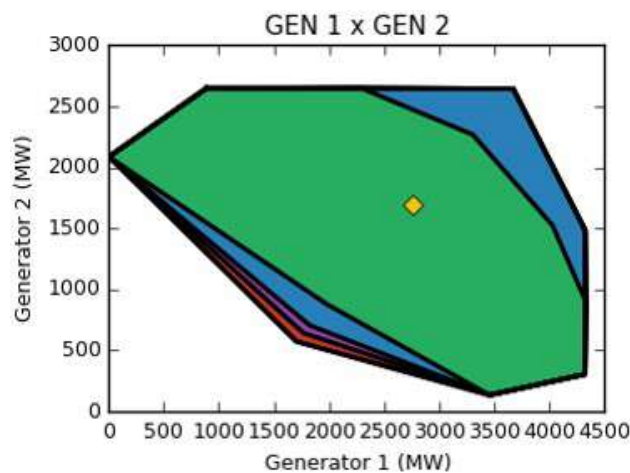


Figure 6.8: Gen 1 x Gen 2 nomogram for system normal operation using DPSE.

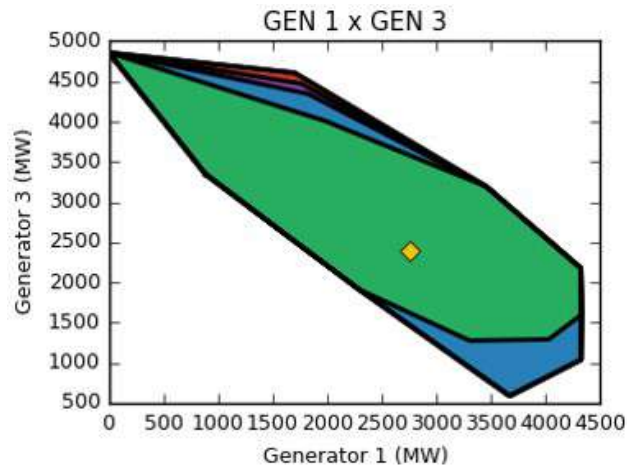


Figure 6.9: Gen 1 x Gen 3 nomogram for system normal operation using DPSE.

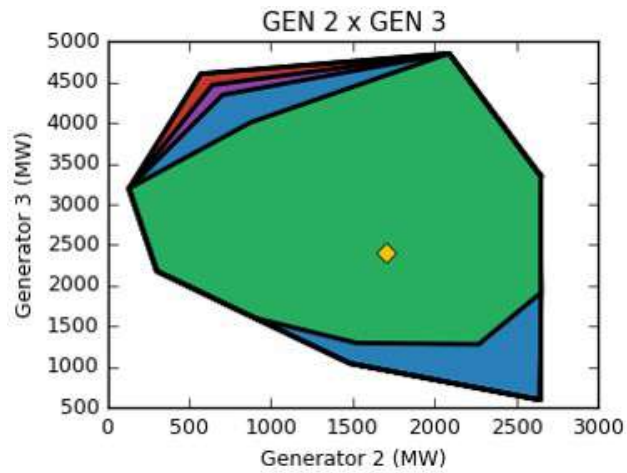


Figure 6.10: Gen 2 x Gen 3 nomogram for system normal operation using DPSE.

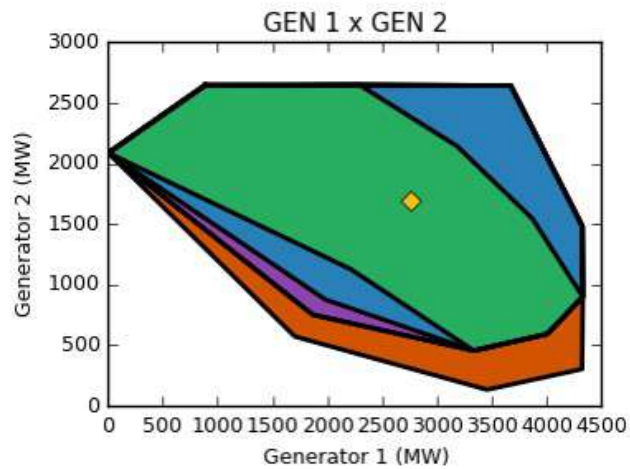


Figure 6.11: Gen 1 x Gen 2 nomogram for contingency situations using DPSE.

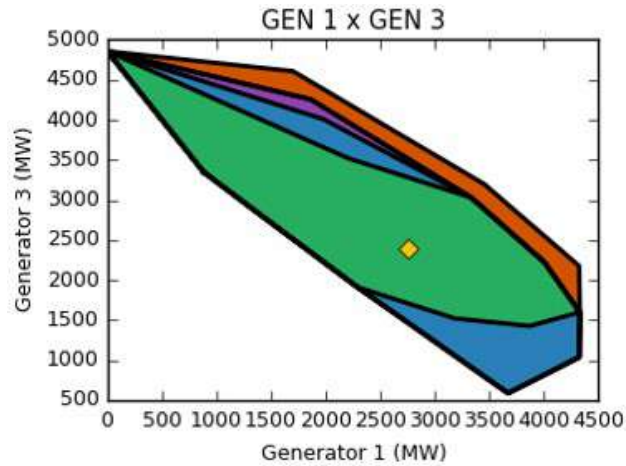


Figure 6.12: Gen 1 x Gen 3 nomogram for contingency situations using DPSE.

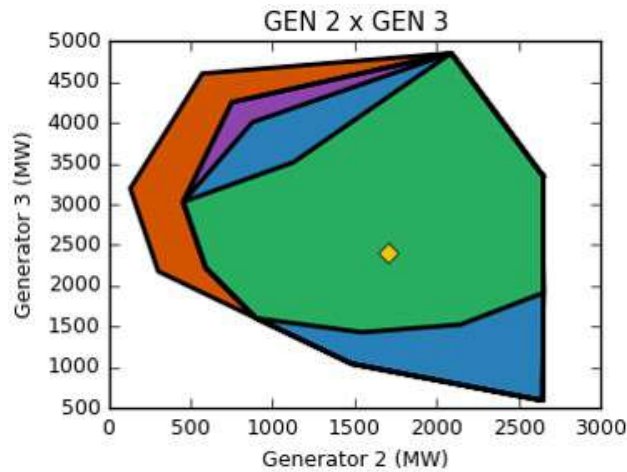


Figure 6.13: Gen 2 x Gen 3 nomogram for contingency situations using DPSE.

Small-signal security regions can be obtained through DNM, which can be observed using a set of nomograms. The distance of actual operating point (yellow dot) to the security borders can be determined.

The influence of contingencies and power plant dispatches in mode damping factors and security regions can be observed.

SAGE system presents 628 state variables and 129 scenarios were evaluated in these tests. The QR method [52, 53] was monitoring all oscillation modes and DPSE method [54] was monitoring only 8 modes.

The processing time was around 5 minutes for DNM by QR method [52, 53] and 2 minutes for DNM by DPSE method [54], using a processor Intel (R) Core (TM) i7-3537U CPU @ 2.00 GHz.

A comparison between the DNM results obtained through both eigensolutions can be made, which is presented in figure 6.14.

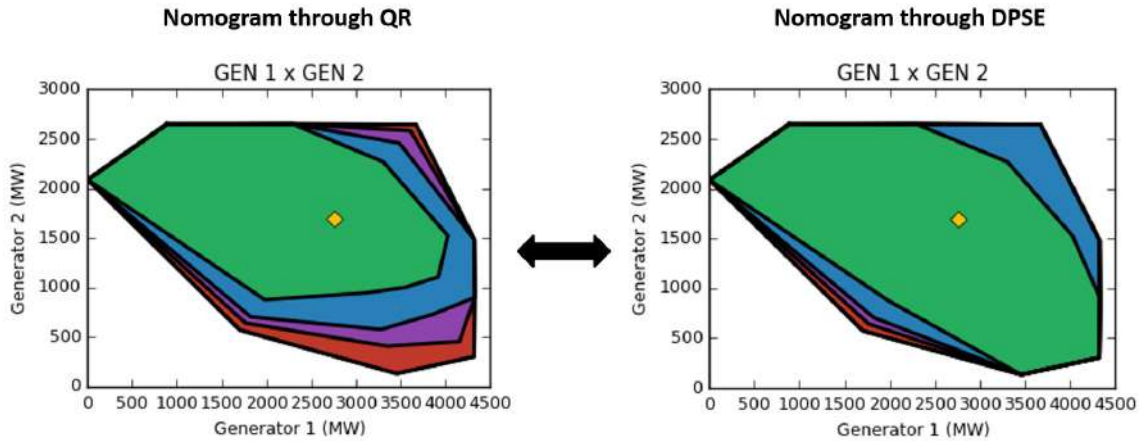


Figure 6.14: Comparison of nomograms obtained through QR and DPSE methods.

The results obtained through QR [52, 53] and DPSE [54] are different, because all modes are calculated in DNM by QR (full eigensolution), but only a mode set is determined in DNM by DPSE (partial eigensolution).

DNM by DPSE is faster than DNM by QR, but it loses some information about mode damping factor when monitoring only a set of oscillation modes. In this case, the inter-area oscillation modes should be chosen for monitoring, due to their importance to power systems.

The DNM by QR method should not be used for evaluating large-scale power system. The processing time would be very large, so its use would not be feasible. In this case, DNM by DPSE method is recommended.

Small-signal stability margins and corrective measures for power systems can be determined through using the damping nomogram method, in order to improve their planning and operation.

These corrective measures can be related to power plant redispatches and control system tuning, as represented in figures 6.15 and 6.16.

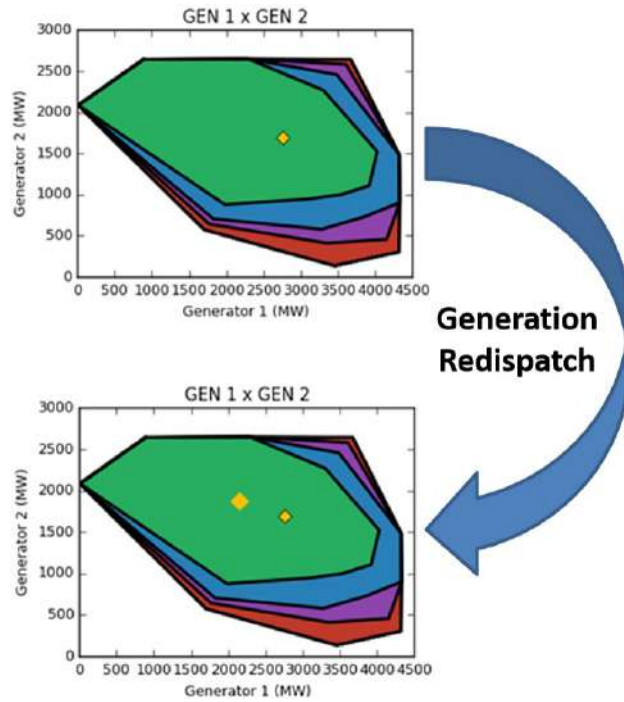


Figure 6.15: Corrective measure through power plant redispatch.

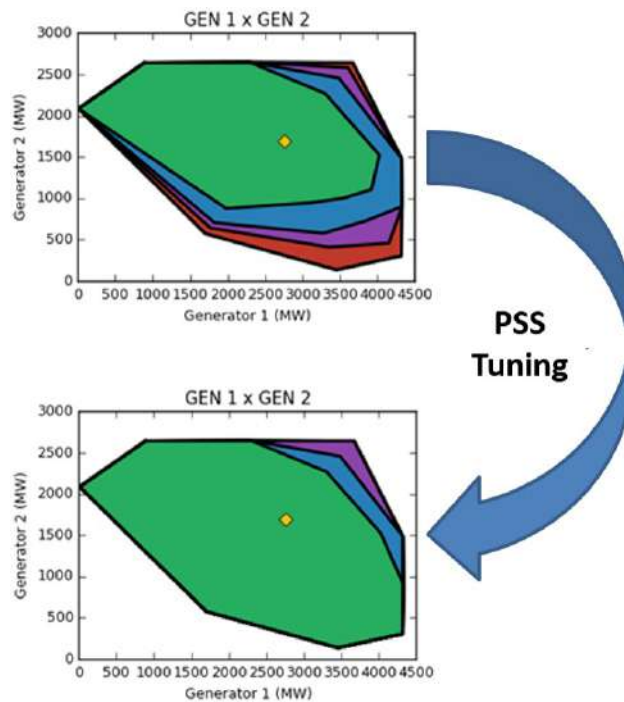


Figure 6.16: Corrective measure through PSS tuning.

Power plant redispaches could be made, in order to change the system operating point to a better scenario, as presented in 6.15, where the small yellow dot is the initial scenario and big yellow dot is the new operating point.

A control system tuning could also be made, in order to improve system security levels, as presented in 6.16, where the secure regions (green and blue) of the nomogram become bigger after a PSS tuning.

6.2 Two Areas System Results

On-line monitoring of oscillation (OLMO), generation sensitivity calculation and CSBGRES method were tested in Two area system (appendix B), containing about 11 buses and 4 machines [4, 57].

Figure 6.17 presents the single-line diagram of Two areas system, showing interconnections between two electrical areas. The area 1 has the power plants of buses 1 and 2, while, area 2 has the power plants of buses 3 and 4.

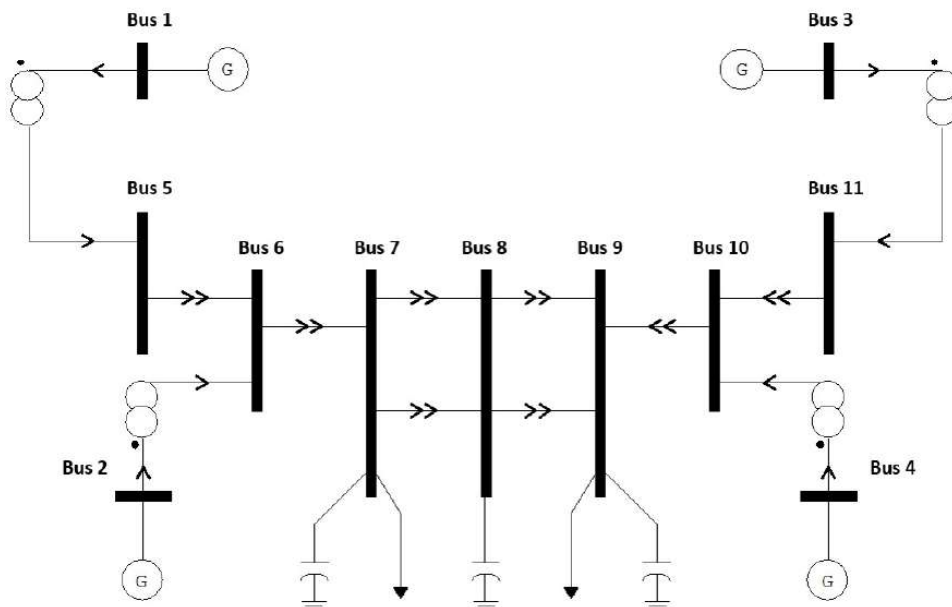


Figure 6.17: Two areas system single-line diagram.

The system was presenting a base case with the following characteristics:

- Power plant dispatch and terminal voltage at bus 1 = 700 MW and 1.03 pu;
- Power plant dispatch and terminal voltage at bus 2 = 450 MW and 1.05 pu;
- Power plant dispatch and terminal voltage at bus 3 = 533 MW and 1.03 pu;
- Power plant dispatch and terminal voltage at bus 4 = 150 MW and 1.01 pu;
- Load at bus 7 = 600 MW;
- Load at bus 9 = 1167 MW.

The electromechanical oscillation mode $-0.2493 + j3.9152$ was monitored, which presents damping factor of 6.35% and frequency of 3.9152 rad/s.

OLMO was executed and several events were applied in electrical grid, aiming to test the on-line monitoring of oscillations tool.

These events are described following:

1°) Modification in load at bus 9 to 1150 MW and dispatch at bus 3 to 515 MW, applied at 15.643 hours;

2°) Modification in dispatch at bus 1 to 690 MW and bus 3 to 523 MW, applied at 15.656 hours;

3°) Modification in dispatch at bus 1 to 680 MW and bus 3 to 532 MW, applied at 15.679 hours;

4°) Modification in terminal voltage at bus 2 to 1.03 pu and bus 4 to 1.03 pu, applied at 15.710 hours;

5°) Modification in load at bus 7 to 610 MW, dispatch at bus 1 to 690 MW and bus 3 to 533 MW, applied at 15.760 hours;

6°) Modification in load at bus 7 to 620 MW and dispatch at bus 3 to 543 MW, applied at 15.796 hours;

7°) Modification in terminal voltage at bus 1 to 1.04 pu and bus 3 to 1.04 pu, applied at 15.841 hours;

8°) Modification in load at bus 7 to 610 MW and dispatch at bus 3 to 533 MW, applied at 15.903 hours;

9°) Modification in load at bus 7 to 600 MW and dispatch at bus 3 to 523 MW, applied at 15.965 hours.

Figure 6.18 presents the mode frequency results obtained through the OLMO.

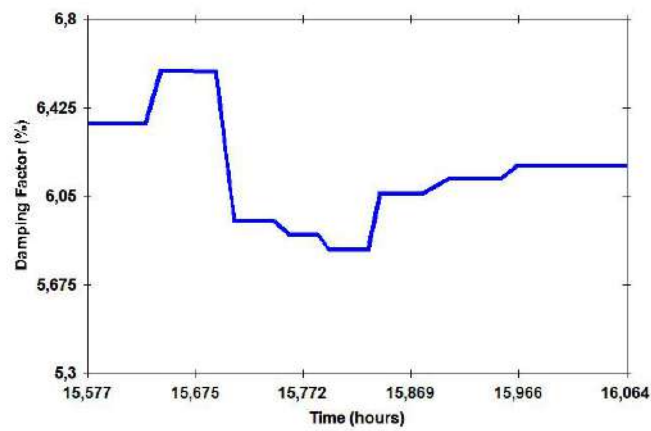


Figure 6.18: Mode damping factor timeline for Two areas system.

Figure 6.19 presents the mode damping factor results obtained through the OLMO.

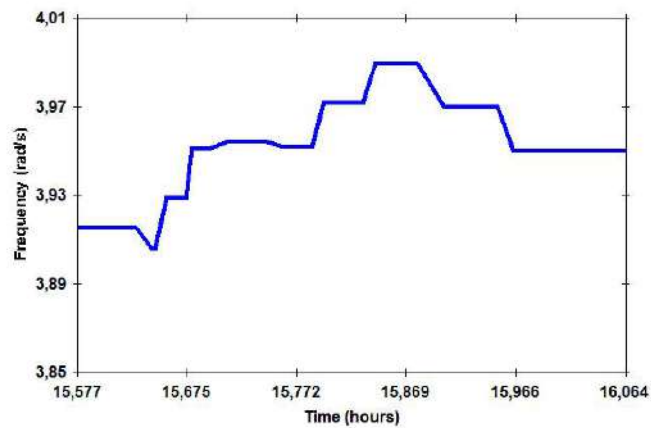


Figure 6.19: Mode frequency timeline for Two areas system.

The mode dynamic behavior can be observed in the results of the on-line monitoring of oscillations. If a problem is seen during OLMO, corrective measures should be used to improve system operation, through increasing mode damping factor.

Generation sensitivities were calculated for mode $-0.2493 + j3.9152$ and the results are presented in figure 6.20 and table 6.1.

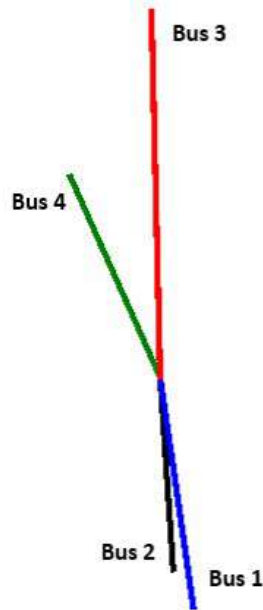


Figure 6.20: Normalized generation sensitivity phasors for Two areas system.

Table 6.1: Normalized generation sensitivity list for Two areas system.

Generator	Module	Phase
Bus 3	1.0000	91.3540
Bus 1	0.6340	-81.8740
Bus 4	0.6002	114.0800
Bus 2	0.5273	-86.1590

Two areas system presents 28 state variables in this test. The processing time for generation sensitivity calculation was around 1 second, using a processor Intel (R) Core (TM) i7-3537U CPU @ 2.00 GHz.

The CSBGRES method was used, in order to obtain a system security margins, through determining a minimum redispatch for all power plants capable of decreasing the mode damping factor from 6.35% to 5%.

Figure 6.21 and table 6.2 present the CSBGRES results for this case.

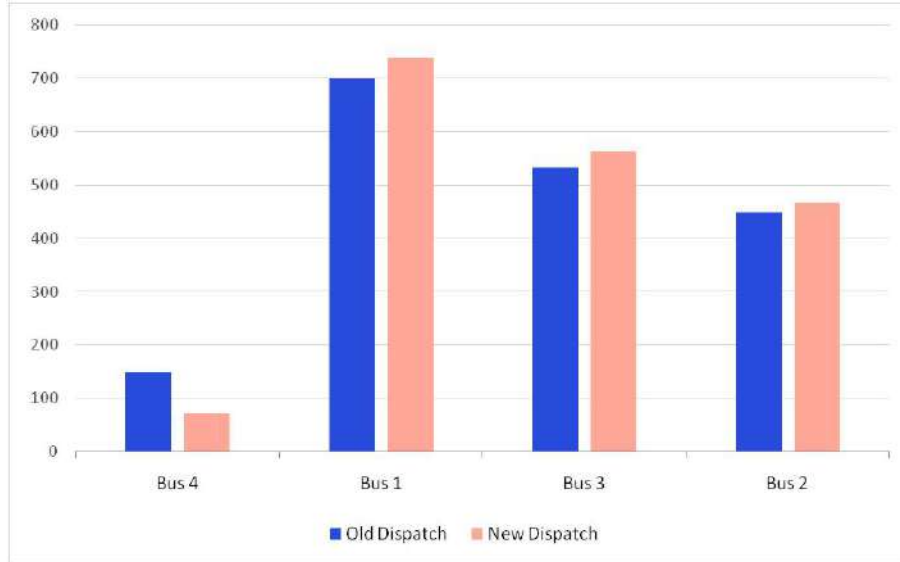


Figure 6.21: CSBGRES histogram (MW) to reach 5% of damping factor in Two areas system.

Table 6.2: CSBGRES redispatches (MW) to reach 5% of damping factor in Two areas system.

Generator	Old dispatch	New dispatch	Variation
Bus 4	150.0000	73.9690	-76.0310
Bus 1	700.0000	738.9400	38.9400
Bus 3	532.8000	563.9000	31.1000
Bus 2	450.0000	467.6300	17.6300

Then, CSBGRES method was used, in order to obtain a corrective measure for the system, through determining a minimum redispatch for all power plants capable of increasing the mode damping factor from 6.35% to 8%.

Figure 6.22 and table 6.3 present the CSBGRES results for this other case.

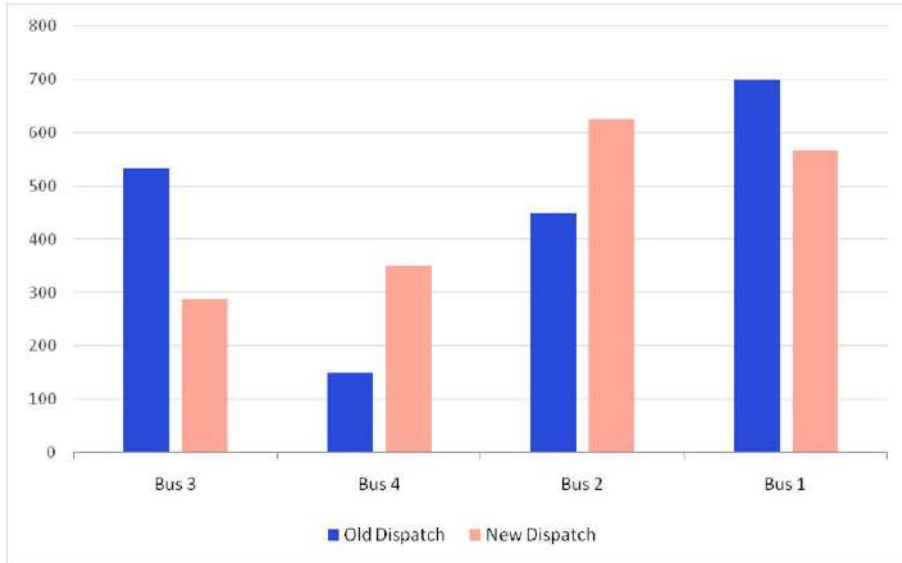


Figure 6.22: CSBGRES histogram (MW) to reach 8% of damping factor in Two areas system.

Table 6.3: CSBGRES redispatches (MW) to reach 8% of damping factor in Two areas system.

Generator	Old dispatch	New dispatch	Variation
Bus 3	532.8000	288.3500	-244.4500
Bus 4	150.0000	350.0000	200.0000
Bus 2	450.0000	625.8600	175.8600
Bus 1	700.0000	566.4600	-133.5400

The first CSBGRES application consists of determining security margins, obtaining the maximum power plant redispatches that can be used before the system presents oscillation problems.

In this case, the damping factor was decreased to 5% and mode $-0.1926 + j3.8090$ was obtained in 3 iterations, which presents 5.0495% of damping factor.

The second CSBGRES application consists of determining corrective measures, obtaining the minimum power plant redispatches that must be used to improve system dynamic behavior.

In this case, the damping factor was increased to 8% and mode $-0.2986 + j3.7527$ was obtained in 9 iterations, which presents 7.9311% of damping factor.

The CSBGRES results were tested and validated. The obtained modes does not have exact desired damping factor, because method tolerance is 0.1% and is used in damping factor converge verification.

The processing time for these CSBGRES applications to reach damping factors of 5% and of 8% were, respectively, around 1 second and around 2 seconds, using a processor Intel (R) Core (TM) i7-3537U CPU @ 2.00 GHz.

6.3 Brazilian Power System Results

Generation sensitivity calculation and CSBGRES method were tested in Brazilian power system (appendix C), using planning study data base of 2020 [58].

Figure 6.23 presents the single-line diagram of Brazilian power system [59].

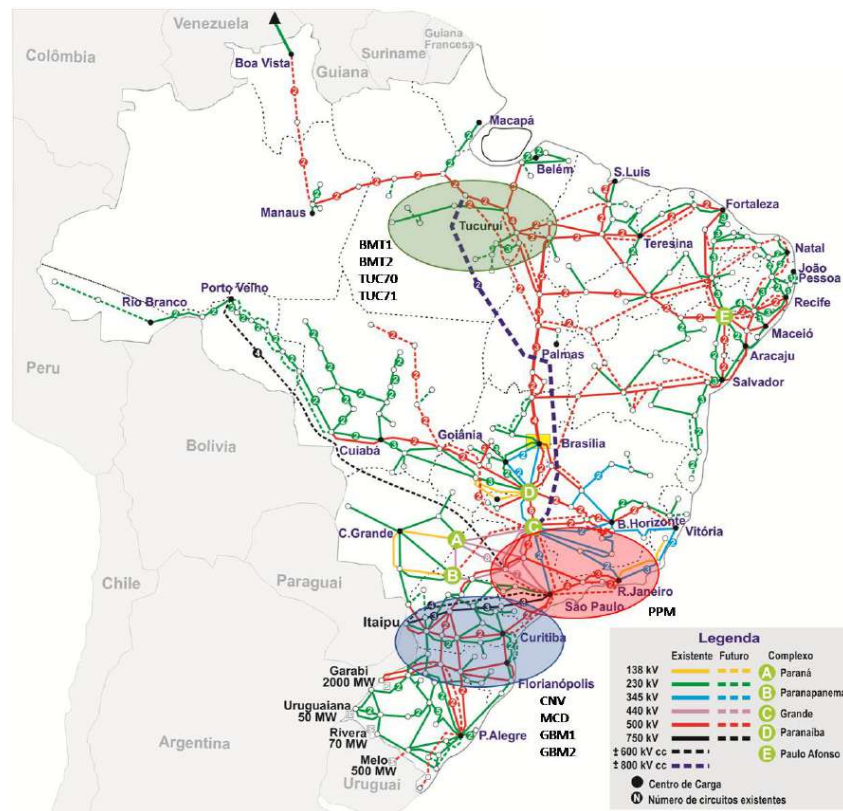


Figure 6.23: Brazilian power system single-line diagram.

Campos Novos (CNV), Machadinho (MCD), Governador Bento Munhoz (GBM1 and GBM2), Porto Primavera (PPM), Tucuruí (TUC70 and TUC71) and Belo Monte (BMT1 and BMT2) power plants are highlighted in figure 6.23, because they will be used to test the CSBGRES method.

The electromechanical oscillation mode $-0.0527 + j2.5482$, with 2% of damping factor, was obtained through using QR method [52, 53]. This mode represents the natural oscillation between North and South regions of Brazilian system.

CSBGRES method will be used to increase damping factor of this mode, but, first, the generation sensitivities must be utilized to select the better power plants for redispatch. The main results are presented in figure 6.24 and table 6.4.

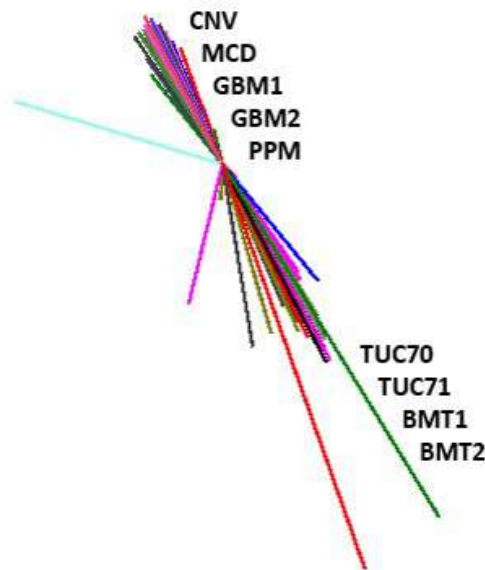


Figure 6.24: Normalized generation sensitivity phasors for Brazilian power system.

Table 6.4: Normalized generation sensitivity list for Brazilian power system.

Generator	Module	Phase
TUC71	0.4577	-60.6150
TUC70	0.4516	-60.6970
BMT1	0.4490	-62.9370
BMT2	0.4249	-62.9080
CNV	0.3593	116.4900
MCD	0.3464	118.7500
GBM1	0.3455	122.1100
PPM	0.3438	119.3800
GBM2	0.3384	121.8600

CNV, MCD, GBM1, GBM2, PPM, TUC70, TUC71, BMT1 and BMT2 are highlighted in the results, again, because they are the largest power plants with the highest generation sensitivities.

These machines were selected to be used in CSBGRES method, through evaluating their generation sensitivities in comparison with the other plants.

Brazilian power system presents 7868 state variables in this test. The processing time for generation sensitivity calculation was around 18 minutes, using a processor Intel (R) Core (TM) i7-3537U CPU @ 2.00 GHz.

The CSBGRES method was used, in order to obtain a corrective measure for the system, through determining a minimum redispatch for selected power plants capable of increasing the mode damping factor from 2% to 5%.

Figure 6.25 and table 6.5 present the CSBGRES results for redispatch the power plants of interest in this case.

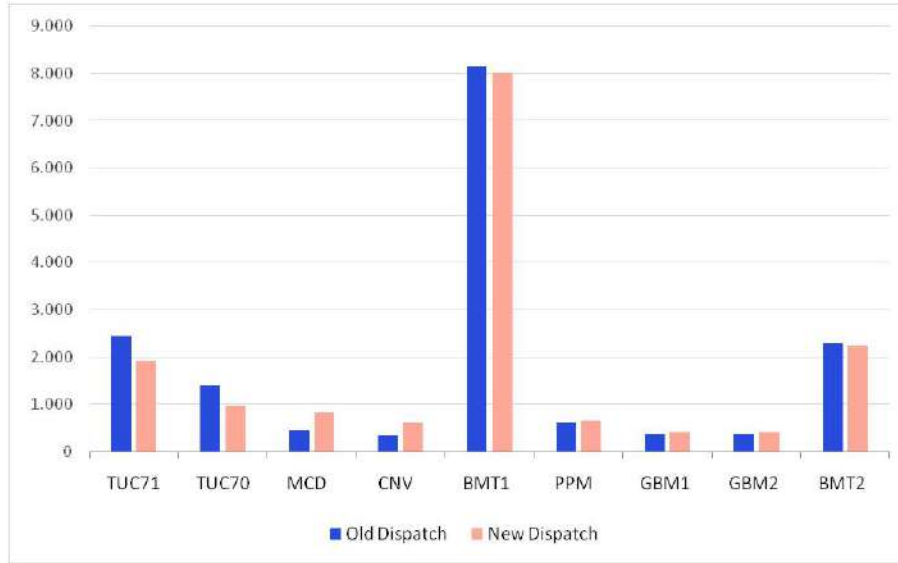


Figure 6.25: CSBGRES histogram (MW) to reach 5% of damping factor in Brazilian power system.

Table 6.5: CSBGRES redispatches (MW) to reach 5% of damping factor in Brazilian power system.

Generator	Old dispatch	New dispatch	Variation
TUC71	2460.0000	1930.7000	-529.3000
TUC70	1406.0000	987.1400	-418.8600
MCD	468.5000	837.0000	368.5000
CNV	364.2000	622.0000	257.8000
BMT1	8151.0000	8014.5000	-136.5000
PPM	616.0000	672.0000	56.0000
GBM1	376.6500	419.0000	42.3500
GBM2	376.6500	419.0000	42.3500
BMT2	2299.0000	2260.5000	-38.5000

Loss variation was -356.16 MW and was considered in the redispatches of selected power plants. The system losses decreased, because the new dispatches are relieving the North-South interconnection.

The CSBGRES results show redispaches needed to achieve the damping factor of 5% for the North-South oscillation mode. The mode $-0.1351 + j2.6886$ was obtained in 16 iterations, which presents 5.0186% of damping factor.

The processing time for the CSBGRES execution was around 1 minute, using a processor Intel (R) Core (TM) i7-3537U CPU @ 2.00 GHz.

6.4 Nordic 44 System Results

Generation sensitivity calculation, CSBGRES method and OLMO were tested, again, in a Nordic equivalent system, called Nordic 44 (appendix D), containing about 44 buses and 18 machines [60].

Figure 6.26 presents the single-line diagram of Nordic 44 system [60], showing interconnections between Norway, Sweden and Finland.

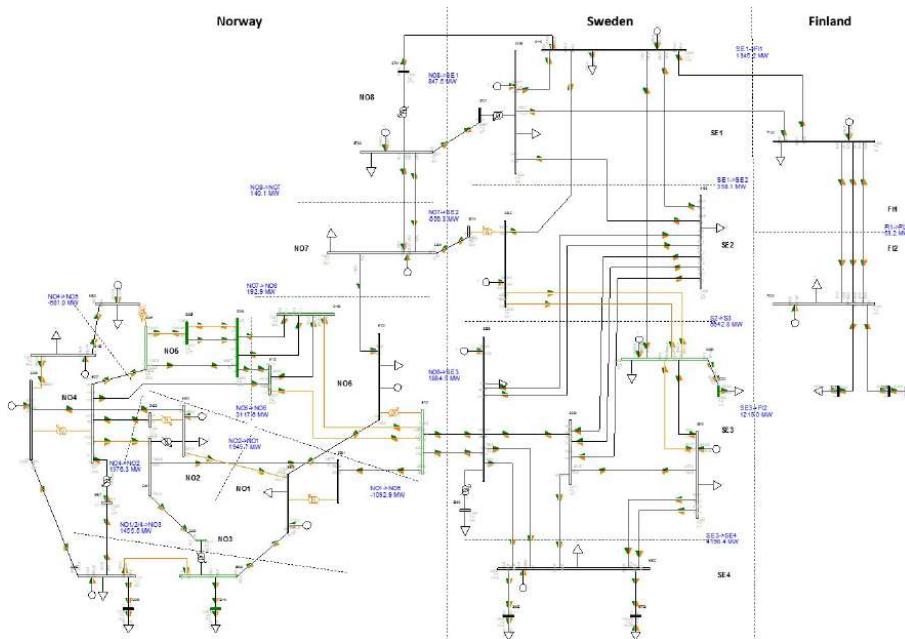


Figure 6.26: Nordic 44 system single-line diagram.

The generation sensitivities were calculated for the inter-area oscillation mode $-0.1021 + j2.0400$, which is the lower damped mode of the system. These results are presented in figure 6.27 and table 6.6.

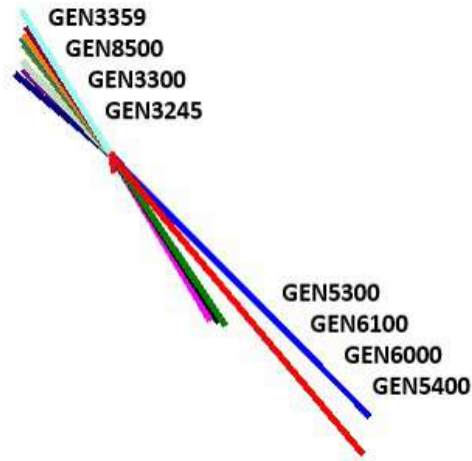


Figure 6.27: Normalized generation sensitivity phasors for Nordic 44 system.

Table 6.6: Normalized generation sensitivity list for Nordic 44 system.

Generator	Module	Phase
GEN5300	1.0000	-49.9100
GEN6100	0.9383	-45.2760
GEN6000	0.5193	-56.2070
GEN5400	0.5035	-57.3040
GEN5600	0.4871	-59.1980
GEN3359	0.4369	121.8500
GEN8500	0.3930	123.6100
GEN3300	0.3791	126.0500
GEN3245	0.3769	127.4300
GEN6500	0.3595	128.5700
GEN3000	0.3546	127.0900
GEN6700	0.3290	133.4300
GEN7000	0.3206	139.8100
GEN3115	0.3189	133.9300
GEN3249	0.3136	135.7000
GEN7100	0.2993	137.6200
GEN5100	0.1595	126.5700
GEN5500	0.0354	-83.7440

These results show the mode displacement trend in complex plane in function of power plant dispatches.

Nordic 44 system presents 224 state variables in this test. The processing time for generation sensitivity calculation was around 3 seconds, using a processor Intel (R) Core (TM) i7-3537U CPU @ 2.00 GHz.

The CSBGRES method was used, in order to obtain a corrective measure for the system, through determining a minimum redispatch for all power plants capable of increasing the mode damping factor from 5% to 8%.

Figure 6.28 and table 6.7 present the CSBGRES results for redispatch all system power plants in this case.

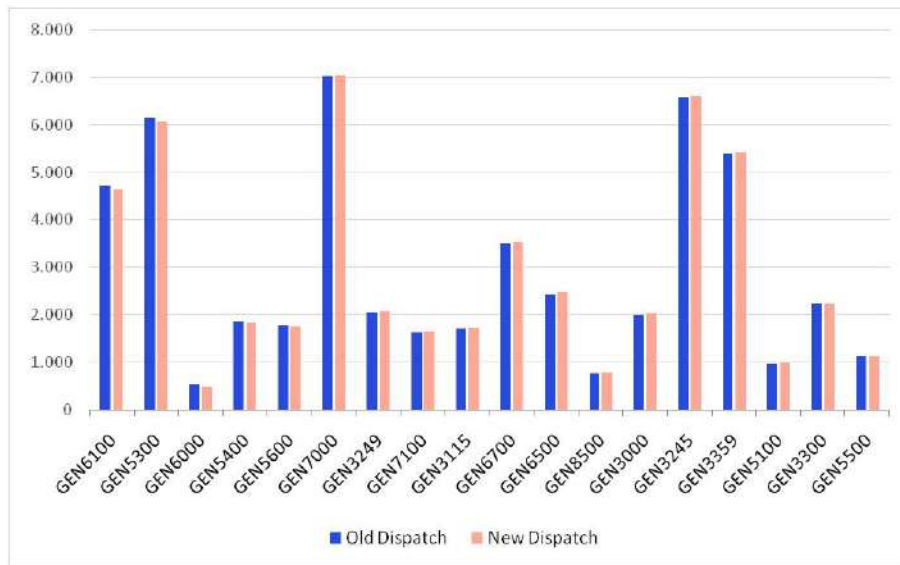


Figure 6.28: CSBGRES histogram (MW) to reach 8% of damping factor in Nordic 44 system.

Table 6.7: CSBGRES redispatches (MW) to reach 8% of damping factor in Nordic 44 system.

Generator	Old dispatch	New dispatch	Variation
GEN6100	4730.0000	4638.0000	-92.0000
GEN5300	6151.0000	6062.0000	-89.0000
GEN6000	523.0000	483.2200	-39.7800
GEN5400	1858.0000	1819.9000	-38.1000
GEN5600	1774.0000	1738.7000	-35.3000
GEN7000	7038.0000	7063.8000	25.8000
GEN3249	2048.0000	2073.1000	25.1000
GEN7100	1620.0000	1645.0000	25.0000
GEN3115	1700.0000	1724.7000	24.7000
GEN6700	3506.0000	3530.5000	24.5000
GEN6500	2442.0000	2466.1000	24.1000
GEN8500	754.0000	777.3700	23.3700
GEN3000	2000.0000	2022.9000	22.9000
GEN3245	6599.0000	6621.8000	22.8000
GEN3359	5400.0000	5422.7000	22.7000
GEN5100	972.0000	980.2500	8.2500
GEN3300	2223.9000	2232.0000	8.1000
GEN5500	1132.0000	1128.0000	-4.0000

The CSBGRES results show redispatches needed to achieve the damping factor of 8% for the inter-area oscillation mode. The mode $-0.1690 + j2.1233$ was obtained in 7 iterations, which presents 7.9359% of damping factor.

The processing time for the CSBGRES execution was around 4 seconds, using a processor Intel (R) Core (TM) i7-3537U CPU @ 2.00 GHz.

Then, the on-line monitoring of oscillations tool was tested in the Nordic 44 system. The CSBGRES method was used to keep the system modes with, at least, 5% of minimum damping factor, during the OLMO execution.

The inter-area oscillation modes $-0.3750 + j3.7519$, with 10% of damping factor, and $-0.1021 + j2.0400$, with 5% of damping factor, obtained in first operating point, were monitored in the OLMO.

Real Nordic electrical system measurement data were utilized to create several operation scenarios for Nordic 44 system.

These scenarios were being sent to software PacDyn [8], during the OLMO execution, in a regular time interval, to simulate a system real-time operation.

Figure 6.29 presents mode damping factor timelines obtained through OLMO.

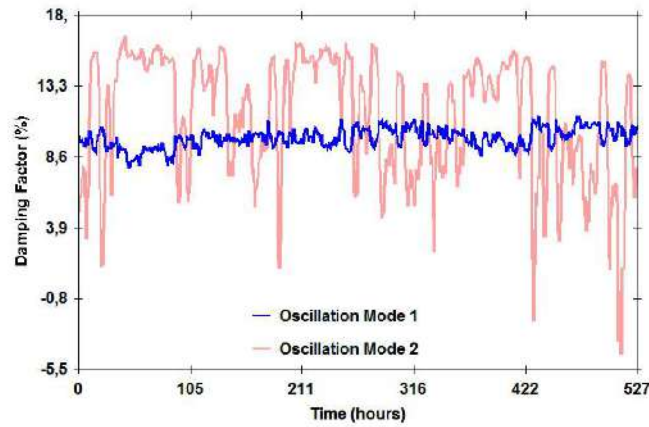


Figure 6.29: Mode damping factor timelines for Nordic 44 system.

Figure 6.30 presents mode frequency timelines obtained through OLMO.

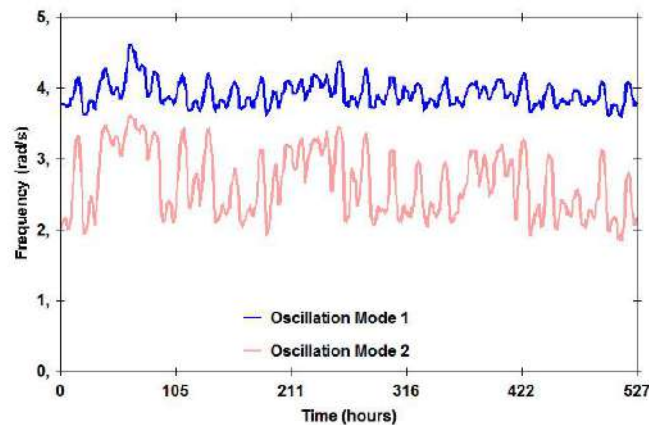


Figure 6.30: Mode frequency timelines for Nordic 44 system.

System oscillation mode 2 presented undesired damping factors (lower than the desired value of 5%) in some operating points.

The CSBGRES method can be used to solve this oscillation problem, determining a minimum redispatch for the power system, so mode 2 can present 5% of damping factor in the critical scenarios.

Figure 6.31 presents mode damping factor timelines obtained through OLMO.

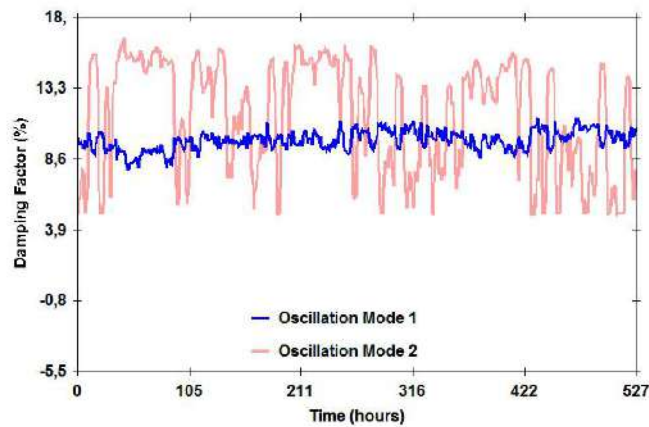


Figure 6.31: Mode damping factor timelines for Nordic 44 system, using CSBGRES method.

Figure 6.32 presents mode frequency timelines obtained through OLMO.

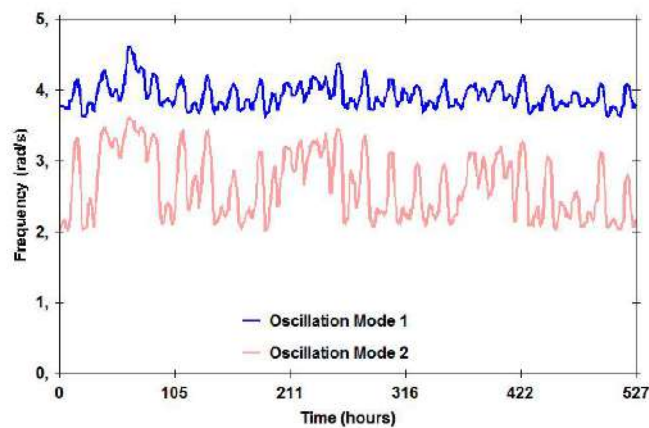


Figure 6.32: Mode frequency timelines for Nordic 44 system, using CSBGRES method.

A comparison between original and CSBGRES results for mode 2, during the OLMO execution, is presented in 6.33.

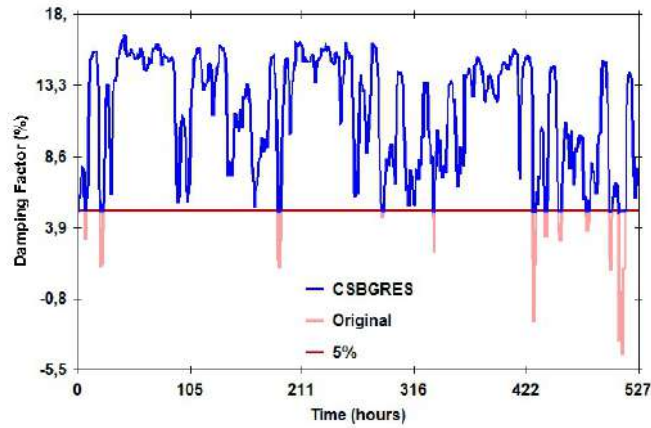


Figure 6.33: OLMO results with and without utilization of CSBGRES method.

Power plant redispatches determined through CSBGRES method was able to solve the problem observed in the OLMO, keeping the system oscillation modes with, at least, 5% of damping factor, during all the monitoring.

The worst scenario obtained in the OLMO presented -4.5% of damping factor for oscillation mode 2. The CSBGRES results for this operating point can be observed in figure 6.34 and table 6.8.

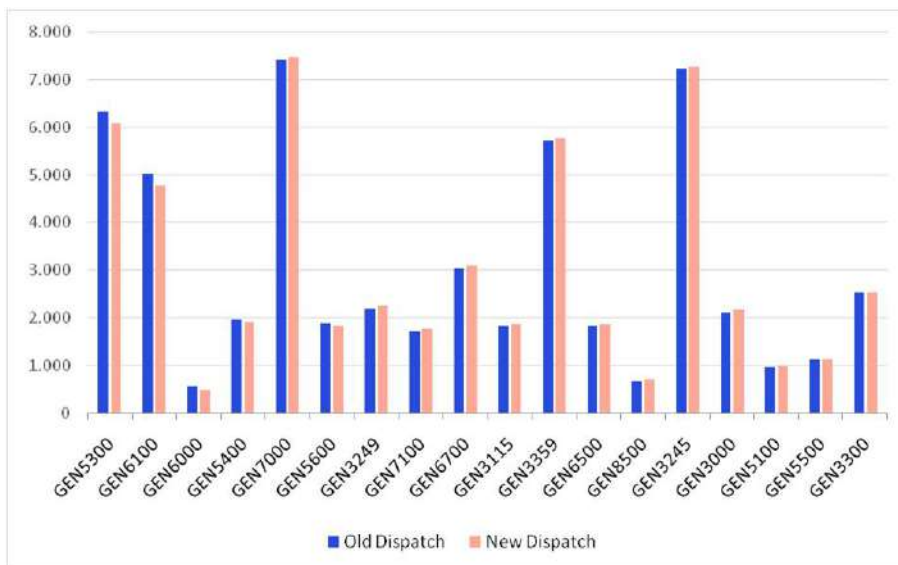


Figure 6.34: CSBGRES histogram (MW) to reach 5% of damping factor in Nordic 44 system in worst scenario.

Table 6.8: CSBGRES redispatches (MW) to reach 5% of damping factor in Nordic 44 system in worst scenario.

Generator	Old dispatch	New dispatch	Variation
GEN5300	6326.0000	6081.2000	-244.8000
GEN6100	5022.3000	4785.4000	-236.9000
GEN6000	555.3200	486.1900	-69.1300
GEN5400	1972.8000	1907.9000	-64.9000
GEN7000	7416.8000	7472.7000	55.9000
GEN5600	1883.6000	1828.1000	-55.5000
GEN3249	2196.6000	2249.9000	53.3000
GEN7100	1707.2000	1760.2000	53.0000
GEN6700	3034.0000	3086.7000	52.7000
GEN3115	1823.4000	1875.9000	52.5000
GEN3359	5722.1000	5774.3000	52.2000
GEN6500	1827.3000	1878.7000	51.4000
GEN8500	661.0000	711.5100	50.5100
GEN3245	7229.0000	7278.3000	49.3000
GEN3000	2119.3000	2168.1000	48.8000
GEN5100	961.8400	993.8700	32.0300
GEN5500	1120.2000	1129.2000	9.0000
GEN3300	2537.7000	2537.7000	0.0000

Small redispatches were capable of modifying considerably the damping factor of the mode of interest. The largest dispatch variation obtained through CSBGRES method was, approximately, 250 MW for power plant GEN5300.

This plant was dispatching 6000 MW. Thus, 250 MW is a reasonable and feasible value for the redispatch of this specific machine.

The CSBGRES results show redispatches needed to achieve the damping factor of 5% for the mode 2. The mode $-0.1005 + j2.0300$ was obtained in 19 iterations, which presents 4.9436% of damping factor.

The processing time for this CSBGRES execution was around 7 seconds, using a processor Intel (R) Core (TM) i7-3537U CPU @ 2.00 GHz.

6.5 Final Considerations

SAGE system was used to test the damping nomogram method, which was able to determine the small-signal security regions.

Two areas system was utilized to test the on-line monitoring of oscillations, generation sensitivity calculation and CSBGRES method.

Brazilian power system was used to test the generation sensitivity calculation and CSBGRES method in a large-scale power system.

Nordic 44 system was utilized to test the generation sensitivity calculation and CSBGRES method during an OLMO execution.

The results obtained in this chapter evidence benefits brought by the methods developed in this thesis for power system analysis.

Chapter 7

Conclusion

This chapter will review the main topics covered by this thesis, which are related to power systems security assessment, focusing on SSA. Conclusions will be made, in order to show the benefits brought by the application of the methods proposed in this work for power system analyses.

7.1 Considerations

Power flow, fault and electromechanical stability analyses should be done for power system planning and operation and were described in chapter 1.

The research motivations and thesis contributions were presented. This work focused on SSA and development of CSBGRES method.

The thesis structure with chapter descriptions and lists of produced papers were also presented, finishing chapter 1.

Power system electromechanical stability was described in chapter 2. The transient and small-signal stability analyses were reviewed.

Then, modal analysis principles were presented, including the concepts of eigenvalues, eigenvectors, participation factors, mode shapes, controllability, observability and transfer functions residues.

Control system design was discussed, including a methodology for control tuning based on Nyquist diagrams, finishing chapter 2.

Power system security assessment state of art was described in chapter 3, including a VSA, TSA and SSA literature review.

Critical contingencies and several scenarios should be evaluated in the determination of power system security margins.

Chapter 3 is finished with a discussion about SDSA results, which can be observed through security indexes or nomograms.

The main concepts of voltage, transient and small-signal security assessment were described in chapter 4, focusing on SSA.

Damping nomogram method (DNM), root-locus method (RLM) and on-line monitoring of oscillations (OLMO) were proposed for SSA execution.

The computational implementations of DNM and OLMO in software PacDyn [8], from CEPEL, were presented, finishing chapter 4.

Hopf bifurcation analysis and the closest security boundary in control parameter space algorithm were reviewed in chapter 5.

A generation sensitivity calculation was developed. These sensitivities show mode displacement trend in complex plane in function of power plant dispatches.

The CSBGRES method was presented, which can be used to obtain minimum redispatch considering a damping factor criteria, finishing chapter 5.

In chapter 6, four systems were used to test the proposed methods: SAGE system, Two areas system, Brazilian power system and Nordic 44 system.

The results obtained in these tests evidence the benefits brought by the methods developed in this thesis for power system analysis.

7.2 Conclusions

The damping nomogram method (DNM), root-locus method (RLM) and on-line monitoring of oscillations (OLMO) were developed in this work for small-signal security assessment (SSA) of power systems.

A numerical generation sensitivity calculation and the CSBGRES method were developed and presented in this thesis.

This method can be used for determining minimum redispatch for power systems, considering a desired damping factor for oscillation modes.

The main innovations and contributions of this thesis are:

- Damping nomogram method development, which can be used to determine small-signal security regions;
- On-line monitoring of oscillations development, which can be utilized to monitor small-signal stability;
- Numerical generation sensitivity calculation, which can be used to select power plants for being utilized in the CSBGRES method;
- CSBGRES method development, which can be used to determine a minimum redispatch for electrical power systems capable of making a oscillation mode presents a desired damping factor.

Small-signal stability margins and security levels can be determined through using the methods proposed in this work, which facilitate the determination of corrective measures to improve power system dynamic behavior.

Corrective measures can be related to control system tuning or power plant redispatch. This last can be obtained through using the CSBGRES method, which was developed in this thesis.

Concluding, the methods and methodologies proposed in this work and implemented in software PacDyn [8] contribute greatly to small-signal security assessment of power systems, enabling a better planning and operation.

7.3 Future Works

The following future works can be proposed:

- Improvement of the methods proposed in this work, through using parallel processing and other techniques, in order to increase algorithm efficiency;
- Development of CSBGRES method extension, in order to consider loading limits for the equipment of power systems;
- Development of methods based on CSBGRES algorithm, considering variation of other power flow parameters, such as terminal voltages or bus loads.

References

- [1] MONTICELLI, A. J. *Fluxo de Carga em Redes de Energia Elétrica*. 1 ed. São Paulo, Edgard Blucher Ltda, 1983.
- [2] ANDERSON, P. M. *Analysis of Faulted Power Systems*. 1 ed. New York, Wiley-IEEE press, 1995.
- [3] STEVENSON, W. D., GRAINGER, J. J. *Power System Analysis*. 4 ed. New York, McGraw-Hill, 1994.
- [4] KUNDUR, P. *Power System Stability and Control*. 4 ed. New York, McGraw-Hill, 1994.
- [5] CEPEL. *ANAREDE - Programa de Análise de Redes Elétricas - Versão 10.1.3*. Manual do usuário, Rio de Janeiro, Rio de Janeiro, Brazil, 2016.
- [6] CEPEL. *ANAFAS - Programa de Análise de Faltas Simultâneas - Versão 6.5.1*. Manual do usuário, Rio de Janeiro, Rio de Janeiro, Brazil, 2014.
- [7] CEPEL. *ANATEM - Programa de Análise Transitórios Eletromecânicos - Versão 11.1.0*. Manual do usuário, Rio de Janeiro, Rio de Janeiro, Brazil, 2016.
- [8] CEPEL. *PacDyn - Program of Small-signal Stability Analysis and Control - Version 9.8.3*. User's manual, Rio de Janeiro, Rio de Janeiro, Brazil, 2017.
- [9] MORISON, K., WANG, L., KUNDUR, P. "Power System Security Assessment", *IEEE Power and Energy Magazine*, v. 2, n. 5, pp. 30–39, october, 2004.
- [10] EJEBE, G. C., JING, C., WAIGHT, J. G., et al. "Online Dynamic Security Assessment in an EMS", *IEEE Computer Applications in Power*, v. 11, n. 1, pp. 43–47, january, 1998.
- [11] VAAHEDI, E., MANSOUR, Y., TSE, E. K. "A General Purpose Method for On-line Dynamic Security Assessment", *IEEE Transactions on Power Systems*, v. 13, n. 1, pp. 243–249, february, 1998.

- [12] ALVES, F. R. M., HENRIQUES, R. M., PASSOS FILHO, J. A., et al. “Ferramenta Integrada para Avaliação de Segurança Estática e Dinâmica de Sistemas Elétricos de Potência de Grande Porte”, *XII Simpósio de Especialistas em Planejamento da Operação e Expansão Elétrica - SEPOPE*, may, 2012.
- [13] HENRIQUES, R. M., ALVES, F. R. M., PASSOS FILHO, J. A., et al. “Melhorias da Avaliação de Segurança de Sistemas Elétricos Através da Representação Detalhada de Equipamentos e Monitoração do Amortecimento de Oscilações”, *XXII Seminário Nacional de Produção e Transmissão de Energia Elétrica - SNPTEE*, october, 2013.
- [14] MORISON, K., HAMADANIZADEH, H., WANG, L. “Dynamic Security Assessment Tools”, *IEEE Power Engineering Society Summer Meeting*, v. 1, pp. 282–286, july, 1999.
- [15] KERIN, U., BALAURESCU, R., LAZAR, F., et al. “Dynamic Security Assessment in System Operation and Planning - First Experiences”, *IEEE Power and Energy Society General Meeting*, pp. 1–6, july, 2012.
- [16] WANG, L., HOWELL, F., KUNDUR, P., et al. “A Tool for Small-signal Security Assessment of Power Systems”, *IEEE International Conference on Power Industry Computer Applications*, pp. 246–252, may, 2001.
- [17] KERIN, U., TRINH, N. T., LERCH, E., et al. “Small Signal Security Index for Contingency Classification in Dynamic Security Assessment”, *IEEE Trondheim PowerTech*, pp. 1–6, june, 2011.
- [18] GOMES JUNIOR, S. *Modelagem e Métodos Numéricos para Análise Linear de Estabilidade Eletromecânica, Ressonância Subsíncrona, Transitórios Eletromagnéticos e Desempenho Harmônico de Sistemas de Potência*. D.Sc. thesis, COPPE/UFRJ, Rio de Janeiro, Rio de Janeiro, Brazil, 2002.
- [19] GOMES JUNIOR, S., MARTINS, N., PORTELA, C. “Computing Small-signal Stability Boundaries for Large-scale Power Systems”, *IEEE Transactions on Power Systems*, v. 18, n. 2, pp. 747–752, may, 2003.
- [20] GOMES JUNIOR, S., MARTINS, N., PARREIRAS, T. J. M. A. “Computing the Closest Small-signal Security Boundary in the Control Parameter Space for Large Scale Power Systems”, *Electric Power Systems Research*, v. 149, pp. 10–18, august, 2017.
- [21] ALVARADO, F., DOBSON, I., HU, Y. “Computation of Closest Bifurcation in Power Systems”, *IEEE Transactions on Power Systems*, v. 9, n. 2, pp. 918–928, may, 1994.

- [22] ALVARADO, F. “Bifurcations in Nonlinear Systems: Computational Issues”, *Proceedings of ISCAS Conference*, may, 1990.
- [23] HILL, D. “Nonlinear Computational and Control for Small Disturbance Stability”, *Proceedings of IEEE Summer Meeting*, july, 2000.
- [24] SEYDEL, R. *From Equilibrium to Chaos: Practical Bifurcation and Stability Analysis*. 2 ed. New York, Elsevier Science Publishing Co, 1988.
- [25] AJJARAPU, V., LEE, B. “Bifurcation Theory and its Application to Nonlinear Dynamical Phenomena in an Electrical Power System”, *IEEE Transactions on Power Systems*, v. 7, n. 1, pp. 424–431, february, 1992.
- [26] KIM, K., SCHATTLER, H., VENKATASUBRAMANIAN, V., et al. “Methods for Calculating Oscillations in Large Power Systems”, *IEEE Transactions on Power Systems*, v. 12, n. 4, pp. 1639–1648, november, 1997.
- [27] YANG, D., AJJARAPU, V. “Critical Eigenvalues Tracing for Power System Analysis via Continuation of Invariant Subspaces and Projected Arnold Method”, *IEEE Transactions on Power Systems*, v. 22, n. 1, pp. 324–332, february, 2007.
- [28] LI, C., DU, Z. “A Novel Method for Computing Small-signal Stability Boundaries of Large-scale Power Systems”, *IEEE Transactions on Power Systems*, v. 28, n. 2, pp. 877–883, may, 2013.
- [29] SARIC, A. T., STANKOVIC, A. M. “Dynamic Voltage Stability Assessment in Large Power Systems with Topology Control Actions”, *IEEE Transactions on Power Systems*, v. 31, n. 4, pp. 2892–2902, july, 2016.
- [30] REVEL, G., LEON, A. E., ALONSO, D. M., et al. “Bifurcation Analysis on a Multimachine Power System Model”, *IEEE Transactions on Circuits and Systems I: Regular Papers*, v. 57, n. 4, pp. 937–949, april, 2010.
- [31] LERM, A. A. P., SILVA, A. S. “Avoid Hopf Bifurcations in Power Systems via Set-points Tuning”, *IEEE Transactions on Power Systems*, v. 19, n. 2, pp. 1076–1084, may, 2004.
- [32] PHADKE, A. R., FOZDAR, M., NIAZI, K. R., et al. “New Technique for Computation of Closest Hopf Bifurcation Point Using Real-coded Genetic Algorithm”, *IET Generation, Transmission and Distribution*, v. 5, n. 1, pp. 11–18, february, 2011.


- [33] ZECEVIC, A. I., MILJKOVIC, D. M. “The Effects of Generation Redispatch on Hopf Bifurcations in Electric Power Systems”, *IEEE Transactions on Circuits and Systems I: Fundamental Theory and Applications*, v. 49, n. 8, pp. 1180–1186, august, 2002.
- [34] PARREIRAS, T. J. M. A. *Metodologia e Implementação Computacional para Análise da Estabilidade a Pequenos Sinais em Múltiplos Cenários*. M.Sc. dissertation, COPPE/UFRJ, Rio de Janeiro, Rio de Janeiro, Brazil, 2012.
- [35] KUNDUR, P., PASERBA, J., AJJARAPU, V., et al. “Definition and Classification of Power System Stability”, *IEEE Transactions on Power Systems*, v. 19, n. 2, pp. 1387–1401, june, 2004.
- [36] CORTEZ, A. N. *Proposta de Critério e Procedimentos para a Avaliação de Estabilidade de Tensão em Sistemas Elétricos de Potência*. M.Sc. dissertation, UFMG, Belo Horizonte, Minas Gerais, Brazil, 2001.
- [37] SILVA, R. R. *Análise Dinâmica Frente a Pequenas e Grandes Perturbações do Sistema Elétrico Acre-Rondônia*. M.Sc. dissertation, COPPE/UFRJ, Rio de Janeiro, Rio de Janeiro, Brazil, 2011.
- [38] SEVILLANO, J. E. V. *Análise Modal no Sistema Elétrico Peruano*. M.Sc. dissertation, COPPE/UFRJ, Rio de Janeiro, Rio de Janeiro, Brazil, 2005.
- [39] CHEN, C. T. *Linear System Theory and Design*. 2 ed. New York, CBS College Publishing, 1984.
- [40] OGATA, K. *Engenharia de Controle Moderno*. 4 ed. New York, Prentice Hall, 2003.
- [41] GUIMARAES, C. H. C., TARANTO, G. N., GOMES JUNIOR, S., et al. “Projeto de Estabilizadores de Sistemas de Potência por Posicionamento Parcial de Par de Pólos Complexos Conjugados”, *XIII Congresso Brasileiro de Automática - CBA*, september, 2000.
- [42] GOMES JUNIOR, S., MARTINS, N., PINTO, H. J. C. P. “Utilização do Método de Nyquist para a Estabilização de Sistemas de Potência Envolvendo Alocação de Par de Pólos Complexos”, *XII Congresso Brasileiro de Automática - CBA*, september, 1998.
- [43] HAUER, J. F., DEMEURE, C. J., SCHARF, L. L. “Initial Results in Prony Analysis of Power System Response Signals”, *IEEE Transactions on Power Systems*, v. 5, n. 1, pp. 80–89, february, 1990.

- [44] ASSIS, T. M. L. *Cálculo da Capacidade de Transmissão Dinâmica em Sistemas de Potência Através de Ferramentas Integradas e Sistemas Inteligentes*. D.Sc. thesis, COPPE/UFRJ, Rio de Janeiro, Rio de Janeiro, Brazil, 2007.
- [45] XUE, Y., VAN CUSTEM, T., RIBBENS-PAVELA, M. “Extended Equal Area Criterion Justifications, Generalizations, Applications”, *IEEE Transactions on Power Systems*, v. 4, n. 1, pp. 44–52, february, 1989.
- [46] ASSIS, T. M. L., KUENZEL, S., PAL, B. C. “Impact of Multi-terminal HVDC Grids on Enhancing Dynamic Power Transfer Capability”, *IEEE Transactions on Power Systems*, v. 32, n. 4, pp. 2652–2662, july, 2017.
- [47] PARREIRAS, T. J. M. A., GOMES JUNIOR, S., TARANTO, G. N., et al. “Avaliação de Segurança a Pequenos Sinais de Sistemas de Potência com o PacDyn”, *XXIII Seminário Nacional de Produção e Transmissão de Energia Elétrica - SNPTEE*, october, 2015.
- [48] PARREIRAS, T. J. M. A., GOMES JUNIOR, S., TARANTO, G. N. “Damping Nomogram Method for Small-signal Security Assessment of Power Systems”, *IEEE Latin America Transactions*, v. 15, n. 5, pp. 877–883, may, 2017.
- [49] GOMES JUNIOR, S., AMARAL, T. S., PARREIRAS, T. J. M. A. “Avaliação do Amortecimento de Oscilações Eletromecânicas no PacDyn Utilizando Lugar das Raízes com Variações no Fluxo de Potência”, *XXIII Seminário Nacional de Produção e Transmissão de Energia Elétrica - SNPTEE*, october, 2015.
- [50] HUANG, X., LIU, J., LIU, Y., et al. “A GA Based Optimized PMU-location-decision Algorithm Considering WAMS Reliability”, *IEEE International Conference on Power System Technology*, pp. 433–439, october, 2014.
- [51] KHAITAN, S. K., GUPTA, A. *High Performance Computing in Power and Energy Systems*. Springer, 2013.
- [52] FRANCIS, J. G. “The QR Transformation a Unitary Analogue to the LR Transformation - Part 1”, *The Computer Journal*, v. 4, n. 3, pp. 265–271, october, 1961.
- [53] FRANCIS, J. G. “The QR Transformation - Part 2”, *The Computer Journal*, v. 4, n. 4, pp. 332–345, january, 1962.
- [54] MARTINS, N. “The Dominant Pole Spectrum Eigensolver for Power System Stability Analysis”, *IEEE Transactions on Power Systems*, v. 12, n. 1, pp. 245–254, february, 1997.

- [55] CEPEL. *SAGE - Sistema de Gerenciamento Aberto de Energia*. Site: www.sage.cepel.br.
- [56] GUHLE, B. D., COSTA, M. R., BORGES, C. L. T., et al. “Integração de uma Ferramenta VSA/DSA ao EMS SAGE”, *XXIII Seminário Nacional de Produção e Transmissão de Energia Elétrica - SNPTEE*, october, 2015.
- [57] GOMES JUNIOR, S., CASTRO, A., PARREIRAS, T. J. M. A. “Integração entre o PacDyn e ANATEM para Estudos Dinâmicos de Sistemas Elétricos”, *XX Seminário Nacional de Produção e Transmissão de Energia Elétrica - SNPTEE*, november, 2009.
- [58] EPE. *Plano Decenal 2022 - Base de Dados de Dinâmica - Ano de 2020*. Site: www.epe.gov.br.
- [59] ONS. *Mapas do Sistema Interligado Nacional - Horizonte de 2015*. Site: www.ons.org.br.
- [60] HAMRE, S. M. *Inertia and FCR in the Present and Future Nordic Power System*. M.Sc. dissertation, NTNU, Trondheim, Sor-Trondelag, Norway, 2015.

Appendix A

SAGE System

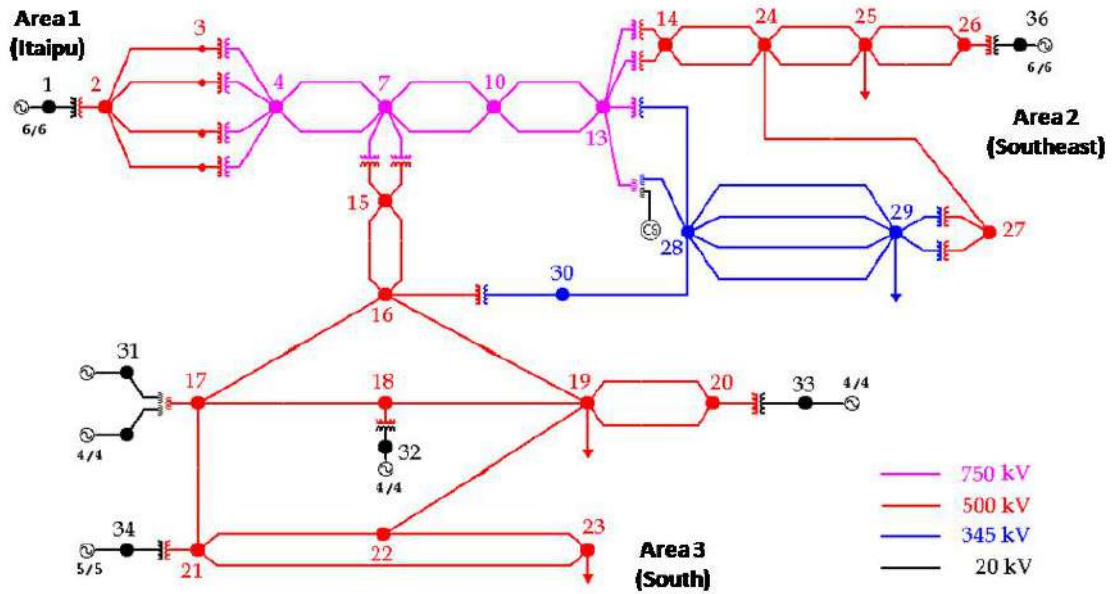

A.1 Power Flow Data File

```

TITU
16-01-15 12:15:02 - Dados de entrada do Anarede - Resdespachado - Todas
DOPC IMPR
NEWT L RCVG L RMON L MFCT L
99999
DCTE
BASE 100. DASE 100. TEPA .01 EXST .4 TETP 5. TRPA 5.
TLPP 1. TEPR .01 QLST .4 TLPR 1. TLPQ 2. TSBZ .01
TSBA 5. ASTP .05 VSTP 5. TLVC .5 TLTC .01 TSEF .1E-7
ZMAX 500. TLPV .5 VDVM 200. VDVN 40. TUDC .001 TADC .01
PGER 30. TPST .2 VFLD 70. ZMIN .001 HIST 470 LFIT 10
ACIT 200 LFCV 1 DCIT 10 VSIT 10 LPIT 50 LFLP 10
PDIT 10 LCRT 96 LPRT 60 CSTP 5. ASDC 1.
ICIT 9000 DMAX 5 FDIV 2. ICMN .1 VART 5. TSTP 33
ICMV .5 APAS 90. CPAR 70. VAVT 2. VAVF 5. VMVF 15.
VPVT 2. VPVF 5. VPMF 10. VSVF 20. VINP 1. VSUP 1.
TLSI 0. NDIR 10. STTR 1. TRPT 100. STIR 10. BFPO 1.
99999
DBAR
1 L2G1EST01A 1 992 0.457.816.99-727.441.6 1 992
2 L1G1EST01B 1 992.019 460.17.13-727.441.6 1 992
3 L1G1EST01C 1 992.019 460.17.13-727.441.6 1 992
4 L1G1EST01D 1 992.019 460.17.13-727.441.6 1 992
5 L1G1EST01E 1 992.019 460.17.13-727.441.6 1 992
6 L2G1EST01F 1 992 0.457.716.98-727.441.6 1 992
7 L1G2EST02A 11086-3.8 0.42.67 0. 0. 11086
8 L G2EST03A 11086-3.9 11086
9 L G2EST03B 11086-3.9 11086
10 L G2EST03C 11086-3.9 11086
11 L G2EST03D 11086-3.9 11086
12 L G3EST04A 11035-6.3 11035
13 L G3EST07A 11050-15. 11050
14 L G3EST10A 11063-23. 11062
15 L G3EST13A 11031-33. 11031
16 L G2EST14A 11069-38. 11069
17 L G2EST15A 11071-12. 11071
18 L G2EST16A 11071-11. 31070
19 L G2EST17A 110332.43 -757.197.6 31032
20 L G2EST18A 110322.41 31031
21 L G2EST19A 11037-1.2 1241.-232. 31036
22 L G2EST20A 11035 -.9 31033
23 L G2EST21A 1 999 6. -809.436.4 3 998
24 L G2EST22A 110232.25 -42.22.886 31021
25 L G2EST23A 11008-1.8 589.291.27 31007
26 L G2EST24A 11063-45. 21063
27 L G2EST25A 11067-48. 5011.-862. 21068
28 L G2EST26A 11067-47. 21067
29 L G2EST27A 11057-44. 488.-18.6 21058
30 L G4EST28A 11088-37. -72.6-35.1 11088
31 L G4EST29A 11082-39. 916.8248.4 21083
32 L G4EST30A 11150-14. 31150
33 L1G1EST31A 110314.41 80.5 -5.1-379.210.2 31031
34 L1G1EST31B 110314.41 80.5-5.08-379.210.2 31031
35 L1G1EST31C 110274.41 80.5-12.4-377.210.8 31027
36 L1G1EST31D 110254.41 80.5-18.3-325.183.7 31025
37 L1G1EST32A 110167.35 212.-58.8-334.186.1 31016
38 L1G1EST32B 110287.29 212.-32.3-189.118.2 31028
39 L1G1EST32C 110317.28 212.-24.3-281.154.1 31031
40 L1G1EST32D 11027 7.3 212.-34.9-146.105.8 31027
41 L1G1EST33A 110294.47 223.-81.7-369.209.2 31029
42 L1G1EST33B 110254.49 223.-89.6-415.246.5 31002
43 L1G1EST33C 110204.52 223.-101.-380.218.9 31020
44 L1G1EST33D 110254.49 223.-89.6-145.119.3 31040
45 L1G1EST34A 110448.22 67.-19.8-316.183.8 31044
46 L1G1EST34B 110448.22 67.-19.8-316.183.8 31044
47 L1G1EST34C 110408.23 67.-25.8-231.152.7 31040
48 L1G1EST34D 110448.22 67.-19.8-316.183.8 31044
49 L1G1EST34E 110448.22 67.-19.8-316.183.8 31044
50 L1G1EST35A 1 967-33. 0.-235.-290.290.1 1 967
51 L1G1EST36A 11060-45. 283.-31.7-250. 250. 21060
52 L1G1EST36B 11062-45. 283.-19.7-250. 250. 21062
53 L1G1EST36C 11060-45. 283.-33.4-250. 250. 21060
54 L1G1EST36D 11062-45. 283.-19.7-250. 250. 21062
55 L1G1EST36E 11060-45. 283.-33.6-250. 250. 21060
56 L1G1EST36F 11060-45. 283.-34.5-250. 250. 21070
64 L G3C2E07ASC1A 11038-20. 11038
65 L G3C2E07ASC1B 11040-5.7 11039
66 L G3C2E07ASC2B 11040-5.7 11040
67 L G3C2E10ASC1B 11029-13. 11029
68 L G3C2E10ASC2B 11030-13. 11030
72 L G3C2E07ASC2A 11038-20. 11038
80000 L 00C2S05TR31 1027-33. 11027
80001 L 00C4S07TR31 10332.52 31032
80002 L 00C4S07TR32 10332.52 31032
99999
DLIN
1 7 1 1.701 .9125 805.805. 805.
2 7 1 1.701 .9125 805.805. 805.
3 7 1 1.701 .9125 805.805. 805.
4 7 1 1.701 .9125 805.805. 805.
5 7 1 1.701 .9125 805.805. 805.
6 7 1 1.701 .9125 805.805. 805.
7 8 1 .0052 .0511.033 23042304 2304
7 9 2 .0051 .05 10.87 23042304 2304
7 10 3 .005 .0510.688 23042304 2304

```

Appendix A. SAGE System

7	11 4	.005	.0510.538		23042304	2304
8	12 1	.6276	1.05		23102310	2310
9	12 1	.6276	1.05		23102310	2310
10	12 1	.6276	1.05		23102310	2310
11	12 1	.6276	1.05		23102310	2310
12	64 1	.076	1.84 927.8		42004200	4200
12	72 2	.076	1.85 929.1		42004200	4200
13	64 1	-.749			99989998	9998
13	65 1	-.778			99989998	9998
13	66 1	-.778			99989998	9998
13	72 1	-.749			99989998	9998
14	67 1	-.915			99989998	9998
14	68 1	-.915			99989998	9998
15	80000 1	-.11	1.		21002100	2100
16	15 1	.7	1.042.87961.169		1623102310352310	
16	15 2	.7	1.042.87961.169		1623102310352310	
16	26 1 T	.0826	1.04 32.		25322532	2532
16	26 2 T	.0826	1.04 32.		25322532	2532
17	13 1	.7	1.042.87961.169		1723102310352310	
17	13 2	.7	1.042.87961.169		1723102310352310	
17	18 1 T	.01	.05 1.135		24542454	2454
17	18 2 T	.01	.05 1.135		24542454	2454
18	19 1	.154	1.94236.97		32733273	3273
18	21 1	.191	2.414294.92		32733273	3273
19	20 1	.056	.69785.746		24562456	2456
19	23 1	.172	2.17265.16		25322532	2532
19	80001 1	.016	.097	1.	10001000	1000
19	80002 1	.016	.101	1.	10001000	1000
20	21 1	.0624	.784896.592		24562456	2456
21	22 1	.01	.12615.428		23372337	2337
21	22 2	.01	.13 15.16		23372337	2337
21	24 1	.162	2.048250.17		32733273	3273
23	24 1	.102	1.268155.24		25322532	2532
23	25 1	.282	3.852 493.7		25322532	2532
24	25 1	.225	3.033381.46		25322532	2532
26	27 1	.0284	.352 10.83		25322532	2532
26	27 2	.0284	.352 10.83		25322532	2532
26	29 1	.0223	.2814.462		25322532	2532
27	28 1	.007	.088 2.707		25322532	2532
27	28 2	.007	.088 2.707		25322532	2532
30	15 1	.899	1.028.85921.102		3021002100232100	
30	31 1 T	.0812	.8 7.56		20302030	2030
30	31 2 T	.0812	.8 7.56		20302030	2030
30	31 3 T	.0812	.8 7.56		20302030	2030
30	31 4 T	.0812	.8 7.56		20302030	2030
30	32 1	1.6	9. 300.		20302030	2030
30	80000 1	1.033	1..85931.115		3021002100232100	
31	29 1	1.44	1.04		784.784.	784.
31	29 2	1.44	1.04		784.784.	784.
32	18 1	.899	1.066		784.784.	784.
33	80001 1	.034	4.359	1.	10001000	1000
34	80001 1	.034	4.365	1.	350.500.	350.
35	80002 1	.034	4.34	1.	10001000	1000
36	80002 1	.034	4.323	1.	350.500.	350.
37	20 1	4.2	1.013		347.347.	347.
38	20 1	4.2	1.013		347.347.	347.
39	20 1	4.2	1.013		347.347.	347.
40	20 1	4.2	1.013		347.347.	347.
41	22 1	4.32	1.034		461.461.	461.
42	22 1	4.32	1.034		461.461.	461.
43	22 1	4.32	1.034		461.461.	461.
44	22 1	4.32	1.034		461.461.	461.
45	23 1	.08255.6814	1.057		385.385.	385.
46	23 1	.08255.6814	1.057		385.385.	385.
47	23 1	.08255.6814	1.057		385.385.	385.
48	23 1	.08255.6814	1.057		385.385.	385.
49	23 1	.08255.6814	1.057		385.385.	385.
50	80000 1	2.483	1.		297.326.	297.
51	28 1	1.701	1.		805.805.	805.
52	28 1	1.701	1.		805.805.	805.
53	28 1	1.701	1.		805.805.	805.
54	28 1	1.701	1.		805.805.	805.
55	28 1	1.701	1.		805.805.	805.
56	28 1	1.701	1.		805.805.	805.
65	14 1	.064	1.53 760.		42004200	4200
66	14 2	.063	1.53 755.7		42004200	4200
67	15 1	.072	1.75 877.5		42004200	4200
68	15 2	.072	1.75 873.		42004200	4200
99999						
DBSH						
13		F 0000 0000	13 -330. C			
1	2 2	-165.				
FBAN						
14		F 0000 0000	14 -100. C			
1	1 1	-100.				
FBAN						
23		F 0000 0000	23 -150. C			
1	1 1	-150.				
FBAN						
24		F 0000 0000	24 -100. C			
1	1 1	-100.				
FBAN						
30		F 0000 0000	30 883.2 C			
1	4 4	220.8				
FBAN						

Appendix A. SAGE System

```

99999
DSHL
12      64 1  -330. -150.  L  L
12      72 2  -330. -150.  L  L
18      19 1  -100.         L
18      21 1  -100.         L
19      23 1          -150.  L
21      24 1          -100.  L
23      25 1          -150.  L
24      25 1          -150.  L
65      14 1  -330. -330.  L  L
66      14 2  -330. -330.  L  L
67      15 1          -165.  L
68      15 2          -165.  L
99999
DGER
1      0. 723.55 16.67 100.
2      0. 723.55 16.67 100.
3      0. 723.55 16.67 100.
4      0. 723.55 16.67 100.
5      0. 723.55 16.67 100.
6      0. 723.55 16.67 100.
33     0. 355. 3.046 100.
34     0. 355. 3.046 100.
35     0. 355. 3.046 100.
36     0. 355. 3.046 100.
37     0. 315. 2.703 100.
38     0. 315. 2.703 100.
39     0. 315. 2.703 100.
40     0. 315. 2.703 100.
41     0. 419. 3.596 100.
42     0. 415.44 3.565 100.
43     0. 419. 3.596 100.
44     0. 419. 3.596 100.
45     0. 294.8 2.53 100.
46     0. 294.8 2.53 100.
47     0. 294.8 2.53 100.
48     0. 294.8 2.53 100.
49     -9999. 294.8 2.53 100.
50     0. 0. 0. 100.
51     0. 440.94 8.317 100.
52     0. 441.74 8.332 100.
53     0. 440.82 8.315 100.
54     0. 441.74 8.332 100.
55     0. 440.81 8.314 100.
56     0. 444.82 8.39 100.
99999
DCAR
barr    7 E barr    19 E barr    27 E barr    31 A 25 25 25 25 60.
barr   21 E barr    24 E barr    25 E barr    29 A 25 25 24 24 60.
barr   23          A 24 24 25 25 60.
barr   30          A 0 0 0 0 60.
99999
DGLT
0      .5 1.5  .5 1.5
99999
DARE
1      0.  AREA 1 - S101          -.1E8  .1E8
2      0.  AREA 2 - S101          -.1E8  .1E8
3      0.  AREA 3 - S101          -.1E8  .1E8
99999
DGBT
G3    750.
G2    500.
G4    345.
G1    20.
00    1.
99999
FIM

```

A.2 Dynamic Data File


```

TITU
SNAPSHOT DO CASO BASE: EXTGCASOBASE
ULOG
4
EXTGCASOBASE.OUT
DOPC IMPR CONT
IMPR L FILE L CONT L 80CO L
999999
DCTE
TETE 1.e-04
TEMD 1.e-04
TABS 1.e-07
TEPQ .01
999999
ULOG
2
sage.sav
ULOG
8
EXTGCASOBASE.PLT
ARQV REST
01
ULOG
3
BDEMO.BLT
ARQM
ULOG
3
DadosIndiv.CDU
ARQM
DMAQ
  1  60      1  901  907u  947u  977u
  2  61      1  901  908u  948u  978u
  3  62      1  901  909u  949u  979u
  4  63      1  901  910u  950u  980u
  5  64      1  901  911u  951u  981u
  6  65      1  901  912u  952u  982u
 51  10      1  901  901u  941u  971u
 52  11      1  901  902u  942u  972u
 53  12      1  901  903u  943u  973u
 54  13      1  901  904u  944u  974u
 55  14      1  901  905u  945u  975u
 56  15      1  901  906u  946u  976u
 33  20      1  807  810u  850u  880u
 34  21      1  807  811u  851u  881u
 35  22      1  807  2810u 2850u 2880u
 36  23      1  807  2811u 2851u 2881u
 37  50      1  702  704u  744u  774u
 38  51      1  702  705u  745u  775u
 39  52      1  702  706u  746u  776u
 40  53      1  702  707u  747u  777u
 41  40      1  700  700u  740u  770u
 42  41      1  700  701u  741u  771u
 43  42      1  700  702u  742u  772u
 44  43      1  700  703u  743u  773u
 45  30      1  808  812u  852u  882u
 46  31      1  808  813u  853u  883u
 47  32      1  808  814u  854u  884u
 48  33      1  808  815u  855u  885u
 49  34      1  808  816u  856u  886u
999999
DSIM
15.00 .003 1
EXSI
FIM

```

Appendix B

Two Areas System

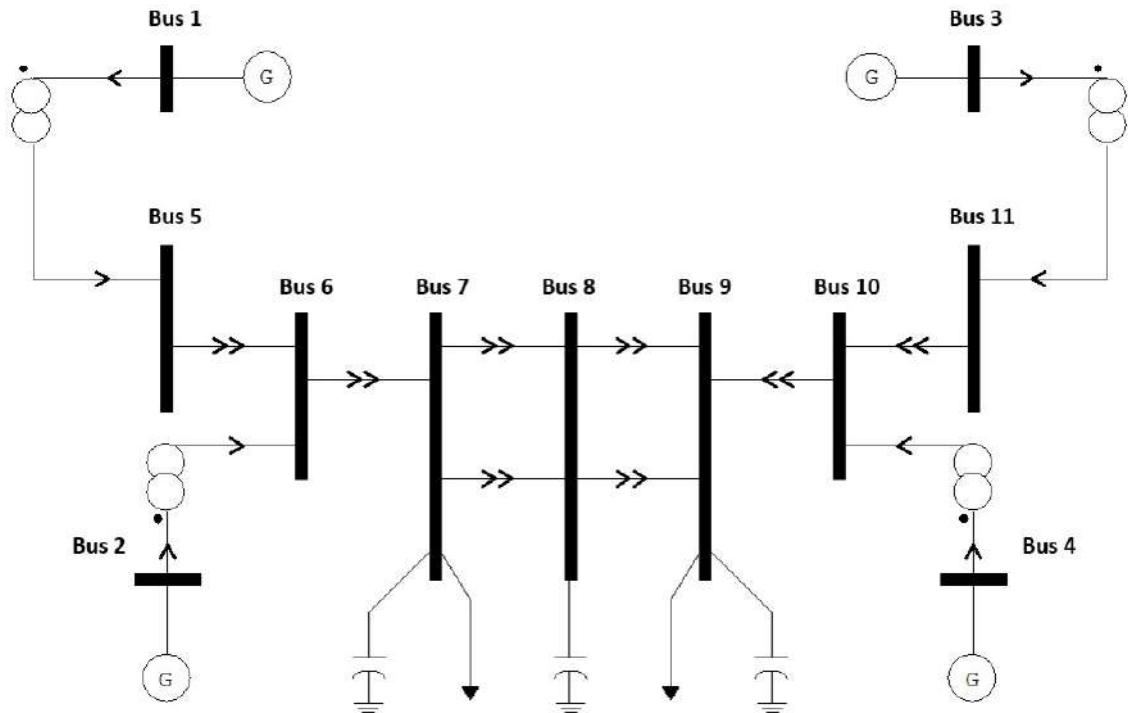

B.1 Power Flow Data File

```

TITU
Two Area Test System Modificado
DCTE
BASE 100. DASE 1000. TEPA .1E-7 EXST 4. TETP 5. TBPA 5.
TLPP 1. TEPR .1E-7 QLST 4. TLPR 1. TLPO 2. TSBZ .01
TSBA 5. ASTP .05 VSTP 5. TLVC .5 TLTC .01 TSFR .1E-7
ZMAX 500. TLPV .5 VDMV 200. VDVN 40. TUDC .001 TADC .01
PGER 30. TPST 2. VFLD 70. ZMIN .001 HIST 470 LFTT 10
ACIT 30 LFCV 1 DCIT 10 VSIT 10 LPIT 50 LFLP 10
PDIT 10 LCRT 30 LPRT 60 CSTP 500. ASDC 1.
ICIT 30 DMAX 5 FDIV 2. ICMN .05 VART 5. TSTP 32
ICMV .5 APAS 90. CPAR 70. VAVT 2. VAVF 5. VMVF 15.
VPVT 2. VPVF 5. VPMF 10. VSVF 20. VINP 1. VSUP 1.
TLSI 0. NDIR 20. STTR 5. TRPT 100. STIR 1. BFPO 1.
99999
DBAR
1 L1 Barra1 103032.7 700.82.96-999999999 11000
2 L1 Barra2 105020.7 450.214.6-999999999 11000
3 L2 Barra3 1030 -7.532.891.49-999999999 21000
4 L1 Barra4 1010-18. 150.47.65-999999999 21000
5 L Barra5 102326.3 11000
6 L Barra6 101816.6 11000
7 L Barra7 100710.3 600. 100. 200. 11000
8 L Barra8 983-6.5 50. 11000
9 L Barra9 995-23. 1167. 100. 250. 21000
10 L Barra10 1002-19. 21000
11 L Barra11 1019-12. 21000
99999
DLIN
1 5 1 1.6666 1.
2 6 1 1.6666 1.
3 11 1 1.6666 1.
4 10 1 1.6666 1.
5 6 1 .25 2.5 4.35
6 7 1 .1 1. 1.75
7 8 1 1.1 11. 19.25
7 8 2 1.1 11. 19.25
8 9 1 1.1 11. 19.25
8 9 2 1.1 11. 19.25
9 10 1 .1 1. 1.75
10 11 1 .25 2.5 4.37
99999
DARE
1 0. * AREA 1 *
2 0. * AREA 2 *
99999
FIM

```

B.2 Dynamic Data File

```

TITU
** Two areas system **
ULOG
2
2areas.sav
ULOG
8
2areas.plt
DOFC IMPR CONT FILE
IMPR FILE
999999
DCTE
TEPQ .01
TEMD 1.E-7
TETE 1.E-7
TABS 1.E-7
999999
ARQV REST
01
DMDG MD03
0001 0001 180 170 030 055 025 020 8.0 0.4 0.03 0.05
0001 .25 6.5 0.0 1200
0002 0001 180 170 030 055 025 020 8.0 0.4 0.03 0.05
0002 .25 6.5 0.0 900
0003 0001 180 170 030 055 025 020 8.0 0.4 0.03 0.05
0003 .25 6.175 0.0 900
0004 0001 180 170 030 055 025 020 8.0 0.4 0.03 0.05
0004 .25 6.175 0.0 350
999999
DCST
0001 2 0.015 9.6 0.9
999999
DCDU IMPR
0001 AVRMAQ1
DEFPAR #Tr 0.01
DEFPAR #Ka 400.0
DEFPAR #Lmin -4
DEFPAR #Lmax 4
1 IMPORT VOLT ET
2 ENTRAD VREF
3 IMPORT VSAD VPSS
4 LEDLAG ET X4 1.0 1.0 #Tr
5 SOMA +VREF X5
-X4 X5
VPSS X5
6 GANHO X5 X6 #Ka
7 LIMITA X6 EFD LMIN LMAX
8 EXPORT EFD EFD
DEFVAL LMIN #Lmin
DEFVAL LMAX #Lmax
FIMCDU
0002 AVRMAQ2
DEFPAR #Tr 0.01
DEFPAR #Ka 400.0
DEFPAR #Lmin -4
DEFPAR #Lmax 4
1 IMPORT VOLT ET
2 ENTRAD VREF
3 IMPORT VSAD VPSS
4 LEDLAG ET X4 1.0 1.0 #Tr
5 SOMA +VREF X5
-X4 X5
VPSS X5
6 GANHO X5 X6 #Ka
7 LIMITA X6 EFD LMIN LMAX
8 EXPORT EFD EFD
DEFVAL LMIN #Lmin
DEFVAL LMAX #Lmax
FIMCDU
0003 AVRMAQ3
DEFPAR #Tr 0.01
DEFPAR #Ka 400.0
DEFPAR #Lmin -4
DEFPAR #Lmax 4
1 IMPORT VOLT ET
2 ENTRAD VREF
3 IMPORT VSAD VPSS
4 LEDLAG ET X4 1.0 1.0 #Tr
5 SOMA +VREF X5
-X4 X5
VPSS X5
6 GANHO X5 X6 #Ka
7 LIMITA X6 EFD LMIN LMAX
8 EXPORT EFD EFD
DEFVAL LMIN #Lmin
DEFVAL LMAX #Lmax
FIMCDU
0004 AVRMAQ4
DEFPAR #Tr 0.01
DEFPAR #Ka 400.0
DEFPAR #Lmin -4
DEFPAR #Lmax 4
1 IMPORT VOLT ET
2 ENTRAD VREF
3 IMPORT VSAD VPSS

```

Appendix B. Two Areas System


```

4 LEDLAG      ET      X4      1.0      1.0      #Tr
5 SOMA        +VREF   X5
              -X4      X5
              VPSS     X5
6 GANHO      X5      X6      #Ka
7 LIMITA     X6      EFD
8 EXPORT EFD  EFD
DEFVAL      LMIN      #Lmin
DEFVAL      LMAX      #Lmax
FIMCDU
0005 PSS1
DEFPAR #Kstab      20.0
DEFPAR #Tw         10.0
DEFPAR #T1        0.05
DEFPAR #T2        0.02
DEFPAR #T3        3.0
DEFPAR #T4        5.4
1 IMPORT WMAQ      W
2 GANHO            W      X2      #Kstab
3 WSHOUT          X2     X3      #Tw  1.0  #Tw
4 LEDLAG          X3     X4      1.0  #T1  1.0  #T2
5 LEDLAG          X4     VPSS   1.0  #T3  1.0  #T4
6 EXPORT VSAD     VPSS
FIMCDU
0006 PSS2
DEFPAR #Kstab      20.0
DEFPAR #Tw         10.0
DEFPAR #T1        0.05
DEFPAR #T2        0.02
DEFPAR #T3        3.0
DEFPAR #T4        5.4
1 IMPORT WMAQ      W
2 GANHO            W      X2      #Kstab
3 WSHOUT          X2     X3      #Tw  1.0  #Tw
4 LEDLAG          X3     X4      1.0  #T1  1.0  #T2
5 LEDLAG          X4     VPSS   1.0  #T3  1.0  #T4
6 EXPORT VSAD     VPSS
FIMCDU
0007 PSS3
DEFPAR #Kstab      20.0
DEFPAR #Tw         10.0
DEFPAR #T1        0.05
DEFPAR #T2        0.02
DEFPAR #T3        3.0
DEFPAR #T4        5.4
1 IMPORT WMAQ      W
2 GANHO            W      X2      #Kstab
3 WSHOUT          X2     X3      #Tw  1.0  #Tw
4 LEDLAG          X3     X4      1.0  #T1  1.0  #T2
5 LEDLAG          X4     VPSS   1.0  #T3  1.0  #T4
6 EXPORT VSAD     VPSS
FIMCDU
0008 PSS4
DEFPAR #Kstab      20.0
DEFPAR #Tw         10.0
DEFPAR #T1        0.05
DEFPAR #T2        0.02
DEFPAR #T3        3.0
DEFPAR #T4        5.4
1 IMPORT WMAQ      W
2 GANHO            W      X2      #Kstab
3 WSHOUT          X2     X3      #Tw  1.0  #Tw
4 LEDLAG          X3     X4      1.0  #T1  1.0  #T2
5 LEDLAG          X4     VPSS   1.0  #T3  1.0  #T4
6 EXPORT VSAD     VPSS
FIMCDU
999999
DMAQ
1 10          1 1 1u
2 10          1 2 2u
3 10          1 3 3u
4 10          1 4 4u
999999
DEVT IMPR
TCDU 1.0      1          .005          2
TCDU 1.0      3         -.005          2
999999
DPLT IMPR
VOLT 1
VOLT 2
VOLT 3
VOLT 4
PELE 1          10
PELE 2          10
PELE 3          10
PELE 4          10
DELT 1          10
DELT 2          10
DELT 3          10
DELT 4          10
999999
DSIM
10.0 .001      5 1 1
EXSI
FIM

```

Appendix C

Brazilian Power System

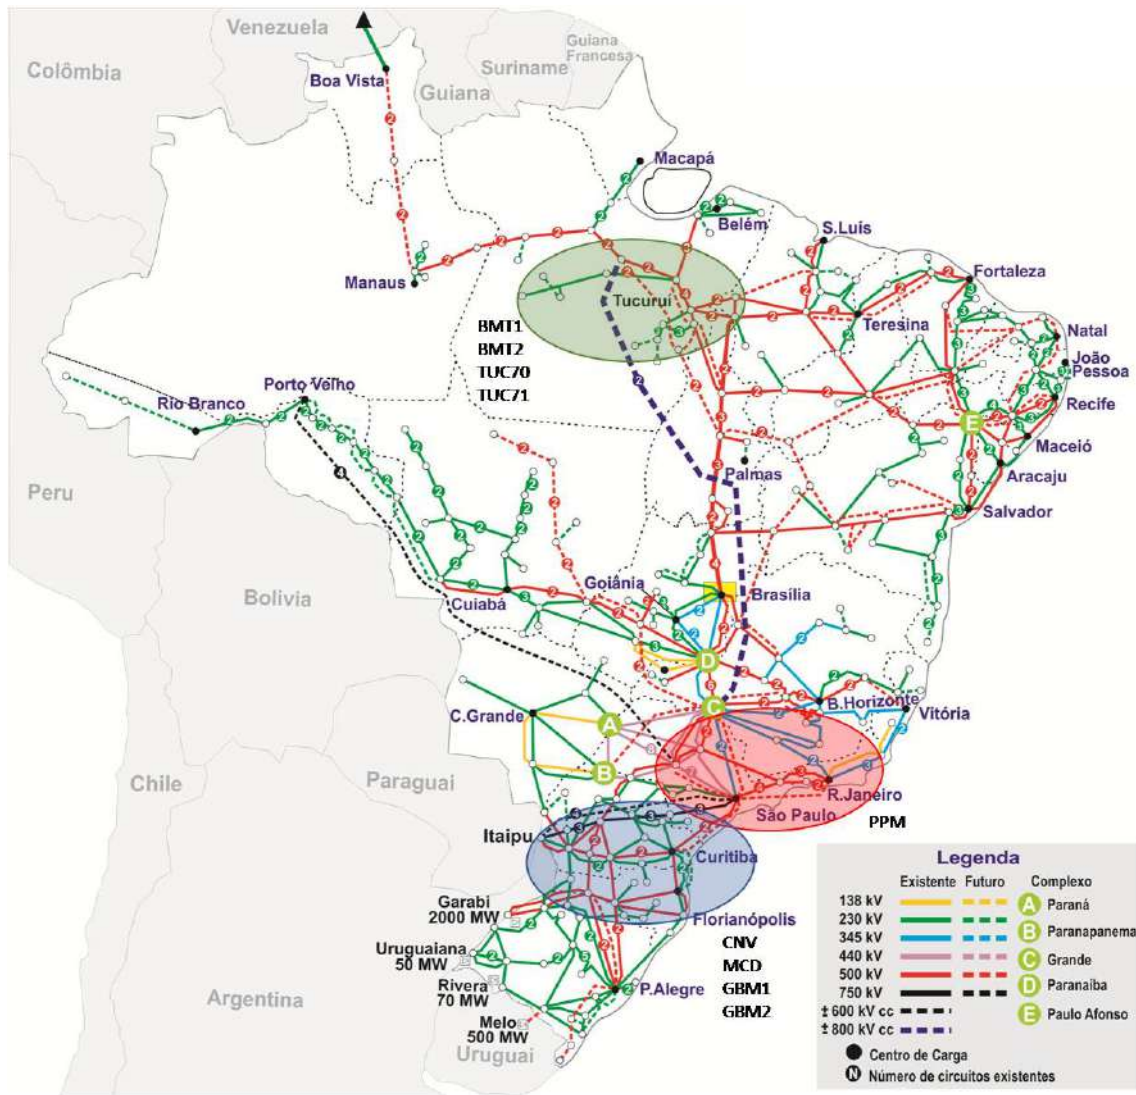

C.1 Power Flow Data File

```

TITU
SIN 2020
DBAR
( EPE - Banco de Dados - 2020 (aproximadamente, 8000 barras)
99999
DLIN
( EPE - Banco de Dados - 2020 (aproximadamente, 11000 linhas de transmissao)
99999
DCSC
736      539 1      -1.76  -.59 -.637X  -.637  736
758      539 1      -1.76  -.59 -.637X  -.637  758
5000     3895 1     -1.76  -.59 -.637X  -.637  5000
4431     3895 1     -1.76  -.59 -.637X  -.637  4431
99999
DBSH
( EPE - Banco de Dados - 2020
99999
DSHL
( EPE - Banco de Dados - 2020
99999
DCER
341  10 2 332  2. -214.-100. 150. P L
421  10 1 421  5. 5.202 -88. 97.4 P L
425  10 1 425  1.5 58.73-175.189.6 P L
444  10 1 11244  1. 24.07 0.209.1 P L
476  10 1 276  1. 160.9-114. 225. P L
581  10 1 585  .8 -290.-250. 250. P L
702  90 1 624  2. 20.03 0. 20. P L
716  90 1 216  1. 3.049 -45. 90. P L
2610 90 1 2634  1. -104.-300. 300. P L
2974 90 1 2628  1. -127.-120. 150. P L
3329 10 1 3329  1. 7.167-54.563.96 P L
3330 10 1 3322  1. 55.42 -20. 55. P L
3628 10 1 3628  3. 7.146 -25. 29. P L
3630 10 1 3909  2. -3.66 -56. 88.5 P L
3631 10 1 3785  2. -4. -55.90.31 P L
3632 10 1 3909  2. -3.66 -56. 88.5 P L
3718 90 1 3717  1. -98.2-300. 300. P L
4301 90 1 4300  1. 276.4-150. 300. P L
4324 90 1 4322  1. -31.2-150. 300. P L
4688 10 1 4688  1. 13.24 -80. 20. P L
7726 90 1 7741  1. -55.7-100. 300. P L
9504 10 1 9535  2. 3.644 -50. 100. P L
9505 10 1 9538  2. 39.1 -20. 55. P L
9539 90 1 3288  2. -133.-130. 75. P L
9540 90 1 9530  2. 103.4-100. 100. P L
10013 90 1 10009  1. -44.-200. 200. P L
10014 90 1 10010  1. -180.-200. 200. P L
10015 90 1 10011  1. -67.2-200. 200. P L
10016 90 1 10017  1. 111.5-100. 100. P L
11562 90 1 11560  1. -17.3-100. 200. P L
12331 90 1 11246  1. 67.2 -75. 150. P L
12332 90 1 12546  1. 20.82 -75. 150. P L
12333 90 1 289  1. 242.6-150. 250. P L
12334 90 1 555  1. -27.3-100. 200. P L
12335 90 1 526  1. -130.-150. 250. P L
12336 90 1 287  1. -20.1 -20. 30. P L
13018 90 1 13018  1. -101.-150. 300. P L
14901 90 1 14901  1. 52.46-150. 300. P L
26453 90 1 1485  1. -230.-200. 300. P L
27950 90 1 1481  1. -21.4 -84. 100. P L
29051 90 1 2154  1. 12.74 -90. 100. P L
38859 90 1 7758  1. 40.28 -50. 50. P L
38860 10 1 7755  2. 76.36-100. 100. P L
38860 90 1 7755  2. 96.84-100. 100. P L
38868 90 1 4285  1. -82.6-200. 300. P L
39001 90 1 39311  1. -43.8-150. 150. P L
40660 10 1 40660  1. 0. 0. 280. P L
41176 90 1 4594  1. -181.-200. 200. P L
52213 90 1 52207  1. -126.-120. 150. P L
99999
DCTR
( EPE - Banco de Dados - 2020
99999
DARE
1 0. CHESF - SISTEMA SUL
2 0. CHESF - SISTEMA LESTE
3 0. CHESF - SISTEMA NORTE
4 0. CHESF - SISTEMA OESTE
5 0. CHESF - SISTEMA CENTRO
6 0. CHESF - SISTEMA SUDOESTE
7 0. ELETRONORTE
8 0. NORTE-SUL
9 0. ALUMAR (MARANHAO)
10 0. TUCURUI-MACAPA-MANAUS
12 0. CELTINS
13 0. CEB
14 0. PCH-GOIAS
15 0. CDSA
17 0. CELG - D
18 0. CELG - D (GOIÂNIA)
19 0. CELG - G&T
20 0. ELETRONORTE-CENTRO-OESTE
21 0. CEMAT
22 0. CEMAT
23 0. CEMIG - GERACAO E CONTROLE DE TENSÃO
24 0. CEMIG - SISTEMA DE TRANSMISSÃO
25 0. CEMIG - REGIAO CENTRO
26 0. CEMIG - REGIAO LESTE
27 0. CEMIG - REGIAO SUDESTE
28 0. CEMIG - REGIAO DO TRIANGULO MINEIRO
29 0. CEMIG - REGIAO OESTE
30 0. CEMIG - REGIAO NORTE

```


Appendix C. Brazilian Power System

31	0.	CEMIG - REGIAO SUL
32	0.	CEMIG - BARRAS DE TERCIARIO
33	0.	CFCLL - MINAS
35	0.	AES-TIETE
36	0.	CESP
37	0.	DUKE-GP
38	0.	EMAE
39	0.	CPFL - SANTA CRUZ
40	0.	CPFL - SUDESTE
41	0.	CPFL - NOROESTE
42	0.	CPFL - NORDESTE
43	0.	CPFL PIRATININGA - BAIXADA
44	0.	CPFL PIRATININGA - OESTE
45	0.	CTEEP - SISTEMA DE 440KV E 500KV
46	0.	CTEEP - SISTEMA DE 138KV OESTE
47	0.	CTEEP - SISTEMA DE 88KV
48	0.	CTEEP - 138KV DO LITORAL E C. BONITO
49	0.	CTEEP - 138KV DA REGIAO DO PARDO
50	0.	CTEEP - SISTEMA DE 345KV E 230KV
51	0.	REDE ENERGIA
52	0.	ELEKTRO - CENTRO
53	0.	ELEKTRO - LESTE
54	0.	ELEKTRO - NOROESTE
55	0.	ELEKTRO - SUL
56	0.	BANDEIRANTE
58	0.	ELETROPAULO
59	0.	CPFL JAGUARIUNA
60	0.	CONSUMIDORES LIVRES (RB) - SE/CO
61	0.	FURNAS - ITAIPU 50 Hz
62	0.	FURNAS - GERACAO E CONTROLE
63	0.	FURNAS - TRANSMISSAO RJ ES MG SP
64	0.	FURNAS - TRANSMISSAO GO DF MT
65	0.	FURNAS- BARRAS TERCIARIAS E FIC
68	0.	LIGHT
69	0.	AMPLA-REGIAO SUL FLUMINENSE
70	0.	AMPLA-REGIAO NORTE FLUMINENSE
71	0.	AMPLA-REGIAO NITEROI
73	0.	CENF
74	0.	ESCELSA
75	0.	TELES PIRES
76	0.	BELO MONTE
77	0.	MADEIRA
78	0.	ACRE E RONDONIA
79	0.	ICG - SE/CO
80	0.	TRANSMISSORAS SUDESTE-COESTE
81	0.	GERADORES HIDR SUDESTE-COESTE
82	0.	GERADORES TERM SUDESTE-COESTE
83	0.	A.E.S.
84	0.	CEEE
85	0.	CEEE DISTRIBUIDORA
86	0.	ENERSUL
87	0.	RGE
88	0.	CELESC - AREA LESTE
89	0.	CELESC - OESTE + SUL
90	0.	ELETROSUL 230KV - SE/CO
91	0.	COPEL - G&T
92	0.	COPEL - D
93	0.	ELETROSUL 525KV
94	0.	ELETROSUL 230KV - SUL
95	0.	CPFL
96	0.	GERASUL
97	0.	OUTRAS EMPRESAS DE GERACAO SUL
98	0.	CONSUMIDORES LIVRES (RB) - SUL
101	0.	CEPISA
102	0.	COELCE
103	0.	COSERN
104	0.	SAELPA
105	0.	CELPE
106	0.	CEAL
107	0.	ENERGIPE
108	0.	COELBA
109	0.	CEMAR
110	0.	CELPA
111	0.	CELB
112	0.	CONSUMIDORES LIVRES (RB) - Norte
113	0.	MANAUS
114	0.	AMAPA
115	0.	RORAIMA
116	0.	TAPAJÓS
117	0.	CONSUMIDORES LIVRES (RB) - Nordeste
118	0.	EOLICAS NORDESTE
99999		
DELO		
(EPE - Banco de Dados - 2020 (aproximadamente, 40 elos de corrente continua)		
99999		
DCBA		
(EPE - Banco de Dados - 2020		
99999		
DCLI		
(EPE - Banco de Dados - 2020		
99999		
DCNV		
(EPE - Banco de Dados - 2020		
99999		
DCCV		
(EPE - Banco de Dados - 2020		
99999		
DGBT		
(EPE - Banco de Dados - 2020		
99999		
FIM		

C.2 Dynamic Data File

```

TITU
SIN 2020
DOPC IMPR CONT
IMPR L CONT L 80CO L FILE L
999999
ULOG
8
SIN2020.PLT
ULOG
2
NNE-EXP-PES-CRITICO.SAV
ARQV REST
2
ULOG
3
USINAS-EXISTENTES-EPE.BLT
ARQM
ULOG
3
USINAS-EXISTENTES-EPE.CDU
ARQM
ULOG
3
USINAS-FUTURAS-EPE.BLT
ARQM
ULOG
3
USINAS-FUTURAS-EPE.CDU
ARQM
ULOG
3
Madeira-EPE.CDU
ARQM
ULOG
3
Madeira-EPE.BLT
ARQM
ULOG
3
BeloMonte-EPE.CDU
ARQM
ULOG
3
BeloMonte-EPE.BLT
ARQM
ULOG
3
TelesPires-EPE.CDU
ARQM
ULOG
3
TelesPires-EPE.BLT
ARQM
ULOG
3
Tapajós-EPE.CDU
ARQM
ULOG
3
Tapajós-EPE.BLT
ARQM
DMAQ
3581 10 100 100 1 100 100u 140u 170u 3581 ANGRA-1--1GR
3582 10 100 100 1 101 101u 141u 171u 3582 ANGRA-2--1GR
3586 10 100 100 4 103 103u 143u 173u 3586 LCBARRET-4GR
3596 10 100 100 2 105 105u 145u 3596 FUNIL----2GR
3587 10 100 100 4 107 106u 146u 3587 FURNAS---4GR
3592 10 100 100 3 109 108u 148u 178u 3592 ITUMBIAR-3GR
3588 10 100 100 4 111 110u 150u 180u 3588 MARIMBON-4GR
3595 10 100 100 2 128 128u 159u 189u 3595 MANSO---2GR
3589 10 100 100 3 113 111u 151u 181u 3589 M.MOR.A--3GR
3590 10 100 100 2 114 112u 152u 182u 3590 M.MOR.B--2GR
3591 10 100 100 2 116 113u 153u 3591 P.COLOMB-2GR
3597 10 100 100 2 118 114u 154u 3597 SCRUZ-19-2GR
3598 10 100 100 2 120 115u 155u 3598 SCRUZ-13-2GR
3601 10 100 100 2 121 132u 161u 172u 3601 SCRUZ-16-2GR
3593 10 100 100 2 122 116u 156u 186u 3593 CORUMBA--2GR
3594 10 100 100 3 124 117u 157u 187u 3594 S.MESA---3GR
3626 10 100 100 1 130 120u 3626 B.GERALLI-1CS
3629 10 100 100 1 132 121u 3629 VITORIA2-1CS
3623 10 100 100 1 134 126u 3623 GRAJAU-1-1CS
3624 10 100 100 1 134 130u 3624 GRAJAU-2-1CS
3625 10 100 100 1 132 123u 3625 VITORIA1-1CS
3622 10 100 100 4 138 127u 3622 IBIUNA---4CS
3621 10 100 100 1 140 125u 3621 T.PRETO--1CS
4057 10 69 73 3 200 200u 240u 270u 4057 NPECANHA-3GR
4057 20 31 27 2 201 201u 241u 271u 4057 NPECANHA-2GR
4060 10 33 38 1 202 202u 242u 272u 4060 FONTES---1GR
4060 20 67 62 2 203 203u 243u 273u 4060 FONTES---2GR
4062 10 100 100 1 205 205u 245u 275u 4062 P.PASSOS-1GR

```

Appendix C. Brazilian Power System

4066	10	29	29	2	206	206u	246u		4066	I. POMBOS-2GR
4066	20	16	17	1	207	207u	247u		4066	I. POMBOS-1GR
4066	30	27	30	1	208	208u	248u		4066	I. POMBOS-1GR
4066	40	28	24	1	209	209u	249u		4066	I. POMBOS-1GR
4385	10	100	100	2	210	210u	250u		4385	CTE-CSN--2GR
1426	10	100	100	2	300	300u	340u	370u	1426	EMBORCAC-2GR
1430	10	100	100	2	302	302u	342u	372u	1430	JAGUARA--2GR
1435	10	100	100	2	303	303u	343u	373u	1435	N. PONTE--2GR
1445	10	100	100	3	304	304u	344u	374u	1445	S. SIMAO--3GR
1446	10	100	100	5	305	305u	345u	375u	1446	T. MARIAS-5GR
1448	10	100	100	2	306	306u	346u	376u	1448	V. GRANDE-2GR
1428	10	100	100	2	314	314u	354u	384u	1428	GUILMAN--2GR
1433	10	100	100	3	315	315u	355u	385u	1433	MIRANDA--3GR
1429	10	100	100	3	316	316u	356u	386u	1429	IGARAPAV-3GR
4664	10	100	100	1	308	308u			4664	MESQUITA-1CS
4678	10	100	100	1	308	309u			4678	NEVES-1--1CS
4680	10	100	100	1	308	310u			4680	NEVES-2--1CS
1449	10	100	100	1	312	312u			1449	IGARAPE--1GR
1436	10	100	100	1	317	317u	357u		1436	PESTRELA-1GR
1427	10	100	100	2	318	318u	358u	388u	1427	FUNILGRD-2GR
1440	10	100	100	3	319	319u	359u	389u	1440	QUEIMADO-3GR
1431	10	100	100	3	320	320u	360u	390u	1431	IRAPE----3GR
1421	10	100	100	2	321	321u	361u	391u	1421	AIMORES--2GR
1452	10	100	100	2	322	322u	362u	392u	1452	BAGUARI--2GR
3382	10	22	32	1	400	400u	440u		3382	HBORD-88-1GR
3382	20	40	34	1	401	401u	441u		3382	HBORD-88-1GR
3382	30	38	34	1	402	402u	442u		3382	HBORD-88-1GR
3385	10	23	15	1	402	403u	443u		3385	HBORD230-1GR
3385	20	51	57	2	403	404u	444u		3385	HBORD230-2GR
3385	30	26	28	1	404	405u	445u		3385	HBORD230-1GR
3386	10	100	100	2	407				3386	PIR-13. 8-2GR
3387	10	100	100	2	408				3387	PIR-14. 4-2GR
3394	10	100	100	2	406	406u	446u	476u	3394	N. PIRAT1-2GR
3395	10	100	100	2	406	407u	447u	477u	3395	N. PIRAT2-2GR
1001	10	100	100	5	500	500u	540u	570u	1001	A. VERMEL-5GR
2041	10	100	100	13	501	501u	541u	571u	2041	I. SOLTE-13GR
2042	10	80	80	4	502	502u	542u		2042	JUPIA----4GR
2042	20	20	20	1	502	503u	543u	573u	2042	JUPIA----1GR
2043	10	100	100	1	502	504u	544u	574u	2043	JUPIA138-1GR
3011	10	100	100	2	506	505u	545u	575u	3011	JURUMIRI-2GR
3016	10	100	100	2	507	506u	546u	576u	3016	CAPIVARA-2GR
3021	10	100	100	2	508	507u	547u	577u	3021	CANOAS-1-2GR
3020	10	100	100	2	509	508u	548u	578u	3020	CANOAS-2-2GR
2045	10	100	100	6	510	509u	549u	579u	2045	P. PRIMA--6GR
3019	10	100	100	2	511	510u	550u	580u	3019	ROSANA-1-2GR
32900	10	100	100	1	511	527u	565u	590u	32900	ROSANA-2-1GR
3013	10	100	100	2	512	511u	551u		3013	S. GRANDE-2GR
3017	10	100	100	3	513	512u	552u	582u	3017	TAQUARUC-3GR
3012	10	100	100	4	514	513u	553u		3012	CHAVANTE-4GR
1009	10	100	100	2	515	514u	554u		1009	BARIRI-A-2GR
21502	10	100	100	1	515	529u	569u		21502	BARIRI-B-1GR
1006	10	100	100	4	516	515u	555u		1006	B. BONITA-4GR
1003	10	100	100	3	517	516u	556u		1003	IBITINGA-3GR
1002	10	100	100	3	518	517u	557u	585u	1002	N. AVANHA-3GR
1004	10	100	100	3	519	518u	558u		1004	PROMISSA-3GR
2044	10	100	100	3	520	519u	559u	587u	2044	T. IRMAOS-3GR
1007	10	100	100	1	521	520u	560u		1007	CACONDE--1GR
1008	10	100	100	2	522	521u	561u		1008	E. CUNHA--2GR
1005	10	100	100	1	523	522u	562u		1005	LIMOEIRO-1GR
2056	10	100	100	1	525	523u	563u		2056	JAGUARI--1GR
2058	10	100	100	1	526	524u	564u	589u	2058	PARAIBUN-1GR
2644	10	100	100	1	532	525u			2644	EMBU-GUA-1CS
2652	10	100	100	1	533	526u			2652	S. ANGELO-1CS
1081	10	100	100	2	600	600u	640u		1081	C. DOUR11-2GR
1082	10	100	100	1	601	601u	641u		1082	C. DOUR13-1GR
1083	10	100	100	1	602	602u	642u	672u	1083	C. DOU13A-1GR
1084	10	100	100	2	603	603u	643u	673u	1084	C. DOU13N-2GR
1085	10	100	100	2	604	604u	644u	674u	1085	C. DOU13K-2GR
6979	10	50	50	1	700	700u	740u	770u	6979	GBMun1e2-1GR
6979	20	50	50	1	9700	9700u	9740u	9770u	6979	GBMun3e4-1GR
6982	10	100	100	2	701	702u	742u		6982	GPSouza--2GR
7190	10	100	100	2	702	706u	746u	776u	7190	GJRicha--2GR
7195	10	100	100	2	702	704u	744u	774u	7195	GNBraga--2GR
6604	10	100	100	2	703	708u	748u	778u	6604	AraucarG-2GR
6605	10	100	100	1	704	709u	749u	779u	6605	AraucarV-1GR
7193	10	100	100	1	705	710u	750u	780u	7193	StaClara-1GR
6969	10	100	100	1	706	711u	751u	781u	6969	Fundao---1GR
8951	10	100	100	2	810				8951	Charquea-2GR
8975	10	100	100	3	808	812u	852u	882u	8975	Ita-----3GR
8954	10	100	100	2	800	800u	840u		8954	JLacA1e2-2GR
8955	10	100	100	2	801	801u	841u		8955	JLacA3e4-2GR
8956	10	100	100	2	802	802u	842u	872u	8956	JLacB5e6-2GR
8957	10	100	100	1	803	803u	843u	873u	8957	JLacC7-1GR
8718	10	100	100	2	815	815u	855u	885u	8718	Machadin-2GR
8960	10	100	100	1	804	804u	844u	874u	8960	PFundo---1GR
8972	10	100	100	2	805	806u	846u	876u	8972	SOsor1a4-2GR
8973	10	100	100	1	806	808u	848u	878u	8973	SOsor5e6-1GR
8974	10	100	100	2	807	810u	850u	880u	8974	SSantiag-2GR

Appendix C. Brazilian Power System

8706	10	100	100	1	811	816u	856u			8706	WARjona1-1GR
8707	10	100	100	1	811	817u	857u			8707	WARjona2-1GR
8708	10	100	100	1	812	818u	858u			8708	WARjona3-1GR
8710	10	100	100	1	812	819u	859u			8710	WARjona4-1GR
8704	10	100	100	1	811	820u	860u			8704	WARjona5-1GR
8750	10	100	100	1	818	823u	862u	887u		8750	Monjolin-1GR
8801	10	100	100	1	824	824u	863u	888u		8801	SPilao---1GR
4482	10	100	100	3	814	814u	854u	884u		4482	CBRAVA---3GR
4486	10	100	100	2	817	822u	861u	886u		4486	SSALVADO-2GR
3637	10	100	100	9	900	900u	940u			3637	ITAIPU50-9GR
3584	10	100	100	9	901	901u	941u	971u		3584	ITAIPU60-9GR
9141	10	100	100	2	1000	1000u	1040u	1070u		9141	Itauba---2GR
9151	10	100	100	3	1001	1002u	1042u	1072u		9151	Jacui----3GR
8918	10	100	100	2	1005	1010u	1050u	1080u		8918	Uruguaiv-2GR
8920	10	100	100	1	1006	1011u	1051u	1081u		8920	Uruguaiv-1GR
9432	10	100	100	2	1002	1004u				9432	PMediciA-2GR
9440	10	100	100	2	1003	1006u				9440	PMediciB-2GR
9251	10	100	100	1	1004	1008u	1048u	1078u		9251	PReal----1GR
9091	10	100	100	1	1007	1009u	1049u	1079u		9091	DFrancis-1GR
9327	10	100	100	1	1008	1013u	1043u	1073u		9327	SaoJose--1GR
7730	10	100	100	1	1009	1014u	1044u	1074u		7730	PSJoao--1GR
6716	10	100	100	2	1010	1015u	1045u	1075u		6716	Maua----2GR
35000	10	45	45	1	1100	1100u	1140u	1170u		35000	MASCAREN-1GR
35000	20	55	55	1	1101	1101u	1141u	1171u		35000	MASCAREN-1GR
35001	10	100	100	2	1102	1102u	1142u	1172u		35001	SUICA---2GR
35002	10	100	100	2	1103	1103u	1143u	1173u		35002	RBONITO--2GR
1	10	100	100	3	1200	1200u	1240u			1	PAFO-1G1-3GR
4	10	100	100	1	1201	1202u	1242u			4	PAFO-2G1-1GR
5	10	100	100	1	1201	1203u	1243u			5	PAFO-2G2-1GR
6	10	100	100	1	1201	1204u	1244u			6	PAFO-2G3-1GR
7	10	100	100	1	1202	1205u	1245u			7	PAFO-2G4-1GR
8	10	100	100	1	1202	1206u	1246u			8	PAFO-2G5-1GR
9	10	100	100	1	1202	1207u	1247u			9	PAFO-2G6-1GR
10	10	100	100	2	1203	1208u	1248u			10	PAFO-3G1-2GR
11	10	100	100	2	1203	1210u	1250u			11	PAFO-3G2-2GR
14	10	100	100	6	1204	1211u	1251u	1271u		14	PAFO-4G1-6GR
28	10	100	100	2	1205	1213u	1253u			28	ASALESG1-2GR
29	10	100	100	2	1205	1215u	1255u			29	ASALESG2-2GR
33	10	100	100	3	1206	1217u	1257u	1272u		33	LGONZAG1-3GR
34	10	100	100	3	1207	1219u	1259u	1273u		34	LGONZAG2-3GR
89	10	100	100	6	1208	1221u	1261u	1274u		89	XINGO---6GR
841	10	100	100	1	1212	1231u				841	RCD-SIE--1CS
941	10	100	100	1	1213	1232u				941	RCD-ALS--1CS
428	10	100	100	1	1212	1233u				428	TERESINA-1CS
44	10	100	100	2	1210	1226u	1266u			44	BOAESP-1-2GR
46	10	100	100	2	1211	1228u	1268u	1277u		46	BOAESP-2-2GR
81	10	100	100	5	1214	1235u	1269u	1278u		81	CAMACARI-5GR
874	10	100	100	2	1213	1234u				874	CAMACARI-2CS
21	10	100	100	6	1209	1223u	1263u	1275u		21	SOBRADIN-6GR
485	10	100	100	1	1215	1237u				485	BULAPA---1CS
483	10	100	100	1	1216	1238u				483	IRECE---1CS
938	10	100	100	2	1308	1308u				938	FDUTRA---2CS
939	10	100	100	3	1310	1310u				939	IMPERATR-3CS
199	10	100	100	1	1306	1307u				199	MARABA---1CS
50	10	100	100	5	1300	1300u	1340u	1370u		50	TUCURUI1-5GR
52	10	100	100	3	1301	1301u	1341u	1371u		52	TUCURUI2-3GR
54	10	100	100	4	1303	1303u	1342u	1372u		54	TUCURUI3-4GR
70	10	100	100	4	1304	1305u	1343u	1373u		70	TUCURUI5-4GR
71	10	100	100	7	1304	1311u	1344u	1374u		71	TUCURUI6-7GR
898	10	100	100	2	1306	1306u				898	VCONDE---2CS
813	10	100	100	1	98					813	ALU_BINF-1GR
26400	10	100	100	2	1403	1403u	1443u	1473u		26400	JUBA-1---2GR
26401	10	100	100	2	1403	1406u	1446u	1476u		26401	JUBA-2---2GR
26405	10	100	100	2	1404	1404u	1444u	1474u		26405	JAURU---2GR
26404	10	100	100	3	1405	1405u	1445u	1475u		26404	GUAPORE--3GR
167	10	100	100	5	1500	1500u	1540u	1570u		167	LAJEADO--5GR
4383	10	75	75	6	1600	1600u	1640u			4383	UTELSOBR-6GR
4383	20	25	25	2	1601	1601u	1641u			4383	UTELSOBR-2GR
4394	10	100	100	12	1700	1700u	1740u			4394	UTEMLAGO12GR
4396	10	100	100	8	1701	1701u	1741u			4396	UTEMLAGO-8GR
433	10	100	100	2	1803	1800u	1840u	1870u		433	UTEJSFER-2GR
4391	10	57	57	2	1900	1900u	1940u	1970u		4391	UTLBRZG1-2GR
4391	20	43	43	1	1902	1902u	1942u	1972u		4391	UTLBRZ18-1GR
4402	10	67	67	2	1900	1903u	1943u	1973u		4402	UTLBRZG2-2GR
4402	20	33	33	1	1901	1905u	1945u	1975u		4402	UTLBRZ28-1GR
4400	10	67	67	2	1900	1906u	1946u	1976u		4400	UTLBRZG3-2GR
4400	20	33	33	1	1901	1908u	1948u	1978u		4400	UTLBRZ38-1GR
4051	10	100	100	3	2000	2000u	2040u	2070u		4051	N.FLU-G1-3GR
4049	10	100	100	1	2001	2001u	2041u	2071u		4049	N.FLU-V1-1GR
95	10	100	100	3	2100	2100u	2140u	2170u		95	ITAPEBI--3GR
26406	10	100	100	1	2200	2200u	2240u	2270u		26406	ITIQ-M1--1GR
26412	10	100	100	1	2201	2201u	2241u	2271u		26412	ITIQ-M2--1GR
170	10	100	100	1	2300	2300u	2340u	2370u		170	UTETBAHI-1GR
3600	10	100	100	2	2400	2400u	2440u	2470u		3600	SIMPLICI-2GR
4494	10	100	100	1	2500	2500u	2540u	2570u		4494	PIRAJU---1GR
8717	10	100	100	1	2600	2600u	2640u	2670u		8717	STIARAJU-1GR
4397	10	100	100	1	2601	2601u	2641u	2671u		4397	UTACHAVG-1GR
4423	10	100	100	1	2602	2602u	2642u	2672u		4423	UTACHAVV-1GR

Appendix C. Brazilian Power System

4392	10	100	100	2	2603	2603u		2673u	4392	UTCPRESA-2GR
4393	10	100	100	2	2603	2604u		2674u	4393	UTCPRESB-2GR
4374	10	100	100	1	2605	2605u	2645u		4374	UTEROCHG-1GR
4384	10	100	100	1	2606	2606u	2646u		4384	UTEROCHV-1GR
339	10	100	100	4	2700	2700u	2740u	2770u	339	TERMOCEG-4GR
327	10	100	100	2	2900	2900u	2940u	2970u	327	TERMFTEG-2GR
330	10	100	100	1	2901	2901u	2941u	2971u	330	TERMFTEV-1GR
8759	10	100	100	2	3000	3000u	3040u	3070u	8759	QQUEIXO--2GR
160	10	100	100	2	3100	3100u	3140u	3170u	160	TERMOPEG-2GR
161	10	100	100	1	3101	3101u	3141u	3171u	161	TERMOPEV-1GR
7303	10	100	100	2	3200	3200u	3240u	3270u	7303	BGRANDE--2GR
48	10	100	100	2	3300	3300u	3340u	3370u	48	P. CAVALO-2GR
4483	10	100	100	2	3301	3301u			4483	OURINHOS-2GR
1437	10	100	100	1	3302	3302u	3342u	3372u	1437	PICADA---1GR
26407	10	100	100	2	3400	3400u	3440u	3470u	26407	P. PEDRA--2GR
7309	10	100	100	1	3500	3500u	3540u	3570u	7309	MCLARO---1GR
7311	10	100	100	2	3501	3501u	3541u	3571u	7311	CALVES---2GR
7313	10	100	100	1	3502	3502u	3542u	3572u	7313	14JULHO--1GR
4386	10	100	100	1	3600	3600u	3640u	3670u	4386	JFORA-A--1GR
4387	10	100	100	1	3600	3601u	3641u	3671u	4387	JFORA-B--1GR
1442	10	100	100	2	3700	3700u	3740u	3770u	1442	STACLARA-2GR
1423	10	100	100	2	3800	3800u	3840u	3870u	1423	R. NEVES--2GR
3599	10	100	100	3	3900	3900u	3940u	3970u	3599	PEIXEANG-3GR
1424	10	100	100	2	4000	4000u	4040u	4070u	1424	AMADORAL-2GR
1425	10	100	100	2	4001	4001u	4041u	4071u	1425	AMADORA2-2GR
7301	10	100	100	2	4100	4100u	4140u	4170u	7301	CNOVOS---2GR
4371	10	100	100	1	4300	4300u	4340u	4370u	4371	CORUMBA4-1GR
23310	10	100	100	2	4400	4400u	4440u	4470u	23310	ESPORA---2GR
9512	10	100	100	3	4702	4702u	4742u	4772u	9512	UTETN2-G-3GR
9514	10	100	100	1	4703	4703u	4743u	4773u	9514	UTETN2-V-1GR
9511	10	100	100	4	4704	4704u	4744u		9511	UTETN1---4GR
9501	10	100	100	4	4705	4705u	4745u	4775u	9501	UHSAMUE-4GR
9518	10	100	100	3	4706	4706u	4746u	999991u	9518	UHEROND2-3GR
413	10	100	100	1	4803	4803u	4843u		413	UTEMANAU-1GR
412	10	100	100	1	4802	4802u	4842u		412	UTEPPFERR-1GR
16402	10	100	100	2	4800	4800u	4840u		16402	UTEPOTI1-2GR
16403	10	100	100	3	4801	4801u	4841u		16403	UTEPOTI3-3GR
108	10	100	100	8	4805	4805u	4845u		108	UTEMURIC-8GR
109	10	100	100	60	4804	4804u			109	UTEAREMB60GR
128	10	100	100	60	4807	4810u	4850u		128	UTEGLOBI60GR
129	10	100	100	60	4807	4811u	4851u		129	UTEGLOII60GR
801	10	100	100	1	4808	4812u	4852u	4872u	801	PITAIQUI--1GR
3583	10	100	100	2	4900	4900u	4940u	4970u	3583	R. BALXO--2GR
4540	10	50	50	1	5000	5000u		5070u	4540	CSA-G1---1GR
4540	20	50	50	1	5000	5002u		5072u	4540	CSA-G2---1GR
4539	10	100	100	1	5001	5001u		5071u	4539	CSA-V---1GR
4405	10	50	50	5	5100	5100u	5140u		4405	VIANA-A--5GR
4405	20	50	50	5	5100	5101u	5141u		4405	VIANA-B--5GR
(4406	10	100	100	32	5101	5102u	5142u	5172u	4406	UTELINHA24GR
4364	10	100	100	4	5300	5300u	5340u	5370u	4364	DARDANE1-4GR
4360	10	100	100	1	5301	5301u	5341u	5371u	4360	DARDANE2-1GR
80	10	100	100	8	5400	5400u	5440u	5470u	80	ESTREITO-8GR
8712	10	100	100	1	5500	5500u	5540u	5570u	8712	CANDIOT3-1GR
7305	10	100	100	2	5600	5600u	5640u	5670u	7305	FCHAPECO-2GR
4343	10	100	100	1	5720	5720u	5760u	5780u	4343	CACU-----1GR
4344	10	100	100	1	5721	5721u	5761u	5781u	4344	SALTO-----1GR
4342	10	100	100	1	5722	5722u	5762u	5782u	4342	B. COQUEI-1GR
4331	10	100	100	1	5723	5723u	5763u	5783u	4331	S. R. VERD-1GR
4341	10	100	100	1	5724	5724u	5764u	5784u	4341	FRCLARO--1GR
4336	10	100	100	1	5800	5800u	5840u	5870u	4336	SERRAFAC-1GR
5194	10	50	50	4	6000	6000u	6040u	6070u	5194	SANTO-MD-4GR
5194	20	50	50	4	6000	6001u	6041u	6071u	5194	SANTO-MD-4GR
5193	10	100	100	4	6000	6002u	6042u	6072u	5193	SANTO-LE-4GR
5213	10	100	100	8	6000	6003u	6043u	6073u	5213	SANTO-LE-8GR
5192	10	100	100	8	6000	6004u	6044u	6074u	5192	SANTO-ME-8GR
5212	10	100	100	16	6000	6005u	6045u	6075u	5212	SANTO-ME16GR
5191	10	100	100	25	6100	6100u	6140u	6170u	5191	JIRAU-MD25GR
5190	10	100	100	18	6101	6101u	6141u	6171u	5190	JIRAU-ME18GR
13003	10	100	100	2	4810	4815u	4855u	4875u	13003	MARANIVG-2GR
13007	10	100	100	1	1315	40041u	40042u	40052u	13007	MARANIVG-1GR
13008	10	100	100	2	4810	4816u	4856u	4876u	13008	MARANV-G-2GR
13009	10	100	100	1	1315	4413u	4433u	4453u	13009	MARANV-V-1GR
13016	10	100	100	2	1311	1315u	8345u	8375u	13016	MARAN3-G-2GR
(13029	10	100	100	1	4810	4817u	4857u	4877u	13029	N. VENEZ2-1GR
104	10	100	100	23	4809	4818u	4858u	4878u	104	UTEPERN323GR
101	10	100	100	16	6020	6021u	6022u		101	UTESUAP216GR
11001	10	100	100	2	4808	4813u	4853u	4873u	11001	FPECEMI--2GR
11010	10	100	100	1	4808	4814u	4854u	4874u	11010	FPECEM2--1GR
8735	10	100	100	2	6400	6400u	6440u	6470u	8735	UHSROQUE-2GR
6609	10	100	100	2	6500	6500u	6540u	6570u	6609	BIGUACU -2GR
4398	10	65	65	2	2687	2687u	2667u	2697u	4398	BALXFLUG-2GR
4398	20	35	35	1	2688	2688u	2668u	2698u	4398	BALXFLUV-1GR
307	10	100	100	23	6324	6324u	6424u		307	UTE1JAGB23GR
11015	10	100	100	23	6329	6329u	6429u		11015	UTE1JAGB23GR
11016	10	100	100	9	6330	6330u	6430u		11016	UTE2JAGA-9GR
11017	10	100	100	9	6326	6326u	6426u		11017	UTE2JAGB-9GR

Appendix C. Brazilian Power System

139	10	100	100	3	9100	9100u	9102u		139	TERMCABO-3GR
196	10	100	100	20	9325	9325u	9425u		196	UTEGRAN20GR
130	10	100	100	20	7803	7804u	7814u		130	TERMOPAR20GR
137	10	100	100	20	7803	7803u	7813u		137	TERMONE 20GR
135	10	100	100	8	7802	7802u	7812u	7872u	135	MARACAT1-8GR
102	10	100	100	3	7805	7805u	7815u		102	MARACAT2-3GR
40201	10	100	100	1	5501	136u	166u	347u	40201	ANTA-----1GR
10020	10	100	100	2	7000	7000u	7040u		10020	C.NUNES1-2GR
10021	10	100	100	1	7001	7001u	7041u		10021	C.NUNES2-1GR
10411	10	100	100	1	7104	7104u	7144u		10411	BALBINA1-1GR
10412	10	100	100	1	7104	40061u	40032u		10412	BALBINA2-1GR
10413	10	100	100	1	7104	40033u	40034u		10413	BALBINA3-1GR
10414	10	100	100	1	7104	40035u	40036u		10414	BALBINA4-1GR
10415	10	100	100	1	7104	40037u	40038u		10415	BALBINA5-1GR
10471	10	100	100	19	7112	7112u	7152u		10471	PIE-JRQ-19GR
10447	10	100	100	19	7113	7113u	7153u		10447	PIE-TBQ-19GR
10436	10	100	100	4	7107	7109u	7149u		10436	PIE_MANA-4GR
10391	10	100	100	4	7108	7110u	7150u		10391	PIE-GERA-4GR
10406	10	100	100	2	7109	7111u	7151u		10406	CROCHA_E-2GR
4941	10	78	78	14	8101	80501u	80502u	80503u	4941	BM-----14GR
4941	20	22	22	4	8102	80513u	80514u	80515u	4941	BM-IMPIS-4GR
195	10	100	100	6	8103	80551u	80552u	80553u	195	BM-SECUN-6GR
7227	10	100	100	1	4005	2803u	2804u		7227	UHTELBOR-1GR
8730	10	100	100	2	4030	2821u	2822u		8730	UHGARIBA-2GR
4373	10	100	100	1	1511	2827u	2828u		4373	UH-CORUM-1GR
4583	10	100	100	2	8896	8896u	8887u	8892U	4583	COLIDER--2GR
4589	10	100	100	4	8883	8883u	8888u	8891U	4589	T.PIRES -4GR
4581	10	100	100	3	8881	8881u	8886u	8899U	4581	SINOP -3GR
4585	10	100	100	4	8885	8885u	8890u	8893U	4585	SMANOEL -4GR
4587	10	100	100	1	8884	8884u	8889u		4587	F.APLAC -1GR
10082	10	100	100	3	6081	4271u	4272u		10082	F.GOMES -3GR
10084	10	100	100	3	6080	4261u	4262u	4263u	10084	S.A.JARI-3GR
10171	10	100	100	3	8304	8312u	8322U	8332U	10171	CACH. CA-3GR
41970	10	100	100	4	8305	8313U	8323U980522U		41970	SANT.ADI-4GR
38079	10	100	100	1	8307	8315U	8325U	8335U	38079	ITAOCARI-1GR
4334	10	100	100	2	8308	8316U	8326U	8336U	4334	DAVINOPO-2GR
50205	10	100	100	1	8311	8319U	8329U	8339U	50205	COMISSIO-1GR
50207	10	100	100	1	8312	8320U	8330U	8340U	50207	F.PIQUIR-1GR
8716	10	100	100	1	5013	2859u	2860u		8716	CANOAS2 -1GR
357	10	91	91	2	1512	2849u	2850u		357	FAFEN-1 -2GR
357	20	9	9	1	1518	2851u	2852u		357	FAFEN-2 -1GR
5202	10	100	100	3	138	999124U				
999999										
DCLI										
10	20	1			1231.9					
50	60	1			1231.9					
90	100	1			1231.9					
130	140	1			1231.9					
1101	1102	1			2673.0					
1105	1106	1			2673.0					
1109	1110	1			2691.0					
1113	1114	1			2691.0					
2101	2102	1			80.00					
2105	2106	1			80.00					
3101	3102	1			2497.0					
3105	3106	1			2497.0					
3109	3110	1			2987.0					
3113	3114	1			2987.0					
4101	4102	1			2497.0					
4105	4106	1			2497.0					
999999										
DELO										
0001		1								
0002		1								
0003		1								
0004		1								
1001		1								
1002		1								
3001		2								
3002		2								
3003		2								
3004		2								
4001		2								
4002		2								
999999										
DCNV										
1		5.	163.		01	0193u				
2		100.		17.	02					
3		5.	163.		01	0194u				
4		100.		17.	02					
5		5.	163.		01	0195u				
6		100.		17.	02					
7		5.	163.		01	0196u				
8		100.		17.	02					
1201					101	9301u				
1202					102					
1203					101	9303u				
1204					102					
1205					9009u					
1206					9010u					
1207					9011u					
1208					9012u					

Appendix C. Brazilian Power System


```

2201          9321 U
2202          9322 U
2203          9323 U
2204          9324 U
3201          301
3202          302
3203          301
3204          302
3205          303
3206          304
3207          303
3208          304
4201          4201
4202          4202
4203          4201
4204          4202
8011          1393u
8012          1394u
8021          1395u
8022          1396u
8031          1397u
8032          1398u
999999
DFCM
  2      14.1 0.016
  4      14.1 0.016
  6      14.1 0.016
  8      14.1 0.016
1202 0.8      0.016
1204 0.8      0.016
1206 0.8      0.016
1208 0.8      0.016
2202 0.8      .016
2204 0.8      .016
3202 0.8      0.016
3204 0.8      0.016
3206 0.8      0.016
3208 0.8      0.016
4202 0.8      0.016
4204 0.8      0.016
999999
ULOG
1
DCER-2020.DAT
DLOC
1296 CIRCAC 58511594 1 585
1497 CIRCAC 953441967 1
999999
DCNE IMPR
9000 9300u
9315 9315U
999999
DCSC
4431 3895 1 199u
 539 736 1 1391u
5000 3895 1 2890u
 539 758 1 2891u
999999
ULOG
1
DPLT.DAT
DCAR
AREA 1 A AREA 118          100 0 0 100
999999
DSIM
  1.0 .0005 51
EXSI
DSIM
 20.0 .001 11
EXSI
FIM

```

Appendix D

Nordic 44 System

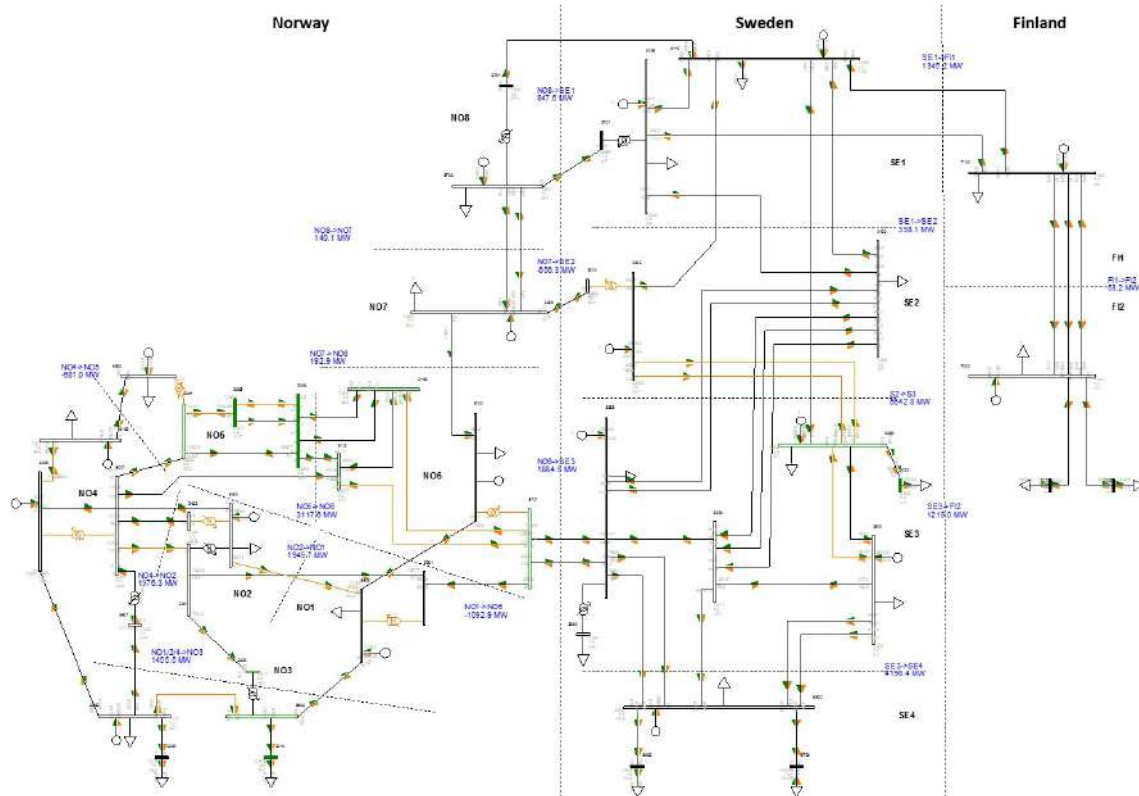

D.1 Power Flow Data File

```

0, 1000.00, 33, 0, 1, 50.00 / PSS@E-33.0 TUE, FEB 23 2016 17:21
REDUCED NORDEL POWER SYSTEM MODEL
V 3.2, 12.08.97
3000,' , 420.0000,2, 23, 1, 1,0.92761, 5.8273,1.10000,0.90000,1.10000,0.90000
3020,' , 420.0000,1, 23, 1, 1,0.92083, 5.0096,1.10000,0.90000,1.10000,0.90000
3100,' , 420.0000,1, 22, 1, 1,1.02520, 0.0345,1.10000,0.90000,1.10000,0.90000
3115,' , 420.0000,2, 21, 1, 1,1.00000, 14.7999,1.10000,0.90000,1.10000,0.90000
3200,' , 420.0000,1, 23, 1, 1,1.01081, -2.0829,1.10000,0.90000,1.10000,0.90000
3244,' , 300.0000,1, 22, 1, 1,0.94693, 32.3216,1.10000,0.90000,1.10000,0.90000
3245,' , 420.0000,2, 22, 1, 1,0.94430, 33.1359,1.10000,0.90000,1.10000,0.90000
3249,' , 420.0000,2, 21, 1, 1,1.00000, 8.1348,1.10000,0.90000,1.10000,0.90000
3300,' , 420.0000,3, 23, 1, 1,1.00000, 0.0000,1.10000,0.90000,1.10000,0.90000
3359,' , 420.0000,2, 23, 1, 1,1.00000, 1.5693,1.10000,0.90000,1.10000,0.90000
3360,' , 135.0000,1, 23, 1, 1,0.99657, 2.0240,1.10000,0.90000,1.10000,0.90000
3701,' , 300.0000,1, 21, 1, 1,0.99020, 12.8634,1.10000,0.90000,1.10000,0.90000
5100,' , 300.0000,2, 16, 1, 1,0.96635, 16.2245,1.10000,0.90000,1.10000,0.90000
5101,' , 420.0000,1, 16, 1, 1,0.94132, 17.0334,1.10000,0.90000,1.10000,0.90000
5102,' , 420.0000,1, 16, 1, 1,0.90977, 28.7651,1.10000,0.90000,1.10000,0.90000
5103,' , 420.0000,1, 16, 1, 1,0.89892, 30.5380,1.10000,0.90000,1.10000,0.90000
5300,' , 300.0000,2, 15, 1, 1,0.99978, 76.5239,1.10000,0.90000,1.10000,0.90000
5301,' , 420.0000,1, 15, 1, 1,0.92864, 60.4580,1.10000,0.90000,1.10000,0.90000
5304,' , 420.0000,1, 15, 1, 1,0.88780, 44.8952,1.10000,0.90000,1.10000,0.90000
5305,' , 420.0000,1, 15, 1, 1,0.90520, 46.8155,1.10000,0.90000,1.10000,0.90000
5400,' , 300.0000,2, 12, 1, 1,1.00700, 41.1229,1.10000,0.90000,1.10000,0.90000
5401,' , 420.0000,1, 12, 1, 1,0.97114, 34.7164,1.10000,0.90000,1.10000,0.90000
5402,' , 420.0000,1, 12, 1, 1,0.99435, 41.6981,1.10000,0.90000,1.10000,0.90000
5500,' , 300.0000,2, 11, 1, 1,1.00400, 9.8673,1.10000,0.90000,1.10000,0.90000
5501,' , 420.0000,1, 11, 1, 1,0.99740, 11.5690,1.10000,0.90000,1.10000,0.90000
5600,' , 300.0000,2, 13, 1, 1,1.01000, 35.4190,1.10000,0.90000,1.10000,0.90000
5601,' , 300.0000,1, 13, 1, 1,1.00428, 41.9598,1.10000,0.90000,1.10000,0.90000
5602,' , 420.0000,1, 13, 1, 1,0.94069, 23.2151,1.10000,0.90000,1.10000,0.90000
5603,' , 300.0000,1, 13, 1, 1,0.90940, 21.8044,1.10000,0.90000,1.10000,0.90000
5610,' , 300.0000,1, 13, 1, 1,0.90525, 20.8216,1.10000,0.90000,1.10000,0.90000
5620,' , 300.0000,1, 13, 1, 1,1.00826, 35.1860,1.10000,0.90000,1.10000,0.90000
6000,' , 300.0000,2, 14, 1, 1,0.99256, 43.2509,1.10000,0.90000,1.10000,0.90000
6001,' , 420.0000,1, 14, 1, 1,0.98625, 42.1113,1.10000,0.90000,1.10000,0.90000
6100,' , 300.0000,2, 14, 1, 1,1.00000, 85.7523,1.10000,0.90000,1.10000,0.90000
6500,' , 300.0000,2, 17, 1, 1,1.00000, 25.2866,1.10000,0.90000,1.10000,0.90000
6700,' , 300.0000,2, 18, 1, 1,1.02000, 32.1411,1.10000,0.90000,1.10000,0.90000
6701,' , 420.0000,1, 18, 1, 1,1.00390, 31.3250,1.10000,0.90000,1.10000,0.90000
7000,' , 420.0000,2, 32, 1, 1,1.00000, 7.2874,1.10000,0.90000,1.10000,0.90000
7010,' , 420.0000,1, 32, 1, 1,0.99389, 7.9901,1.10000,0.90000,1.10000,0.90000
7020,' , 420.0000,1, 32, 1, 1,1.00003, 7.0908,1.10000,0.90000,1.10000,0.90000
7100,' , 420.0000,2, 31, 1, 1,1.00000, 7.1215,1.10000,0.90000,1.10000,0.90000
8500,' , 420.0000,2, 24, 1, 1,0.95815, -11.8643,1.10000,0.90000,1.10000,0.90000
8600,' , 420.0000,1, 24, 1, 1,0.95803, -12.2052,1.10000,0.90000,1.10000,0.90000
8700,' , 420.0000,1, 24, 1, 1,0.95813, -12.2563,1.10000,0.90000,1.10000,0.90000
0 / END OF BUS DATA, BEGIN LOAD DATA
3000,'1',1, 23, 1, 4199.819, 1701.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
3020,'1',1, 23, 1, 1219.000, 616.000, 0.000, 0.000, 0.000, 0.000, 1,0,0
3100,'1',1, 22, 1, 611.944, 110.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
3115,'1',1, 21, 1, 611.944, 650.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
3244,'1',1, 21, 1, 2231.971, 650.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
3300,'1',1, 23, 1, 2399.216, 800.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
3359,'1',1, 23, 1, 5758.100, 2400.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
3360,'1',1, 23, 1, -330.000, 262.000, 0.000, 0.000, 0.000, 0.000, 1,0,0
5100,'1',1, 16, 1, 1137.339, 70.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
5300,'1',1, 15, 1, 2612.342, -70.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
5400,'1',1, 12, 1, 1133.003, 100.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
5500,'1',1, 11, 1, 4342.567, 400.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
5600,'1',1, 13, 1, 1330.038, 250.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
5610,'1',1, 13, 1, 1412.000, 363.000, 0.000, 0.000, 0.000, 0.000, 1,0,0
5620,'1',1, 13, 1, 414.000, 175.000, 0.000, 0.000, 0.000, 0.000, 1,0,0
6100,'1',1, 14, 1, 2364.529, 800.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
6500,'1',1, 17, 1, 2994.684, 999.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
6700,'1',1, 18, 1, 2452.704, 150.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
7000,'1',1, 32, 1, 7851.452, 350.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
7010,'1',1, 32, 1, -1219.000, 600.000, 0.000, 0.000, 0.000, 0.000, 1,0,0
7020,'1',1, 32, 1, 343.000, -4.000, 0.000, 0.000, 0.000, 0.000, 1,0,0
7100,'1',1, 31, 1, 2821.605, 400.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
8500,'1',1, 24, 1, 3665.753, 1299.000, 0.000, 0.000, 0.000, 0.000, 1,1,0
8600,'1',1, 24, 1, 546.000, 10.000, 0.000, 0.000, 0.000, 0.000, 1,0,0
8700,'1',1, 24, 1, 628.000, 0.000, 0.000, 0.000, 0.000, 0.000, 1,0,0
0 / END OF LOAD DATA, BEGIN FIXED SHUNT DATA
0 / END OF FIXED SHUNT DATA, BEGIN GENERATOR DATA
3000,'1', 2000.000, 1934.000, 1934.000, -1934.000,1.00000, 0, 2600.000, 0.00000E+0, 2.25000E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 2625.750, 0.000, 1,1.0000
3115,'1', 1700.000, 358.659, 1866.000, -1866.000,1.00000, 0, 2200.000, 0.00000E+0, 2.30000E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 2000.000, 0.000, 1,1.0000
3245,'1', 6599.000, 670.000, 670.000, -670.000,1.00000, 0, 8064.000, 0.00000E+0, 1.53850E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 7258.000, 0.000, 1,1.0000
3249,'1', 2048.000, 485.973, 1972.000, -1972.000,1.00000, 0, 2714.000, 0.00000E+0, 2.10000E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 2583.000, 0.000, 1,1.0000
3300,'1', 2223.852, 2883.988, 2301.000, -2301.000,1.00000, 0, 3300.000, 0.00000E+0, 1.60000E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 2250.000, 0.000, 1,1.0000
3359,'1', 5400.000, 3281.928, 4915.000, -4915.000,1.00000, 0, 6750.000, 0.00000E+0, 1.93750E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 5679.330, 0.000, 1,1.0000
5100,'1', 972.000, 849.990, 849.990, -849.990,1.00000, 0, 1199.990, 0.00000E+0, 1.51350E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 976.060, 0.000, 1,1.0000
5300,'1', 6151.000, 1700.000, 1700.000, -1700.000,1.00000, 0, 7518.020, 0.00000E+0, 2.60000E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 6213.670, 0.000, 1,1.0000
5400,'1', 1858.000, 1409.123, 1800.000, -1800.000,1.00700, 0, 2450.000, 0.00000E+0, 1.60000E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 1873.440, 0.000, 1,1.0000
5500,'1', 1132.000, 601.322, 1200.000, -1200.000,1.00400, 0, 1450.000, 0.00000E+0, 2.28250E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 1142.370, 0.000, 1,1.0000

```

Appendix D. Nordic 44 System

```

5600,'1', 1774.000, 1123.709, 1700.000, -1700.000,1.01000, 0, 3299.990, 0.00000E+0, 2.80000E-1, 0.00000E+0,
0.00000E+0,0.99900,1, 100.0, 1788.280, 0.000, 1,1.0000
6000,'1', 523.000, 500.000, 500.000, -500.000,1.00500, 0, 680.000, 0.00000E+0, 2.80000E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 620.000, 0.000, 1,1.0000
6100,'1', 4730.000, 1276.413, 4500.010, -4500.010,1.00000, 0, 6200.010, 0.00000E+0, 1.80000E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 4750.000, 0.000, 1,1.0000
6500,'1', 2442.000, 1190.436, 2400.000, -2400.000,1.00000, 0, 3299.990, 0.00000E+0, 1.58020E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 2454.550, 0.000, 1,1.0000
6700,'1', 3506.000, 66.699, 1800.000, -1800.000,1.02000, 0, 4290.010, 0.00000E+0, 1.70620E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 3509.090, 0.000, 1,1.0000
7000,'1', 7038.000, 751.025, 6377.000, -6377.000,1.00000, 0, 8946.000, 0.00000E+0, 2.25000E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 7186.260, 0.000, 1,1.0000
7100,'1', 1620.000, 533.564, 1400.000, -1400.000,1.00000, 0, 2000.000, 0.00000E+0, 1.53850E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 1800.000, 0.000, 1,1.0000
8500,'1', 754.000, 917.000, 917.000, -917.000,1.02000, 0, 1300.000, 0.00000E+0, 1.70620E-1, 0.00000E+0,
0.00000E+0,1.00000,1, 100.0, 1183.000, 0.000, 1,1.0000
0 / END OF GENERATOR DATA, BEGIN BRANCH DATA
3000, 3020,'1', 0.00000E+0, 1.00000E-2, 0.00000, 0.00, 0.00, 0.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3000, 3115,'1', 7.50000E-2, 9.00000E-1, 0.50000, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
3000, 3245,'1', 8.00000E-3, 1.20000E-1, 0.05000, 1200.00, 1600.00, 1800.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
3000, 3245,'2', 1.80000E-2, 2.00000E-1, 0.05000, 800.00, 1300.00, 1600.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
3000, 3300,'1', 6.00000E-3, 8.00000E-2, 0.03000, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3000, 3300,'2', 9.00000E-3, 1.00000E-1, 0.02500, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3100, 3115,'1', 3.00000E-2, 4.00000E-1, 0.11000, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
3100, 3200,'1', 4.00000E-2, 2.40000E-1, 0.20000, 1200.00, 2000.00, 2500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3100, 3200,'2', 4.00000E-2, 2.40000E-1, 0.20000, 1200.00, 2000.00, 2500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3100, 3200,'3', 4.00000E-2, 2.40000E-1, 0.20000, 1200.00, 2000.00, 2500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3100, 3249,'1', 3.00000E-2, 4.30000E-1, 0.16000, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
3100, 3359,'1', 8.00000E-2, 5.00000E-1, 0.25000, 900.00, 1300.00, 1600.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3100, 3359,'2', 4.00000E-2, 2.30000E-1, 0.24000, 1200.00, 2000.00, 2500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3115, 3245,'1', 4.50000E-2, 5.00000E-1, 0.14000, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3115, 3249,'1', 1.50000E-2, 2.00000E-1, 0.08000, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3115, 6701,'1', 4.00000E-2, 4.00000E-1, 0.10000, 850.00, 1000.00, 1100.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
3115, 7100,'1', 4.00000E-2, 1.30000E-1, 0.13000, 1300.00, 1500.00, 1700.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3200, 3300,'1', 2.00000E-2, 2.00000E-1, 0.06000, 800.00, 1100.00, 1300.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3200, 3359,'1', 1.00000E-2, 2.00000E-1, 0.07000, 1300.00, 1800.00, 2000.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3200, 8500,'1', 1.00000E-2, 1.70000E-1, 0.06000, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3244, 6500,'1', 1.00000E-2, 2.00000E-1, 0.06000, 1800.00, 2300.00, 2500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
3249, 7100,'1', 2.00000E-2, 7.50000E-2, 0.07800, 1300.00, 1500.00, 1700.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3300, 8500,'1', 2.00000E-2, 2.30000E-1, 0.06000, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3300, 8500,'2', 1.20000E-2, 2.70000E-1, 0.10000, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3359, 5101,'1', 1.60000E-2, 2.60000E-1, 0.09000, 1900.00, 2200.00, 2600.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
3359, 5101,'2', 2.00000E-2, 2.20000E-1, 0.06000, 1600.00, 2000.00, 2500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3359, 8500,'1', 1.20000E-2, 2.70000E-1, 0.10000, 1500.00, 2000.00, 2500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3359, 8500,'2', 2.50000E-2, 3.20000E-1, 0.09000, 1100.00, 1300.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
3701, 6700,'1', 2.50000E-1, 2.00000E+0, 0.03000, 300.00, 400.00, 500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5100, 5500,'1', 2.70000E-2, 2.60000E-1, 0.04400, 700.00, 800.00, 900.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5100, 6500,'1', 8.00000E-2, 9.00000E-1, 0.06000, 800.00, 900.00, 950.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
5101, 5102,'1', 8.00000E-3, 1.00000E-1, 0.09000, 1700.00, 1800.00, 1900.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5101, 5103,'1', 1.00000E-2, 1.40000E-1, 0.04000, 1350.00, 1600.00, 1800.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5101, 5501,'1', 1.00000E-2, 1.50000E-1, 0.55000, 2000.00, 2200.00, 2500.00, 0.02230, -0.97440, -0.02160,
0.97440,1,2, 0.00, 1,1.0000
5102, 5103,'1', 4.00000E-3, 7.00000E-2, 0.03000, 2000.00, 2200.00, 2400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
5102, 5304,'1', 1.70000E-2, 2.40000E-1, 0.07000, 1500.00, 1800.00, 2000.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5102, 6001,'1', 3.00000E-2, 4.60000E-1, 0.13000, 1450.00, 1700.00, 2000.00, 0.00020, 0.00010, 0.00020, -
0.00010,1,2, 0.00, 1,1.0000
5103, 5304,'1', 2.00000E-2, 2.50000E-1, 0.07000, 1000.00, 1200.00, 1400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5103, 5304,'2', 1.30000E-2, 2.00000E-1, 0.06000, 1500.00, 1800.00, 2000.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000

```

Appendix D. Nordic 44 System

```

5300, 6100,'1 ', 2.10000E-2, 2.20000E-1, 0.01000, 800.00, 900.00, 950.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5301, 5304,'1 ', 1.00000E-2, 2.00000E-1, 0.06000, 1250.00, 1500.00, 1700.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
5301, 5305,'1 ', 7.00000E-3, 1.20000E-1, 0.03100, 1250.00, 1500.00, 1700.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
5301, 6001,'1 ', 1.30000E-2, 2.00000E-1, 0.05000, 1800.00, 2000.00, 2150.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5304, 5305,'1 ', 1.00000E-2, 1.50000E-1, 0.05000, 1950.00, 2200.00, 2400.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5304, 5305,'2 ', 1.30000E-2, 1.70000E-2, 0.04000, 1350.00, 1400.00, 1500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5400, 5500,'1 ', 9.00000E-3, 9.40000E-1, 0.05000, 400.00, 550.00, 650.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
5400, 6000,'1 ', 3.30000E-2, 3.60000E-1, 0.02500, 800.00, 900.00, 950.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5401, 5501,'1 ', 1.75000E-2, 2.70000E-1, 0.08000, 1500.00, 1800.00, 2000.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
5401, 5602,'1 ', 1.60000E-2, 2.55000E-1, 0.09000, 2200.00, 2400.00, 2600.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
5401, 6001,'1 ', 6.40000E-3, 1.00000E-1, 0.02800, 1250.00, 1500.00, 1700.00, -0.00020, -0.00050, 0.00020,
0.00050,1,2, 0.00, 1,1.0000
5402, 6001,'1 ', 7.00000E-4, 1.00000E-2, 0.00300, 1500.00, 1700.00, 1900.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5500, 5603,'1 ', 5.00000E-2, 6.00000E-1, 0.05000, 800.00, 900.00, 950.00, 0.00030, 0.00130, -0.00030, -
0.00130,1,1, 0.00, 1,1.0000
5600, 5601,'1 ', 3.00000E-2, 3.40000E-1, 0.02000, 800.00, 900.00, 950.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
5600, 5603,'1 ', 2.00000E-2, 2.20000E-1, 0.02000, 900.00, 1050.00, 1200.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
5600, 5620,'1 ', 0.00000E+0, 1.00000E-2, 0.00000, 0.00, 0.00, 0.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
5600, 6000,'1 ', 2.00000E-2, 2.00000E-1, 0.07000, 1350.00, 1500.00, 1650.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
5603, 5610,'1 ', 0.00000E+0, 1.00000E-2, 0.00000, 0.00, 0.00, 0.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
6000, 6100,'1 ', 3.40000E-2, 4.20000E-1, 0.03000, 800.00, 900.00, 950.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
6500, 6700,'1 ', 1.70000E-1, 1.80000E+0, 0.10000, 800.00, 900.00, 950.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
6500, 6700,'2 ', 1.00000E-1, 1.30000E+0, 0.12000, 1000.00, 1200.00, 1300.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
7000, 7010,'1 ', 0.00000E+0, 1.00000E-2, 0.00000, 0.00, 0.00, 0.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
7000, 7020,'1 ', 0.00000E+0, 1.00000E-2, 0.00000, 0.00, 0.00, 0.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
7000, 7100,'1 ', 4.00000E-2, 1.20000E-1, 0.13000, 1040.00, 1200.00, 1500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
7000, 7100,'2 ', 4.00000E-2, 1.20000E-1, 0.13000, 1040.00, 1200.00, 1500.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
7000, 7100,'3 ', 4.00000E-2, 1.40000E-1, 0.13000, 1200.00, 1500.00, 1700.00, 0.00000, 0.00000, 0.00000,
0.00000,1,2, 0.00, 1,1.0000
8500, 8600,'1 ', 0.00000E+0, 1.00000E-2, 0.00000, 0.00, 0.00, 0.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
8500, 8700,'1 ', 0.00000E+0, 1.00000E-2, 0.00000, 0.00, 0.00, 0.00, 0.00000, 0.00000, 0.00000,
0.00000,1,1, 0.00, 1,1.0000
0 / END OF BRANCH DATA, BEGIN TRANSFORMER DATA
3244, 3245, 0,'1 ',1,1,1, 0.00000E+0, 0.00000E+0,2,' ',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
5.00000E-3, 2.00000E-2, 1000.00
1.00000, 0.000, 0.000, 500.00, 0.00, 1, 3245, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
3701, 3249, 0,'1 ',1,1,1, 0.00000E+0, 0.00000E+0,2,' ',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
2.00000E-2, 5.00000E-1, 1000.00
1.00000, 0.000, 0.000, 300.00, 0.00, 1, 3701, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
3359, 3360, 0,'1 ',1,1,1, 0.00000E+0, 0.00000E+0,2,' ',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
5.00000E-3, 2.00000E-2, 1000.00
0.99980, 0.000, 0.000, 1000.00, 9000.00, 9000.00, 1, 3360, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
5101, 5100, 0,'1 ',1,1,1, 0.00000E+0, 0.00000E+0,2,' ',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
8.00000E-4, 3.05000E-2, 1000.00
1.00635, 0.000, 0.000, 1000.00, 9000.00, 9000.00, 1, 5101, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
5300, 5301, 0,'1 ',1,1,1, 0.00000E+0, 0.00000E+0,2,' ',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
1.60000E-3, 6.10000E-2, 1000.00
1.00000, 0.000, 0.000, 2000.00, 9000.00, 9000.00, 1, 5301, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
5400, 5401, 0,'1 ',1,1,1, 0.00000E+0, 0.00000E+0,2,' ',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
3.20000E-3, 1.20000E-1, 1000.00
1.00635, 0.000, 0.000, 1000.00, 9000.00, 9000.00, 1, 5401, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
5400, 5402, 0,'1 ',1,1,1, 0.00000E+0, 0.00000E+0,2,' ',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'

```

Appendix D. Nordic 44 System

```
4.00000E-4, 1.50000E-2, 1000.00
1.00000, 0.000, 0.000, 1000.00, 9000.00, 9000.00, 1, 5402, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
5500, 5501, 0,'1','1,1,1,1, 0.00000E+0, 0.00000E+0,2,' ,',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
4.00000E-4, 1.50000E-2, 1000.00
1.01260, 0.000, 0.000, 1000.00, 9000.00, 9000.00, 1, 5501, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
5601, 6001, 0,'1','1,1,1,1, 0.00000E+0, 0.00000E+0,2,' ,',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
2.00000E-4, 7.60000E-3, 1000.00
1.01806, 0.000, 0.000, 1000.00, 9000.00, 9000.00, 1, 5601, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
5603, 5602, 0,'1','1,1,1,1, 0.00000E+0, 0.00000E+0,2,' ,',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
8.00000E-4, 3.05000E-2, 1000.00
0.96825, 0.000, 0.000, 1000.00, 9000.00, 9000.00, 1, 5602, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
6000, 6001, 0,'1','1,1,1,1, 0.00000E+0, 0.00000E+0,2,' ,',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
4.00000E-4, 1.50000E-2, 1000.00
1.00625, 0.000, 0.000, 1000.00, 9000.00, 9000.00, 1, 6001, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
6700, 6701, 0,'1','1,1,1,1, 0.00000E+0, 0.00000E+0,2,' ,',1, 1,1.0000, 0,1.0000, 0,1.0000,
0,1.0000,'
5.00000E-3, 2.00000E-2, 1000.00
1.01250, 0.000, 0.000, 1000.00, 9000.00, 9000.00, 1, 6701, 1.40000, 0.60000, 1.01000, 0.99000, 127, 0,
0.00000, 0.00000, 0.000
1.00000, 0.000
0 / END OF TRANSFORMER DATA, BEGIN AREA DATA
11, 0, 0.000, 10.000,'NO1 '
12, 0, 0.000, 10.000,'NO2 '
13, 0, 0.000, 10.000,'NO3 '
14, 0, 0.000, 10.000,'NO4 '
15, 0, 0.000, 10.000,'NO5 '
16, 0, 0.000, 10.000,'NO6 '
17, 0, 0.000, 10.000,'NO7 '
18, 0, 0.000, 10.000,'NO8 '
21, 0, 0.000, 10.000,'SE1 '
22, 0, 0.000, 10.000,'SE2 '
23, 0, 0.000, 10.000,'SE3 '
24, 0, 0.000, 10.000,'SE4 '
31, 0, 0.000, 10.000,'FI1 '
32, 0, 0.000, 10.000,'FI2 '
0 / END OF AREA DATA, BEGIN TWO-TERMINAL DC DATA
0 / END OF TWO-TERMINAL DC DATA, BEGIN VSC DC LINE DATA
0 / END OF VSC DC LINE DATA, BEGIN IMPEDANCE CORRECTION DATA
0 / END OF IMPEDANCE CORRECTION DATA, BEGIN MULTI-TERMINAL DC DATA
0 / END OF MULTI-TERMINAL DC DATA, BEGIN MULTI-SECTION LINE DATA
0 / END OF MULTI-SECTION LINE DATA, BEGIN ZONE DATA
0 / END OF ZONE DATA, BEGIN INTER-AREA TRANSFER DATA
0 / END OF INTER-AREA TRANSFER DATA, BEGIN OWNER DATA
0 / END OF OWNER DATA, BEGIN FACTS DEVICE DATA
0 / END OF FACTS DEVICE DATA, BEGIN SWITCHED SHUNT DATA
0 / END OF SWITCHED SHUNT DATA, BEGIN GNE DATA
0 / END OF GNE DATA, BEGIN INDUCTION MACHINE DATA
0 / END OF INDUCTION MACHINE DATA
Q
```

D.2 Dynamic Data File

```

/
/ Nordic 44 system
/
3000 'GENROU' 1 5.0000 0.50000E-01 1.0000 0.50000E-01
5.9700 0.0000 2.2200 2.1300 0.36000
0.46800 0.22500 0.16875 0.10890 0.37795 /
/3000 'STAB2A' 1 1.0000 2.0000 0.0000 2.0000
/ 0.55000 1.0000 0.10000E-01 0.30000E-01/
3000 'IEEET2' 1 0.0000 729.00 0.40000E-01 5.3200
-4.0500 1.0000 0.44000 0.66700E-01 2.0000
0.44000 6.5000 0.54000E-01 8.0000 0.20200 /
3000 'IEESGO' 1 0.10000E-01 0.0000 0.15000 0.30000
8.0000 0.40000 0.0000 0.70000 0.43000
1.0000 0.0000 /
3115 'GENSAL' 1 7.5700 0.45000E-01 0.10000 4.7410
0.0000 0.94600 0.56500 0.29000 0.23000
0.11077 0.10239 0.27420 /
/3115 'STAB2A' 1 1.0000 4.5000 0.87000 2.0000
/ 0.87000E-01 1.0000 0.10000E-01 0.40000E-01/
3115 'SCRX' 1 0.25385 13.000 31.000 0.50000E-01
0.0000 4.0000 0.0000 0.0000 /
3115 'HYGOV' 1 0.60000E-01 0.40000 5.0000 0.50000E-01
0.20000 0.10000 1.0000 0.0000 1.0000
1.0577 0.50000 0.10000 /
3245 'GENSAL' 1 5.0000 0.60000E-01 0.10000 3.3000
0.0000 0.75000 0.50000 0.25000 0.15385
0.11538 0.10239 0.27420 /
3245 'SCRX' 1 0.25385 13.000 31.000 0.50000E-01
0.0000 4.0000 0.0000 0.0000 /
3245 'HYGOV' 1 0.60000E-01 0.40000 5.0000 0.50000E-01
0.20000 0.10000 1.0000 0.0000 1.0000
1.0100 0.50000 0.10000 /
3249 'GENSAL' 1 10.130 0.60000E-01 0.10000 4.5430
0.0000 1.0360 0.63000 0.28000 0.21000
0.11538 0.10239 0.27420 /
3249 'SCRX' 1 0.25385 13.000 31.000 0.50000E-01
0.0000 4.0000 0.0000 0.0000 /
3249 'HYGOV' 1 0.60000E-01 0.40000 5.0000 0.50000E-01
0.20000 0.10000 1.0000 0.0000 1.0000
1.1000 0.50000 0.10000 /
3300 'GENROU' 1 10.800 0.50000E-01 1.0000 0.50000E-01
6.0000 0.0000 2.4200 2.0000 0.23000
0.41080 0.16000 0.14812 0.10890 0.37795 /
/3300 'STAB2A' 1 1.0000 4.5000 0.0000 2.0000
/ 0.55000 1.0000 0.10000E-01 0.30000E-01/
3300 'SCRX' 1 0.0000 0.40000E-01 10.000 0.40000E-01
0.0000 5.0000 0.0000 0.0000 /
3300 'IEESGO' 1 0.10000E-01 0.0000 0.15000 0.30000
8.0000 0.40000 0.0000 0.70000 0.43000
1.0000 0.0000 /
3359 'GENROU' 1 4.7500 0.50000E-01 1.0000 0.50000E-01
4.8200 0.0000 2.1300 2.0300 0.31000
0.40300 0.19370 0.14531 0.10890 0.37795 /
/3359 'STAB2A' 1 1.0000 4.5000 0.0000 2.0000
/ 0.68000 1.0000 0.10000E-01 0.30000E-01/
3359 'SCRX' 1 0.20000 10.000 165.00 0.40000E-01
0.0000 5.0000 0.0000 0.0000 /
3359 'IEESGO' 1 0.10000E-01 0.0000 0.15000 0.30000
8.0000 0.40000 0.0000 0.70000 0.43000
1.0000 0.0000 /
5100 'GENSAL' 1 4.9629 0.50000E-01 0.15000 3.9871
0.0000 1.1332 0.68315 0.24302 0.15135
0.13405 0.10000 0.30000 /
5100 'SEXS' 1 0.50000E-01 100.00 200.00 0.50000
0.0000 4.0000 /
5100 'HYGOV' 1 0.60000E-01 0.40000 5.0000 0.50000E-01
0.20000 0.20000 1.0000 0.0000 1.0000
1.1000 0.50000 0.10000 /
5300 'GENSAL' 1 6.4000 0.50000E-01 0.15000 3.5000
0.0000 1.1400 0.84000 0.34000 0.26000
0.20000 0.10000 0.30000 /
/5300 'STAB2A' 1 1.0000 4.5000 0.0000 2.0000
/ 0.55000 1.0000 0.10000E-01 0.30000E-01/
5300 'STAB1' 1 25.00 5.0000 4.200 0.03
4.200 0.03 0.10000E-00/
5300 'SCRX' 1 0.25385 13.000 61.000 0.50000E-01
0.0000 4.0000 0.0000 0.0000 /
5300 'HYGOV' 1 0.60000E-01 0.40000 5.0000 0.50000E-01
0.20000 0.20000 1.0000 0.0000 1.0000
1.1000 0.50000 0.10000 /
5400 'GENSAL' 1 6.5000 0.50000E-01 0.15000 4.1000
0.0000 1.0200 0.63000 0.25000 0.16000
0.13000 0.10000 0.30000 /
5400 'SEXS' 1 0.50000E-01 100.00 200.00 0.50000
0.0000 4.0000 /
5400 'HYGOV' 1 0.60000E-01 0.40000 5.0000 0.50000E-01
0.20000 0.20000 1.0000 0.0000 1.0000
1.1000 0.50000 0.10000 /
5500 'GENSAL' 1 7.1980 0.50000E-01 0.15000 3.0000
0.0000 1.2364 0.65567 0.37415 0.22825
0.16194 0.10000 0.30000 /
5500 'SEXS' 1 0.50000E-01 100.00 200.00 0.50000
0.0000 4.0000 /
5500 'HYGOV' 1 0.60000E-01 0.40000 5.0000 0.50000E-01
0.20000 0.20000 1.0000 0.0000 1.0000

```

Appendix D. Nordic 44 System

```

1.1000      0.50000      0.10000      /
5600 'GENSAL' 1      7.8500      0.50000E-01      0.15000      3.5000
      0.0000      1.0000      0.51325      0.38000      0.28000
      0.21000      0.10000      0.30000      /
5600 'STAB1' 1      26.97      3.0000      7.881      0.03
      7.881      0.03      0.10000E-00/
5600 'SCRX' 1      0.25385      13.000      61.000      0.50000E-01
      0.0000      4.0000      0.0000      0.0000      /
5600 'HYGOV' 1      0.60000E-01      0.30000      5.0000      0.50000E-01
      0.20000      0.20000      1.0000      0.0000      1.0000
      1.1000      0.50000      0.10000      /
6000 'GENSAL' 1      9.7000      0.50000E-01      0.15000      3.5000
      0.0000      1.2800      0.94000      0.37000      0.28000
      0.20000      0.10000      0.30000      /
6000 'SEXS' 1      1.0000      0.10000      20.000      0.10000
      -4.0000      4.0000      /
6000 'HYGOV' 1      0.60000E-01      0.30000      5.0000      0.50000E-01
      0.20000      0.20000      1.0000      0.0000      1.0000
      1.1000      0.50000      0.10000      /
6100 'GENSAL' 1      9.9000      0.50000E-01      0.15000      3.0000
      0.0000      1.2000      0.73000      0.37000      0.18000
      0.15000      0.10000      0.30000      /
/6100 'STAB2A' 1      1.0000      4.5000      0.0000      2.0000
/      0.55000      1.0000      0.10000E-01      0.30000E-01/
6100 'SCRX' 1      0.25385      13.000      61.000      0.50000E-01
      0.0000      4.0000      0.0000      0.0000      /
6100 'HYGOV' 1      0.60000E-01      0.40000      5.0000      0.50000E-01
      0.20000      0.20000      1.0000      0.0000      1.0000
      1.1000      0.50000      0.10000      /
6500 'GENSAL' 1      5.4855      0.50000E-01      0.15000      3.5580
      0.0000      1.0679      0.64200      0.23865      0.15802
      0.13514      0.10000      0.30000      /
6500 'SEXS' 1      0.50000E-01      100.00      200.00      0.50000
      0.0000      4.0000      /
6500 'HYGOV' 1      0.60000E-01      0.40000      5.0000      0.50000E-01
      0.20000      0.20000      1.0000      0.0000      1.0000
      1.1000      0.50000      0.10000      /
6700 'GENSAL' 1      5.2400      0.50000E-01      0.15000      3.5920
      0.0000      1.1044      0.66186      0.25484      0.17062
      0.14737      0.10000      0.30000      /
/6700 'STAB2A' 1      1.0000      4.5000      0.0000      2.0000
/      0.55000      1.0000      0.10000E-01      0.30000E-01/
6700 'STAB1' 1      5.442      3.0000      6.962      0.03
      6.962      0.03      0.10000E-00/
6700 'SCRX' 1      0.25385      13.000      61.000      0.50000E-01
      0.0000      4.0000      0.0000      0.0000      /
6700 'HYGOV' 1      0.60000E-01      0.40000      5.0000      0.50000E-01
      0.20000      0.20000      1.0000      0.0000      1.0000
      1.1000      0.50000      0.10000      /
7000 'GENROU' 1      10.000      0.50000E-01      1.0000      0.50000E-01
      5.5000      0.0000      2.2200      2.1300      0.36000
      0.46800      0.22500      0.16875      0.10890      0.37795      /
/7000 'STAB2A' 1      1.0000      1.0000      0.0000      2.0000      /
/      0.55000      1.0000      0.10000E-01      0.30000E-01/
7000 'STAB1' 1      5.192      5.0000      13.50      0.03
      13.50      0.03      0.10000E-00/
7000 'IEEET2' 1      0.0000      800.00      0.40000E-01      5.3200
      -4.0500      1.0000      0.44000      0.66700E-01      2.0000
      0.44000      6.5000      0.54000E-01      8.0000      0.20200      /
7000 'IEESGO' 1      0.10000E-01      0.0000      0.15000      0.30000
      8.0000      0.40000      0.0000      0.70000      0.43000
      1.0000      0.0000      /
7100 'GENSAL' 1      5.0000      0.60000E-01      0.10000      3.2000
      0.0000      0.75000      0.50000      0.25000      0.15385
      0.11538      0.10239      0.27420      /
/7100 'STAB2A' 1      1.0000      4.5000      0.0000      2.0000
/      0.55000      1.0000      0.10000E-01      0.30000E-01/
7100 'SCRX' 1      0.25385      13.000      61.000      0.50000E-01
      0.0000      4.0000      0.0000      0.0000      /
7100 'HYGOV' 1      0.60000E-01      0.40000      5.0000      0.50000E-01
      0.20000      0.10000      1.0000      0.0000      1.0000
      1.0100      0.50000      0.10000      /
8500 'GENROU' 1      10.000      0.50000E-01      1.0000      0.50000E-01
      7.0000      0.0000      2.4200      2.0000      0.23000
      0.41080      0.17062      0.14812      0.10890      0.37795      /
/8500 'STAB2A' 1      1.0000      4.5000      0.0000      2.0000      /
/      0.55000      1.0000      0.10000E-01      0.30000E-01/
8500 'SCRX' 1      0.0000      0.40000E-01      10.000      0.40000E-01
      0.0000      5.0000      0.0000      0.0000      /
8500 'IEESGO' 1      0.10000E-01      0.0000      0.15000      0.30000
      8.0000      0.40000      0.0000      0.70000      0.43000
      1.0000      0.0000      /

```